




CHUCK E. CHEESE



6700 Abercorn St, Savannah, GA 31405

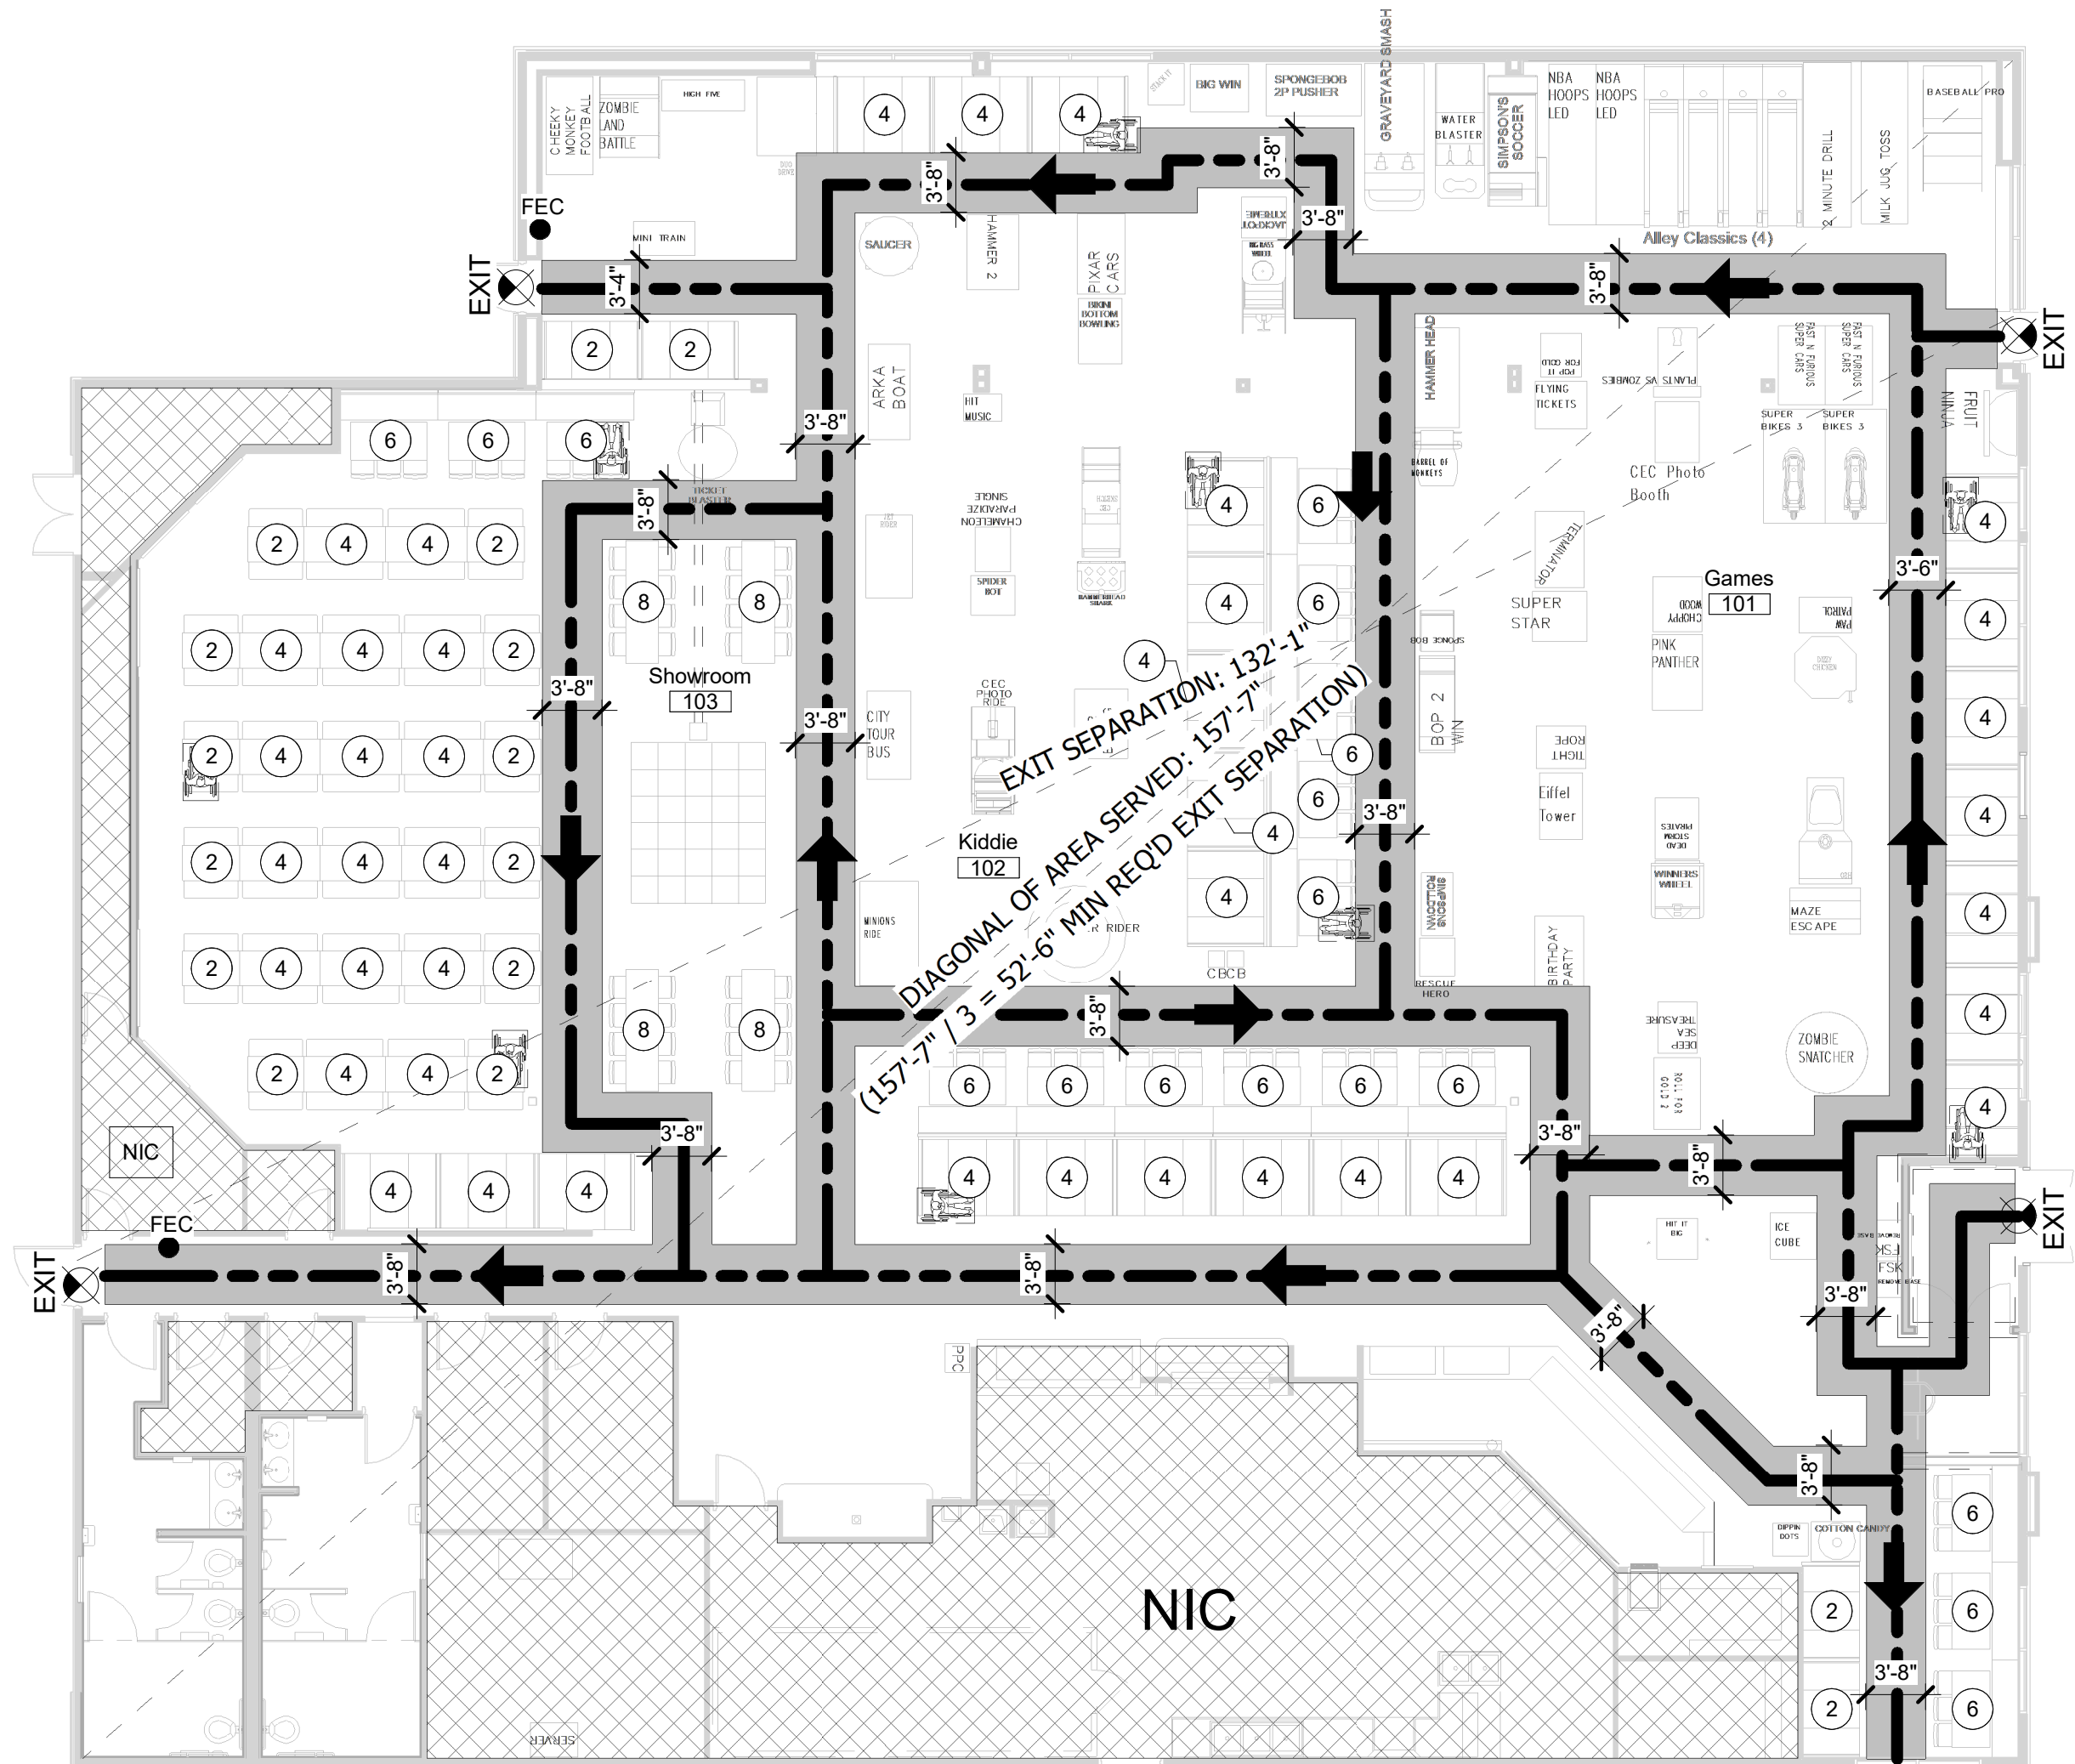


Accessible Seating

At least 5%, but not less than 1 of the dining surfaces shall be accessible. Accessible seating shall be identified by a sign or a marker.

16 Tables x 42" = 672"/24" = 28 x .05 = 1
41 Tables x 56" = 2,296"/24" = 96 x .05 = 5
16 Tables x 60" = 960"/24" = 40 x .05 = 2
4 Tables x 90" = 360"/24" = 15 x .05 = 1

Total Accessible Tables Required: 9

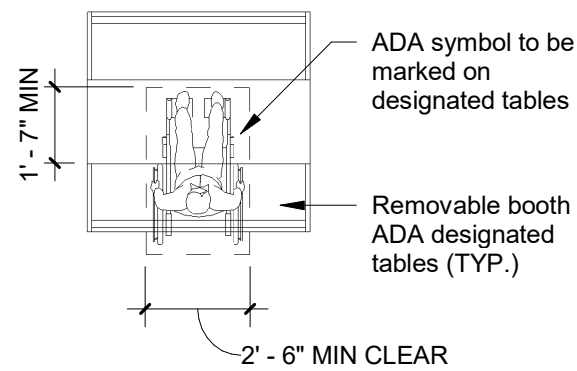

General Notes - Life Safety

- A Provide fire extinguishers within travel distance of 75'-0"
B All penetrations through rated assemblies shall be installed per U.L. standard details and applicable codes as required to maintain the integrity of rated assemblies

Material Flame Spread

Interior finishes shall be either Class A or B in accordance with NFPA 101, Section 12.3.3.2 and 12.3.3.3

Material	Class	Flame Spread
FRP Panels	Class A	
Plastic Laminate	Class A	
Carpet	Class A	
LT-1 Ceiling Tile	Class A	
LT-2 Ceiling Tile	Class A	
Sheet Vinyl	Class A	
VCT	Class A	
Vinyl Base	Class A	
Paint	Class A	
Slat Wall	Class A	

Life Safety Plan Legend

EXIT	Exit Light
→	Egress Pathway
●	Maximum Travel Distance
→	Diagonal Distance
FEC	Fire Extinguisher Cabinet
→	Direction of Egress
#	Seat count tag
♿	Accessible Seating Location

OCCUPANCY LOAD

Kiddie/Games Standing Area:	Proposed:
A) Gross Area:	3,103 SF
B) Area Covered By Games:	1,1501 SF
C) Net Area For Occupancy:	1,952 SF
D) Occupant Load Factor:	15 SF/Person
E) Occupancy:	130 People

Occupancy Calculations:	
A) Kiddie/Games Standing (per above):	130 People
B) Games Seating:	50 People
C) Kiddie Seating:	126 People
D) Showroom Seating @ 24"	150 People
E) Kitchen Occupancy (1,258sf @ 200sf/person)	6 People
Total Occupancy=	462 People

General Notes - Cover Sheet

A	No water, no sewer, no structural, no changes to occupancy SF, no work in the kitchen.
B	No part of these documents supercede the other, any discrepancies require clarification from the Architect.
C	All disciplines are referenced to each other, any discrepancies require clarification from the Architect.
D	Verify all existing conditions with the drawings, any discrepancies require clarification from the Architect.
E	OFCI means "Owner Furnished and Contractor Installed", identifies items that are provided by the owner and installed by the contractor as part of this contract.
F	NIC means "Not In Contract", identifies items that are provided and installed under a separate contract. Shown for reference only.
G	Alternate items that are identified shall be priced separately, pricing shall include item and installation cost for inclusion into the contract if selected by the owner.
H	Signage will be submitted for a separate permit by sign company.
I	Wood used for blocking in a rated wall must be fire treated.

PROJECT SCOPE

This is a reimage of an existing freestanding building currently operating as a Chuck E Cheese (CEC) store. Exterior scope includes painting building, replacing lighting, no structural modifications. Interior scope includes painting, replacing seating, tables, games, wall finishes, minimal lighting, and restroom fixtures. Excluded from the project is new signage, permitted and installed by a separate scope.

CODE SUMMARY

Use:	Restaurant
Occupancy Class:	A-2 (Restaurant)
Building Area:	11,801 SF
Occupants:	462 Occupants
Exit:	Required: 462 occupants x 0.15 = 69 Total Provided: 3'3"+3'3"+3'3"+6'0" = 189" Total


Building:	International Building Code 1, 2018
Mechanical:	International Mechanical Code 1, 2018
Electrical:	National Electric Code 2, 2017
Plumbing:	International Plumbing Code 1, 2018
Fire:	International Fire Code 1, 2 2018
Accessibility:	Georgia Accessibility Code 2015
Energy:	International Energy Conservation Code 1, 2015

Index of Drawings

Sheet Number	Sheet Name	Current Revision	Current Revision Date
General			
CS1.0	Cover Sheet	A	2021/07/16
CS2.0	Accessibility Standard	A	2021/07/16
CS3.0	Accessibility Standard	A	2021/07/16
Demolition			
D1.0	Demolition Floor Plan	A	2021/07/16
D1.1	Demolition RCP Plan	A	2021/07/16
D1.2	Demolition Elevations	A	2021/07/16
Architectural			
A1.0	Floor Plan	A	2021/07/16
A1.2	Dimension Outlet Plan	A	2021/07/16
A2.0	Floor Finish Plan	A	2021/07/16
A3.0	Reflected Ceiling Plan	A	2021/07/16
A4.0	Exterior Elevations	A	2021/07/16
A5.0	Interior Elevations	A	2021/07/16
A5.1	Interior Elevations	A	2021/07/16
A7.3	Interior Details	A	2021/07/16
A7.4	Interior Details	A	2021/07/16
A8.0	Schedules	A	2021/07/16
A9.2	Enlarged Restroom Plan	A	2021/07/16
Plumbing			
MP1.0	Plumbing	A	2021/07/16
Electrical			
AV1	Speaker Plan	A	2021/07/16
E0.0	Legend & Keynotes	A	2021/07/16
E1.0	Lighting Floor Plan	A	2021/07/16
E2.0	Power Floor Plan	A	2021/07/16
E3.0	Electrical Details	A	2021/07/16



Location Map

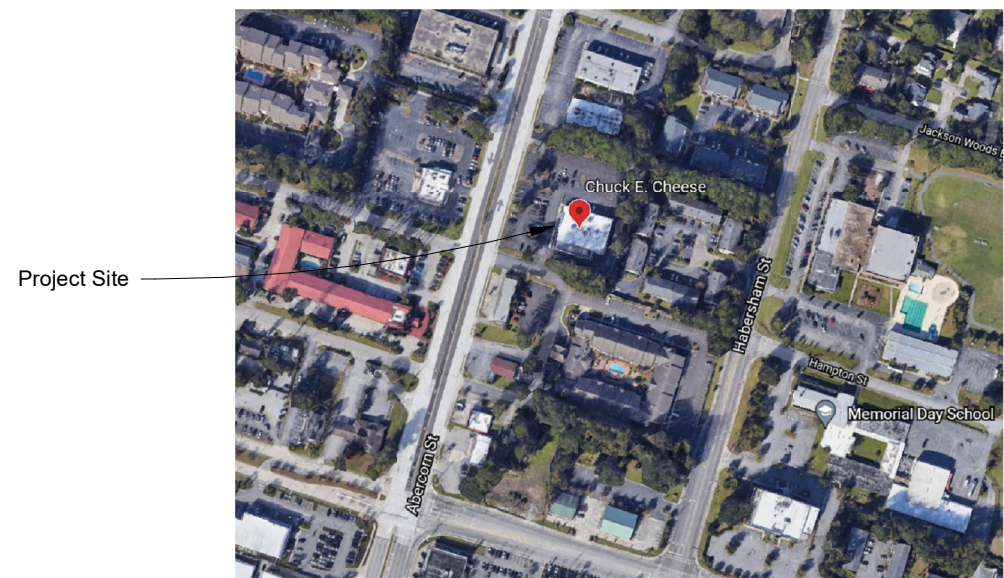

Vicinity Map

CITY OF SAVANNAH
DEVELOPMENT
SERVICES

PLAN
APPROVED
08/02/2021



#605

6700 Abercorn Savannah, GA
31405

Owner:
CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect:
Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75087
Ph: 972-221-1979
Contact: Michael Orr

MEP Engineer:
Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: (816)997.9627
Contact: Joe Hillsbrenner, P.E.



Architect: William D. Pounds

A	Permit Set	2021/07/16
No.	Description	Date

DRAWN BY: EO
CHECKED BY: VG
PROJ. NO: 94-21781
PKWY Architects, LLC © 2021

Cover Sheet

CS1.0

301 General. The provisions of Chapter 3 shall apply where required by Chapter 2 or where referenced by a requirement in this document.

302 Floor or Ground Surfaces

Figure 302.2 Carpet Pile Height

302.3 Openings. Openings in floor or ground surfaces shall not allow passage of a sphere more than 1/2 inch (13 mm) diameter except as allowed in 407.4.3, 409.4.3, 410.4, 810.5.3 and 810.10. Elongated openings shall be placed so that the long dimension is perpendicular to the dominant direction of travel.

Figure 302.3 Elongated Openings in Floor or Ground Surfaces

303 Changes in Level

303.1 General. Where changes in level are permitted in floor or ground surfaces, they shall comply with 303.

EXCEPTIONS:

1. Animal containment areas shall not be required to comply with 303.
2. Areas of sport activity shall not be required to comply with 303.

303.2 Vertical. Changes in level of 1/4 inch (6.4 mm) high maximum shall be permitted to be vertical.

Figure 303.2 Vertical Change in Level

303.3 Beveled. Changes in level between 1/4 inch (6.4 mm) high minimum and 1/2 inch (13 mm) high maximum shall be beveled with a slope not steeper than 1:2.

Figure 303.3 Beveled Change in Level

303.4 Ramps. Changes in level greater than 1/2 inch (13 mm) high shall be ramped, and shall comply with 405 or 406.

304 Turning Space

304.1 General. Turning space shall comply with 304.

304.3 Size. Turning space shall comply with 304.3.1 or 304.3.2.

304.3.1 Circular Space. The turning space shall be a space of 60 inches (1525 mm) diameter minimum. The space shall be permitted to include knee and toe clearance complying with 306.

304.3.2 T-Shaped Space. The turning space shall be a T-shaped space within a 60 inch (1525 mm) square minimum with arms and base 36 inches (915 mm) wide minimum. Each arm of the T shall be clear of obstructions 12 inches (305 mm) minimum in each direction and the base shall be clear of obstructions 24 inches (610 mm) minimum. The space shall be permitted to include knee and toe clearance complying with 306 only at the end of either the base or one arm.

Figure 304.3.2 T-Shaped Turning Space

304.4 Door Swing. Doors shall be permitted to swing into turning spaces.

305 Clear Floor or Ground Space

305.1 General. Clear floor or ground space shall comply with 305.

305.2 Floor or Ground Surfaces. Floor or ground surfaces of a clear floor or ground space shall comply with 302. Changes in level are not permitted.

EXCEPTION: Slopes not steeper than 1:48 shall be permitted.

305.3 Size. The clear floor or ground space shall be 30 inches (760 mm) minimum by 48 inches (1220 mm) minimum.

Figure 305.3 Clear Floor or Ground Space

305.4 Knee and Toe Clearance. Unless otherwise specified, clear floor or ground space shall be permitted to include knee and toe clearance complying with 306.

305.5 Position. Unless otherwise specified, clear floor or ground space shall be positioned for either forward or parallel approach to an element.

Figure 305.5 Position of Clear Floor or Ground Space

305.6 Approach. One full unobstructed side of the clear floor or ground space shall adjoin an accessible route or adjoin another clear floor or ground space.

305.7 Maneuvering Clearance. Where a clear floor or ground space is located in an alcove or otherwise confined on all or part of three sides, additional maneuvering clearance shall be provided in accordance with 305.7.1 and 305.7.2.

306 Knee and Toe Clearance

306.1 General. Where space beneath an element is included as part of clear floor or ground space or turning space, the space shall comply with 306. Additional space shall not be prohibited beneath an element but shall not be considered as part of the clear floor or ground space or turning space.

306.2 Toe Clearance.


306.2.1 General. Space under an element between the finish floor or ground and 9 inches (230mm) above the finish floor or ground shall be considered toe clearance and shall comply with 306.2.

306.2.2 Maximum Depth. Toe clearance shall extend 25 inches (635 mm) maximum under an element.

306.2.3 Minimum Required Depth. Where toe clearance is required at an element as part of a clear floor space, the toe clearance shall extend 17 inches (430 mm) minimum under the element.

306.2.4 Additional Clearance. Space extending greater than 6 inches (150 mm) beyond the available knee clearance at 9 inches (230 mm) above the finish floor or ground shall not be considered toe clearance.

306.2.5 Width. Toe clearance shall be 30 inches (760 mm) wide minimum.

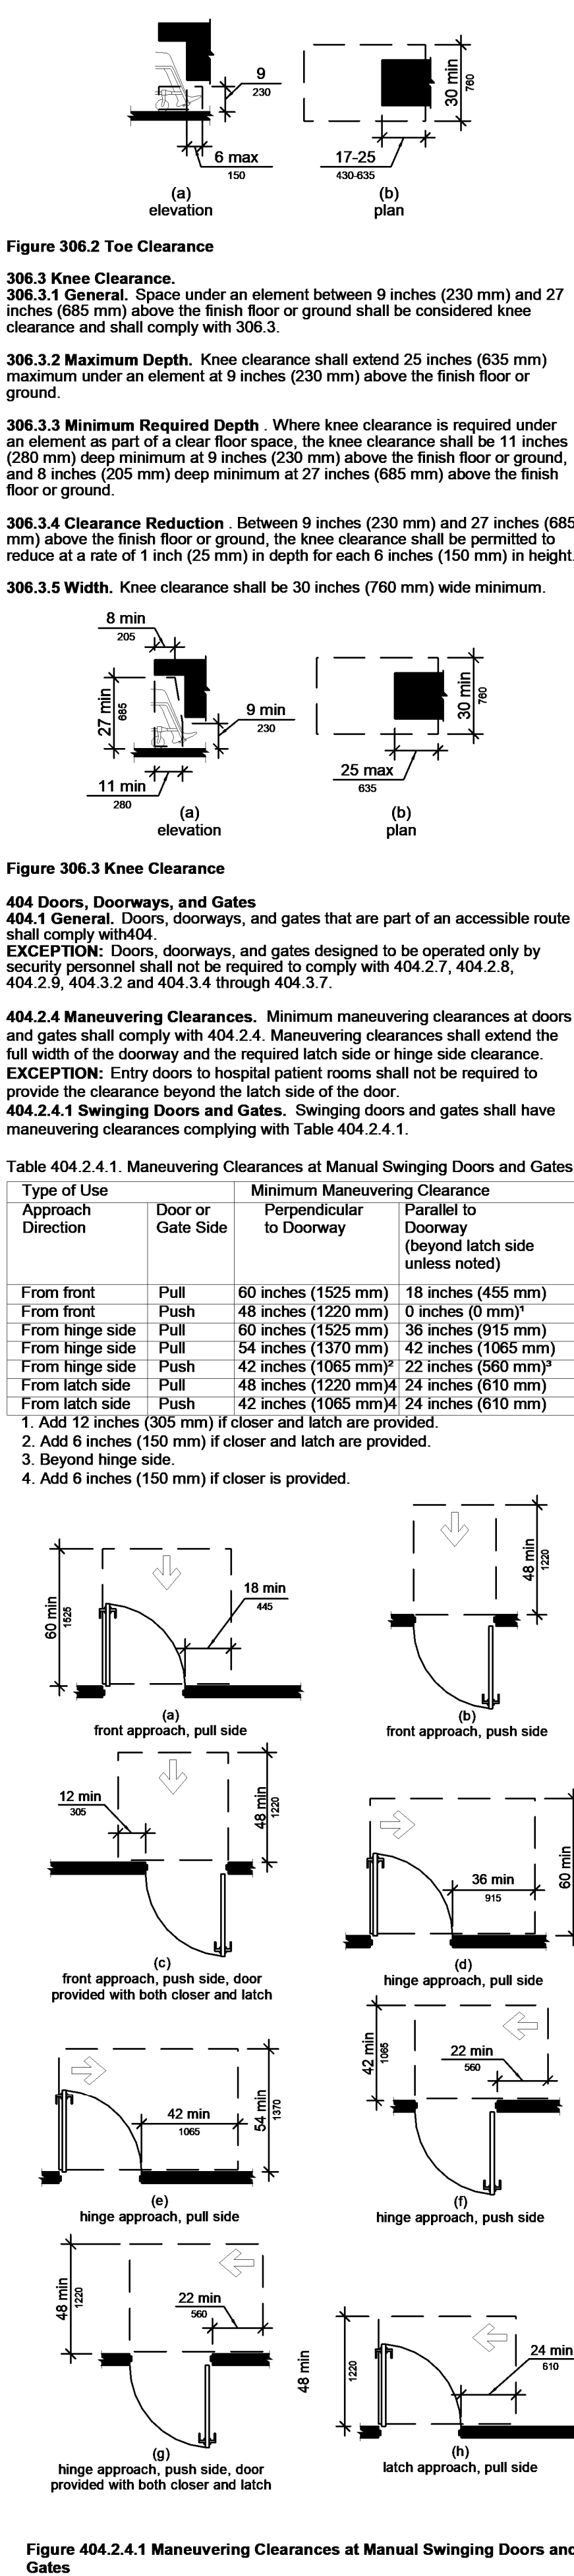

CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Michael Or

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: (816)997.9627
Contact: Joe Hillebrenner, P.E.



DRAWN BY: EO
CHECKED BY: VG
PROJ. NO: 94-21781

PKWY Architects, LLC © 2021

D1.0

Key #	Demolition Notes
A	Existing conditions are based on field observations. The demolition plan is for reference only. Contractor to verify existing conditions prior to the start of work.
B	Demolish indicated structures and fixtures in an orderly and careful manner.
C	Provide temporary supports, shoring and bracing as required to protect existing structural items remaining in place. Verify and coordinate existing utilities to be removed and/or relocated.
D	Erect waterproof enclosure for exterior openings created by demolition work.
E	Demolished items shall be removed from site and legally disposed of.
F	Protect existing landscape materials, appurtenances, and structures which are to remain.
G	Remove all floor finishes down to substrate.
H	Remove walls and structures down to surface which may be refinished.
J	Where the scope of work requires penetration of the existing slab, the GC shall verify existing slab's construction type. GC to notify owner if a structural supported slab is found. Do not cut any portion of slab's structural reinforcement. If penetration exceeds 8" width, install reinforcing #5 x 18" dowels with 9" embedment @ 18" O.C. The GC & sub-contractors shall maintain the integrity of the existing slab by patching and repairing as needed.
K	Disconnect, remove and cap designated MEP utilities and fixtures within demolition areas. Mark location of disconnected utilities.
L	Remove abandoned electrical equipment to source of supply. Verify that abandoned wiring and equipment serves only abandoned facilities. Coordinate utility service outages with utility company. Cut conduit flush with or beneath walls and floors, and refinish surfaces.
M	When encountered, inform owner of presence of contaminated materials. Contaminated materials are to be removed by others. Verify that previously removed materials are acceptable prior to commencement of demolition work.

	Scope of Work		Door to be removed
	Not In Contract		Scope Note
	Construction to be removed		Floor outlet
	Existing wall to remain		Wall outlet
'E' Existing 'D' Demolish 'R' Relocate 'N' New			

1	Remove (40 +/-) floor outlets throughout Kiddie and Games rooms.
2	Remove existing furniture.
3	Remove existing carpet. Include Aux and storage rooms.
4	Remove marlite in vestibule, kid check and restroom vestibule.
5	Remove floor tile as indicated.
6	Demolish studio C.
7	Remove and protect digital menu board for tile installation.
8	Relocate salad bar.
9	Remove existing decor.
10	Restroom: remove floor tile, wall tile, toilets, urinals, vanities, partitions, accessories, 2x4 lights, light box, etc. Demo wall finish to framing. Remove door if applicable.
11	Remove stanchions at kid check.
12	Relocate track lights as needed to illuminate wall decor.
13	
14	Demolish doors at entry and vestibule.
15	
16	6" wide trench line to 13"x13" rough opening in slab for new recessed dance floor.
17	Remove existing light box. Power to remain.
18	Remove window and portion of wall.
19	Remove half walls.
20	Remove fixture and cap.

$$\frac{1}{8}'' = 1'-0''$$



Legend - Demo Plan

- Scope of Work
- NIC Not In Contract
- Construction to be removed
- Existing wall to remain
- Existing Demolish
- Demolish
- Relocate
- New
- Door to be removed
- Scope Note
- Floor outlet
- Wall outlet

Legend - Reflected Ceiling Plan

- Existing Acoustical lay-in ceiling LT-1
- Existing Acoustical lay-in ceiling LT-2
- Gypsum ceiling
- Ceiling Tag
- Ceiling Finish Code
- Ceiling Height (A.F.F.)
- 24" x 48" Troffer
- Recessed Can Light
- Vanity Light - 7'-0" AFF
- Pendant - 6'-0" AFF
- Exterior Wall Sconce
- 48" Industrial Fluorescent Strip
- Wall mount Television
- Exit Sign
- Supply Diffuser (Ref. Mechanical)
- Return Diffuser (Ref. Mechanical)
- Access Panel

Scope Notes Demolition RCP

1	
2	
3	
4	
5	
6	Relocate track lights as needed to illuminate wall decor.

1 Demo Reflected Ceiling Plan

1/8" = 1'-0"

CITY OF SAVANNAH
DEVELOPMENT
SERVICES

PLAN
APPROVED
08/02/2021



#605

6700 Abercorn Savannah, GA
31405

Owner:

CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect:

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Michael Orr

MEP Engineer:

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: (816)997.9627
Contact: Joe Hillebrenner, P.E.



Architect: William D. Pounds

A	Permit Set	2021/07/16
No.	Description	Date

DRAWN BY: EO


CHECKED BY: VG

PROJ. NO: 94-21781


PKWY Architects, LLC © 2021

Demolition RCP Plan


D1.1

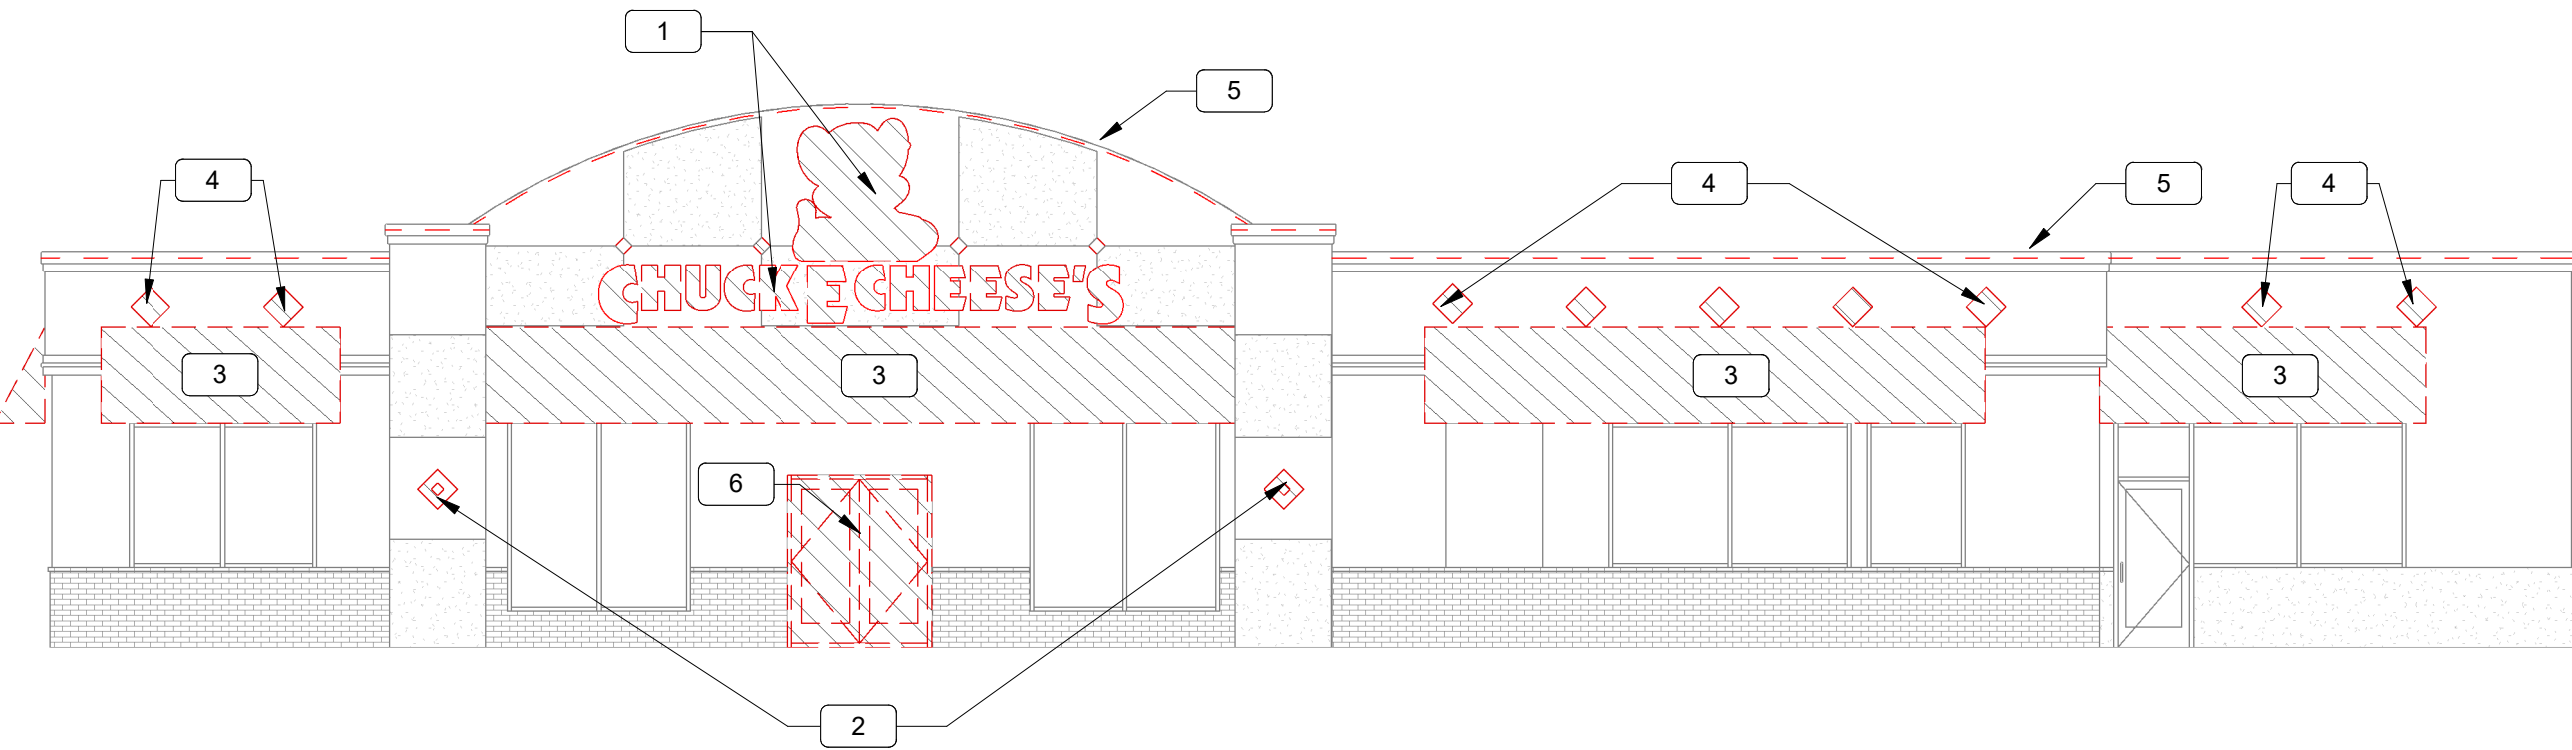


1 Front Demo Elevations
1/8" = 1'-0"

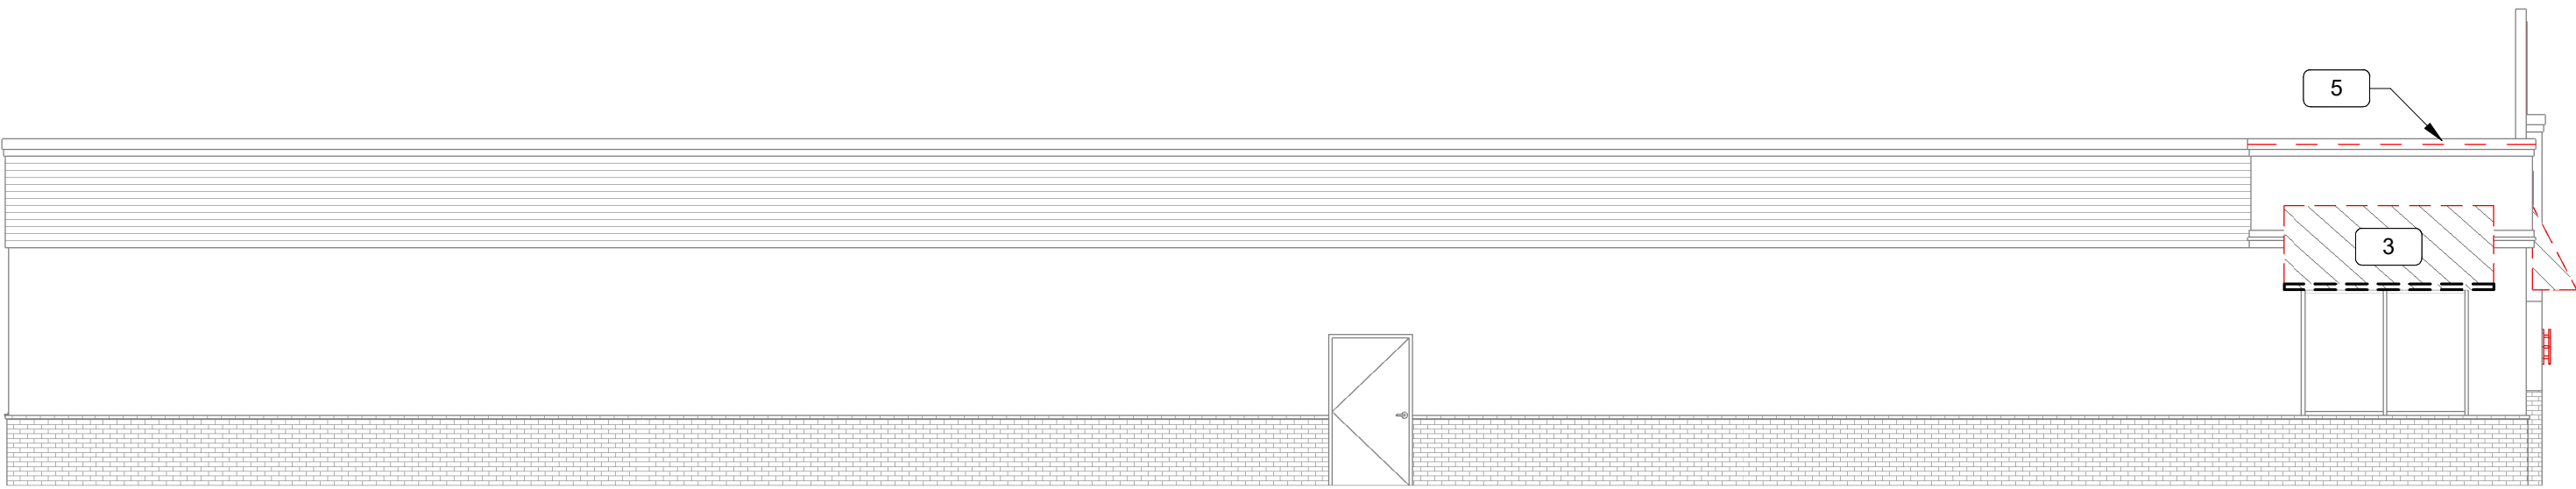

2 Left Demo Elevations
1/8" = 1'-0"

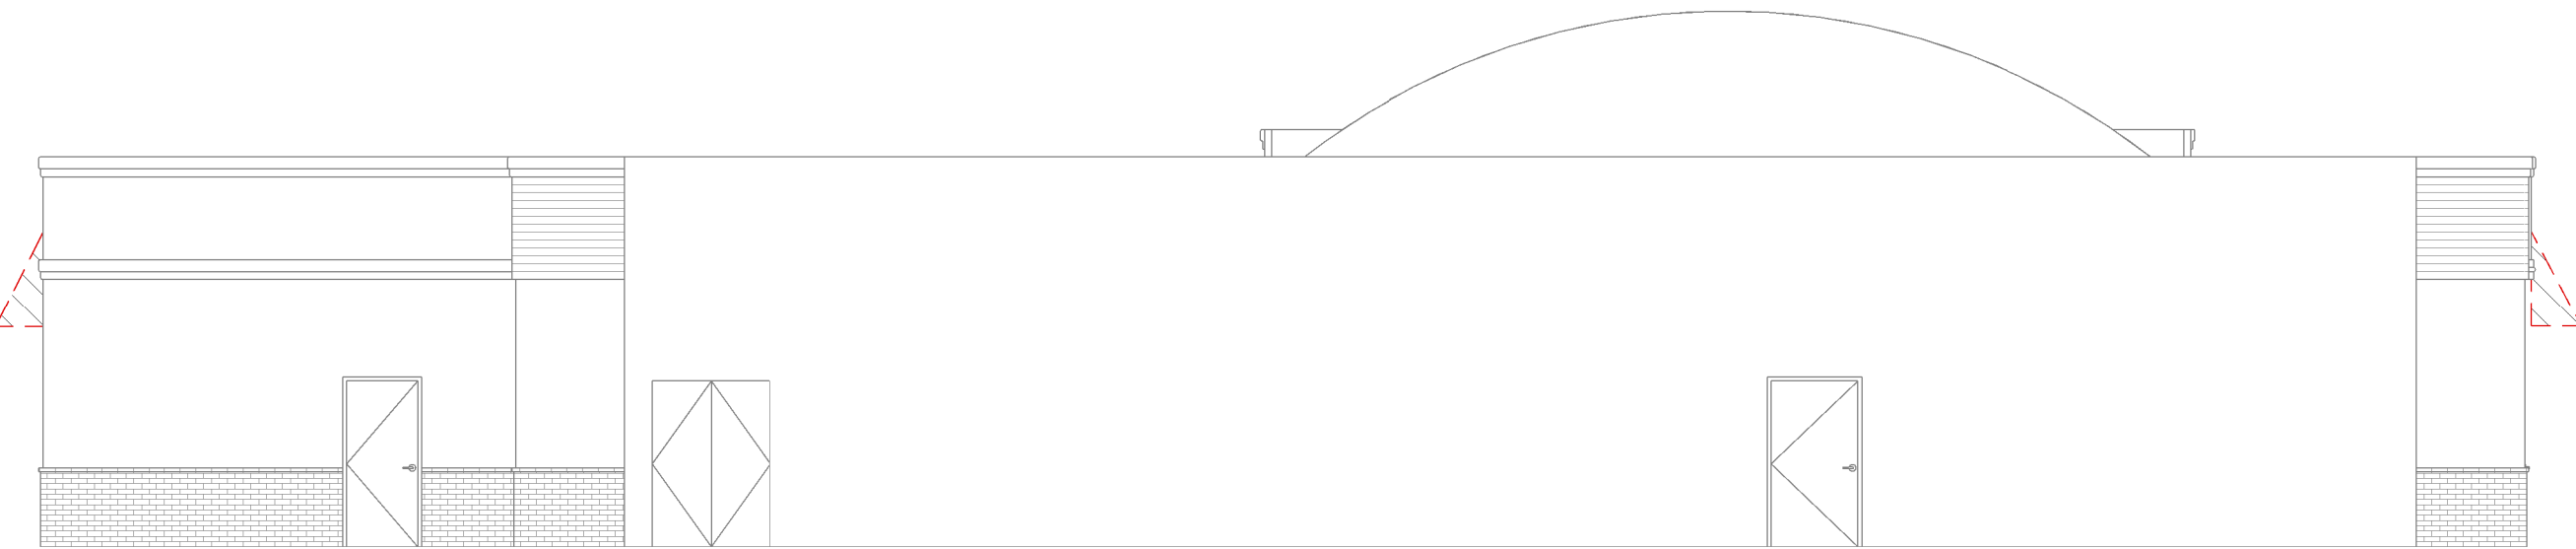

3 Rear Demo Elevations
1/8" = 1'-0"

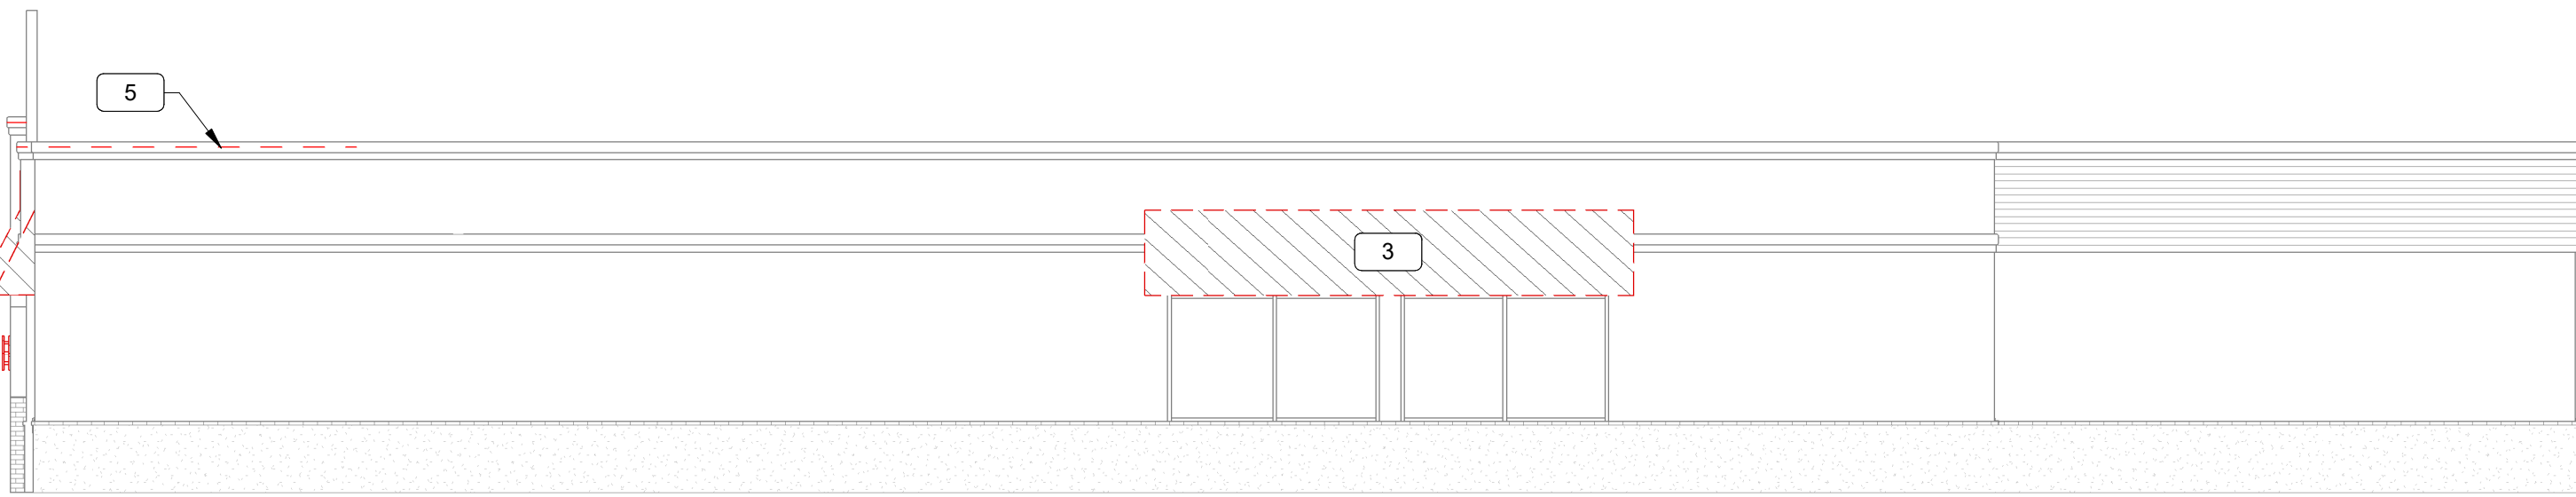

4 Right Demo Elevations
1/8" = 1'-0"

General Notes - Demolition

Key #	Demolition Notes
A	Existing conditions are based on field observations. The demolition plan is for reference only. Contractor to verify existing conditions prior to the start of work.
B	Demolish indicated structures and fixtures in an orderly and careful manner.
C	Provide temporary supports, shoring and bracing as required to protect existing structural items remaining in place. Verify and coordinate existing utilities to be removed and/or relocated.
D	Erect weatherproof closures for exterior openings created by demolition work.
E	Demolished items shall be removed from site and legally disposed of.
F	Protect existing landscape materials, appurtenances, and structures which are to remain.
G	Remove all floor finishes down to substrate.
H	Remove walls and structures down to surface which may be refinished.
J	Where the scope of work requires penetration of the existing slab, the GC shall verify existing slab's construction type. GC to notify owner if a structural supported slab is found. Do not cut any portion of the slab's structural reinforcing. If trench exceeds 8" width, install reinforcing #5 x 18" dowels with 9" embedment @ 18" O.C. The GC & sub-contractors shall maintain the integrity of the existing slab by patching and repairing as needed.
K	Disconnect, remove and cap designated MEP utilities and fixtures within demolition areas. Mark location of disconnected utilities.
L	Remove abandoned electric wiring to source of supply. Verify that abandoned wiring and equipment serves only abandoned facilities. Coordinate utility service outages with utility company. Cut conduit flush with or beneath walls and floors, and refinish surfaces.
M	When encountered, inform owner of presence of contaminated materials. Contaminated materials are to be removed by others. Verify that previously removed materials are acceptable prior to commencement of demolition work.

Legend - Demo Plan

	Scope of Work		Door to be removed
	Not In Contract		Scope Note
	Construction to be removed		Floor outlet
	Existing wall to remain		Wall outlet
E'	Existing		
D'	Demolish		
R'	Relocate		
N'	New		

Scope Notes Demolition Elevation

1	Remove signage.
2	Remove sconce.
3	Remove awning.
4	Remove accent diamond.
5	Remove LED accents at parapet.
6	Remove storefront door.

CITY OF SAVANNAH
DEVELOPMENT
SERVICES

PLAN
APPROVED
08/02/2021



#605

6700 Abercorn Savannah, GA
31405

Owner:

CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect:

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Michael Orr

MEP Engineer:

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: (816)997.9627
Contact: Joe Hillebrenner, P.E.



Architect: William D. Pounds

A	Permit Set	2021/07/16
No.	Description	Date

DRAWN BY: EO


CHECKED BY: VG

PROJ. NO: 94-21781


PKWY Architects, LLC © 2021

Demolition Elevations

D1.2

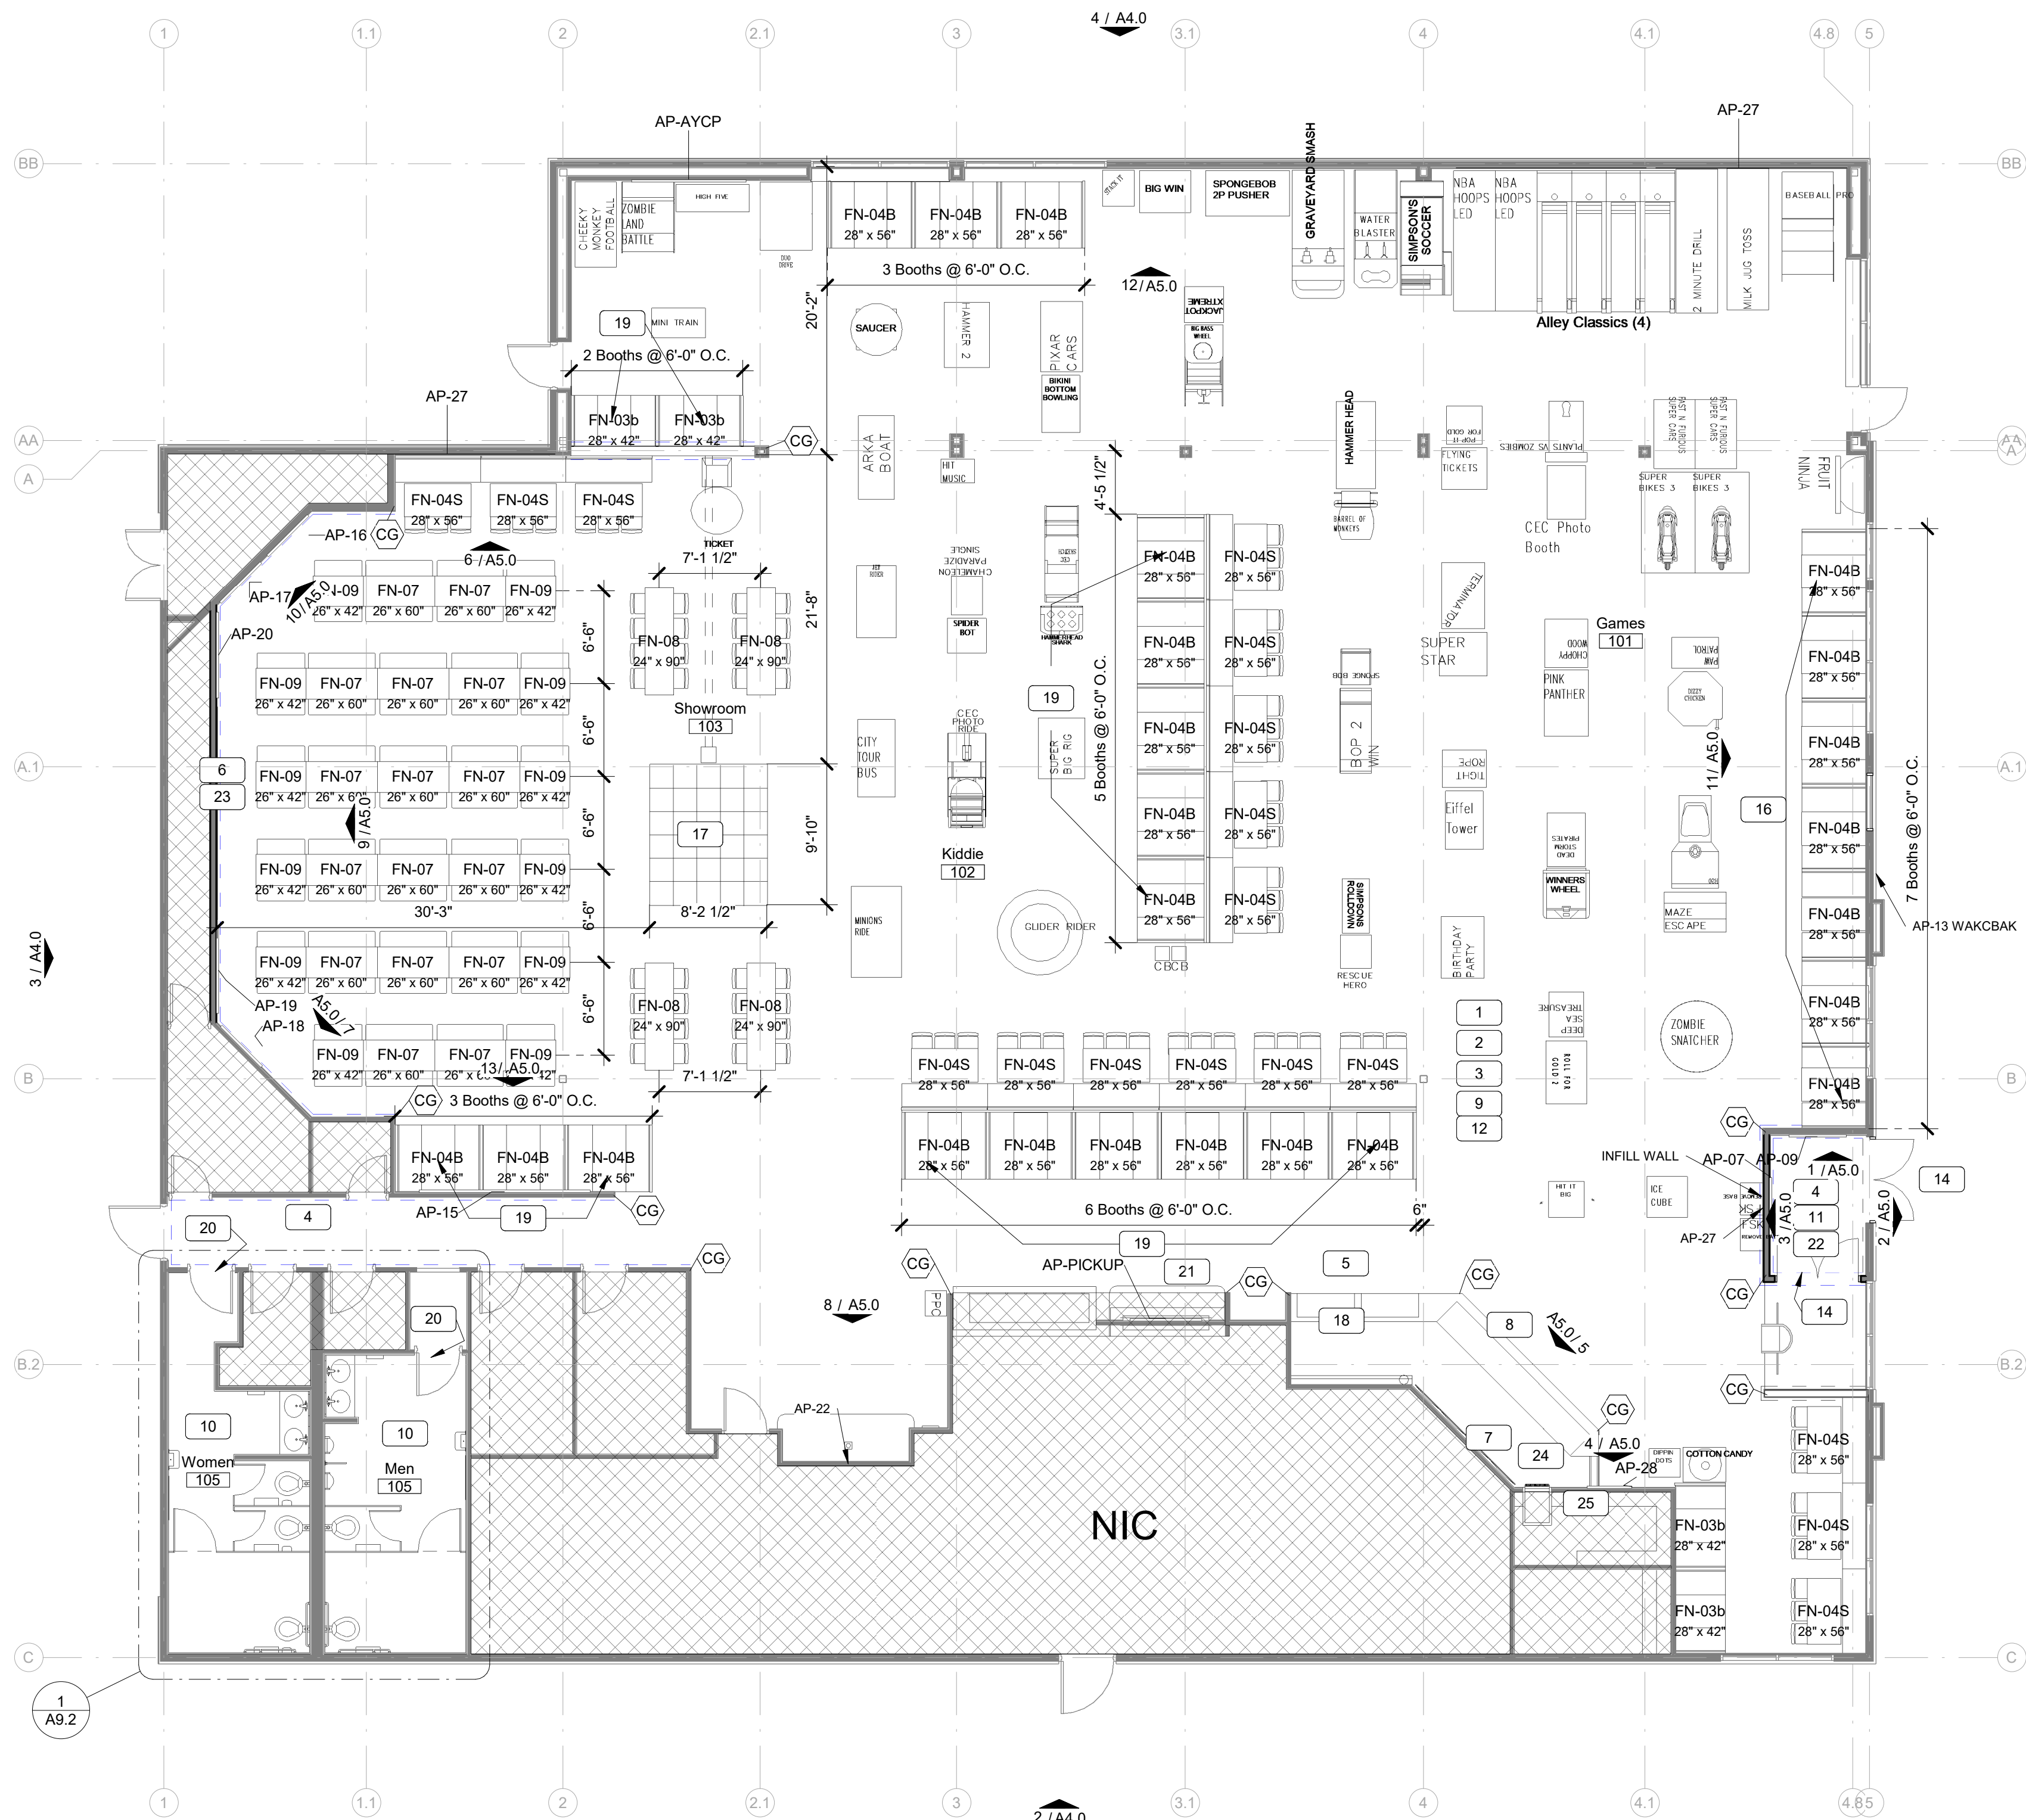

1 Floor Plan
1/8" = 1'-0"

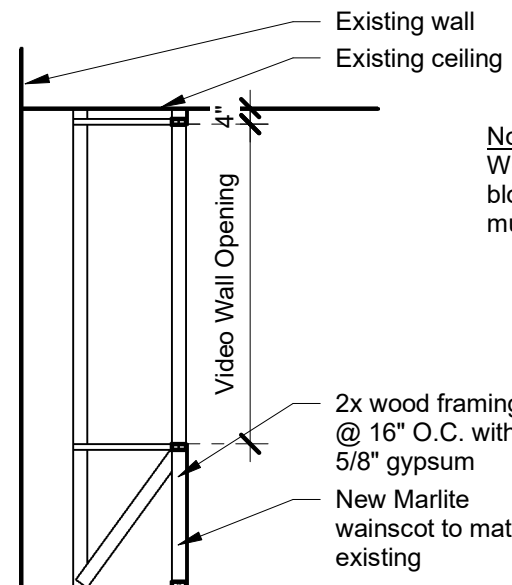

2 Section @ Video Wall
1/4" = 1'-0"

General Notes - Floor Plan

Key #	Floor Plan General Notes
A	Interior "Clear" dimensions are finish dimensions, "Hold" are to finish face.
B	Security systems are to be provided and installed by others. General Contractor shall be responsible for coordination with owner's security systems contractor.
C	All gypsum board to be installed per manufacturer's recommendations. Gypsum board shall be taped and bedded. Provide fire tape at fire rated partitions. See specifications. Level 4 Finish @ new character wall or match existing texture.
D	Provide wood blocking in partitions as required. Coordinate with owner on items/fixtures and equipment installed by owner that may require blocking.
E	Wall surfaces must be cleaned and dust free prior to caulking.
F	Include 45 LF of painted grey specialty stripes.
G	Caulk at chairrail throughout guest area.

General Notes - Furniture

A	New booth's and settee's to be fabricated by owner's millwork manufacturer and installed by the GC. Settee's to be mechanically fastened. Refer to manufacturer's shop drawings.
B	Booth divider panels to be mechanically fastened to booth seating. Refer to manufacturer's shop drawings.
C	Existing Kid check stanchions to be replaced with adjustable queue rail.
D	Existing millwork to remain. Replace red plastic laminate as indicated. Prep for new mosaic tile FRP.
E	GC to install new artwork, decor and coat hooks as indicated. GC to install matching corner guards as needed. Final location to be determined by CEC prior to construction. Do not install any decor until mounting locations have been verified by CEC PA.
F	Install fire extinguishers, alarm, PA controls, motion detector, emergency lighting, thermostats, etc. as required by local fire and/or building authorities. Installation of new art work and decor shall not be in conflict. Unspecified locations for non life safety items shall be verified with owner prior to installation. Unspecified locations for life safety items shall be verified with local fire and/or building authorities prior to installation. Install "Squawk Boxes" on all customer accessible pull stations
G	GC to coordinate installation of dance floor tiles & hex TV monitor frame installed above ceiling. Coordinate with CEC's manager of install power as indicated. Refer to Electrical sheets.

Legend - Floor Plan

Room name	Room name and number	AP-XX	Art Package
	101		Ref A8.0
1i	Toilet Accessory Tag	NIC	Not In Contract
CG	Corner Guard		Scope Note
	Center of Dance Floor		

Scope Notes - Floor Plan

1	50 +/- under carpet floor outlets throughout Kiddie and Game Rooms.
2	New furniture as indicated.
3	New Carpet layout, include AUX rooms and closets. High traffic carpet at entry vestibule to kid check, Patch floor from stanchion removal.
4	Install marlite in vestibule, kid check and restroom vestibule.
5	New wood look floor tile at cash wrap. See Floor Finish Plan.
6	Patch/repair wall from stage demo.
7	Protect digital menu board and install wall tile up to its mounting brackets.
8	Millwork: install mosaic FRP at order, salad, merch and beverage bar; FRP J-mold at corners as required.
9	Install decor; replace and/or remove all existing legal AJAX signage on exterior and interior during remodel process. Coordinate timing of legal signage removal and replacement so that store is not open without exterior/interior legal signage. Patch/repair from removal.
10	Restroom: install floor tile, wall tile, toilets, urnals, floating vanities, partitions, accessories, 2x4 lights and vanity light.
11	Sand and stain half-wall caps at entry.
12	Relocated (10) track lights to illuminate wall decor.
13	
14	Install dark bronze storefront door at entry and vestibule.
15	
16	Install (7) pendant lights.
17	New dance area with inslab elec. ((5) 20 amp circuits and (2) data.
18	Provide power and installation for "You Won" sign.
19	Install (7) wall outlets and (11) booth outlets.
20	Install restroom door with khaki laminate interior face, red laminate exterior face; paint the existing frame PT-02 Balboa Mist
21	Existing pass through window.
22	GC provided kid check doors if none are existing at entry podium.
23	Digital display wall, verify final size and location with CEC (include 1 data and 9 dedicated 20 amp circuits). Install Marlite and paint.
24	Provide 20 amp 220V circuit.
25	New digital promo board. Install data.
26	

Table Count

Type Mark	Description	Table Count
Games		
FN-03b	28" x 42"	2
FN-04B	28" x 56"	7
FN-04S	28" x 56"	3
Kiddie		
FN-03b	28" x 42"	2
FN-04B	28" x 56"	14
FN-04S	28" x 56"	11
Showroom		
FN-04B	28" x 56"	3
FN-04S	28" x 56"	3
FN-07	28" x 60"	16
FN-08	24" x 90"	4
FN-09	26" x 42"	12
		77



#605

6700 Abercorn Savannah, GA
31405

Owner:

CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect:

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75827
Ph: 972-221-1979
Contact: Michael Orr

MEP Engineer:

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: (816)997.9627
Contact: Joe Hillebrenner, P.E.



Architect: William D. Pounds

A	Permit Set	2021/07/16
No.	Description	Date

DRAWN BY: EO


CHECKED BY: VG

PROJ. NO: 94-21781






PKWY Architects, LLC © 2021

Floor Plan

A1.0

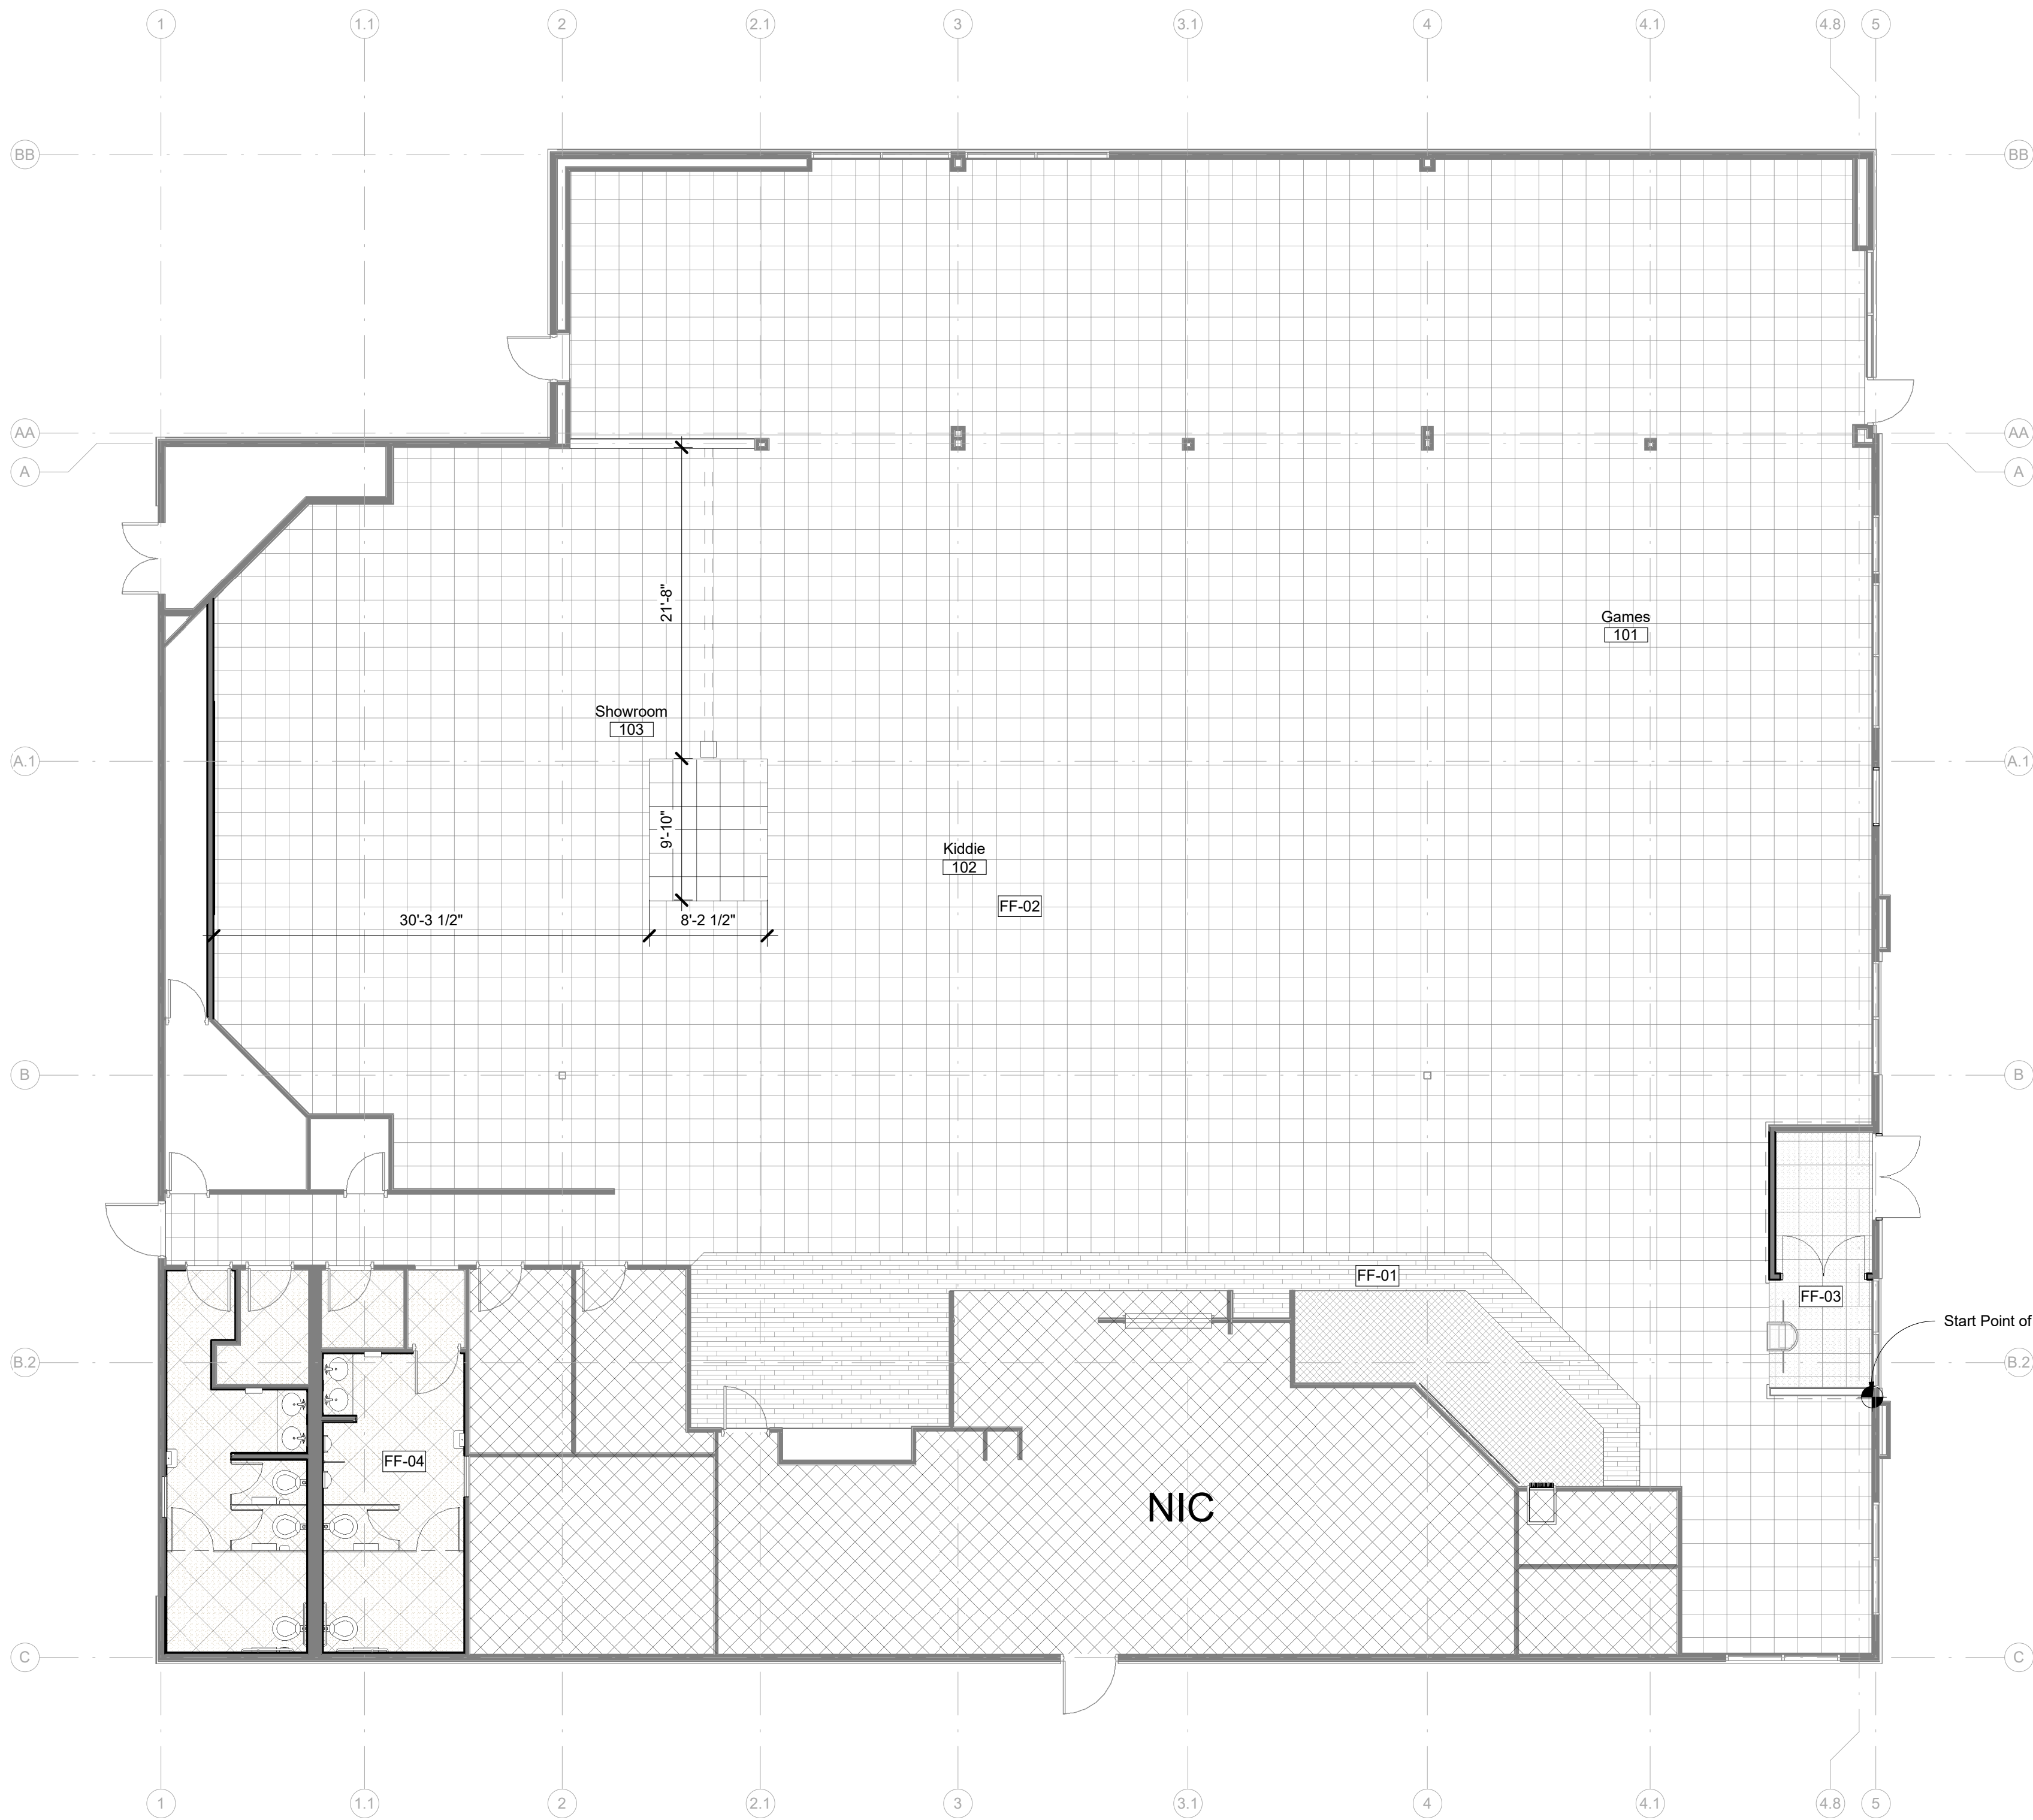

Floor Finish - Legend	
	FF-01 Porcelain Tile
	FF-02 Carpet Tile
	FF-03 High Traffic Entrance Carpet Tile
	FF-04 Ceramic Tile

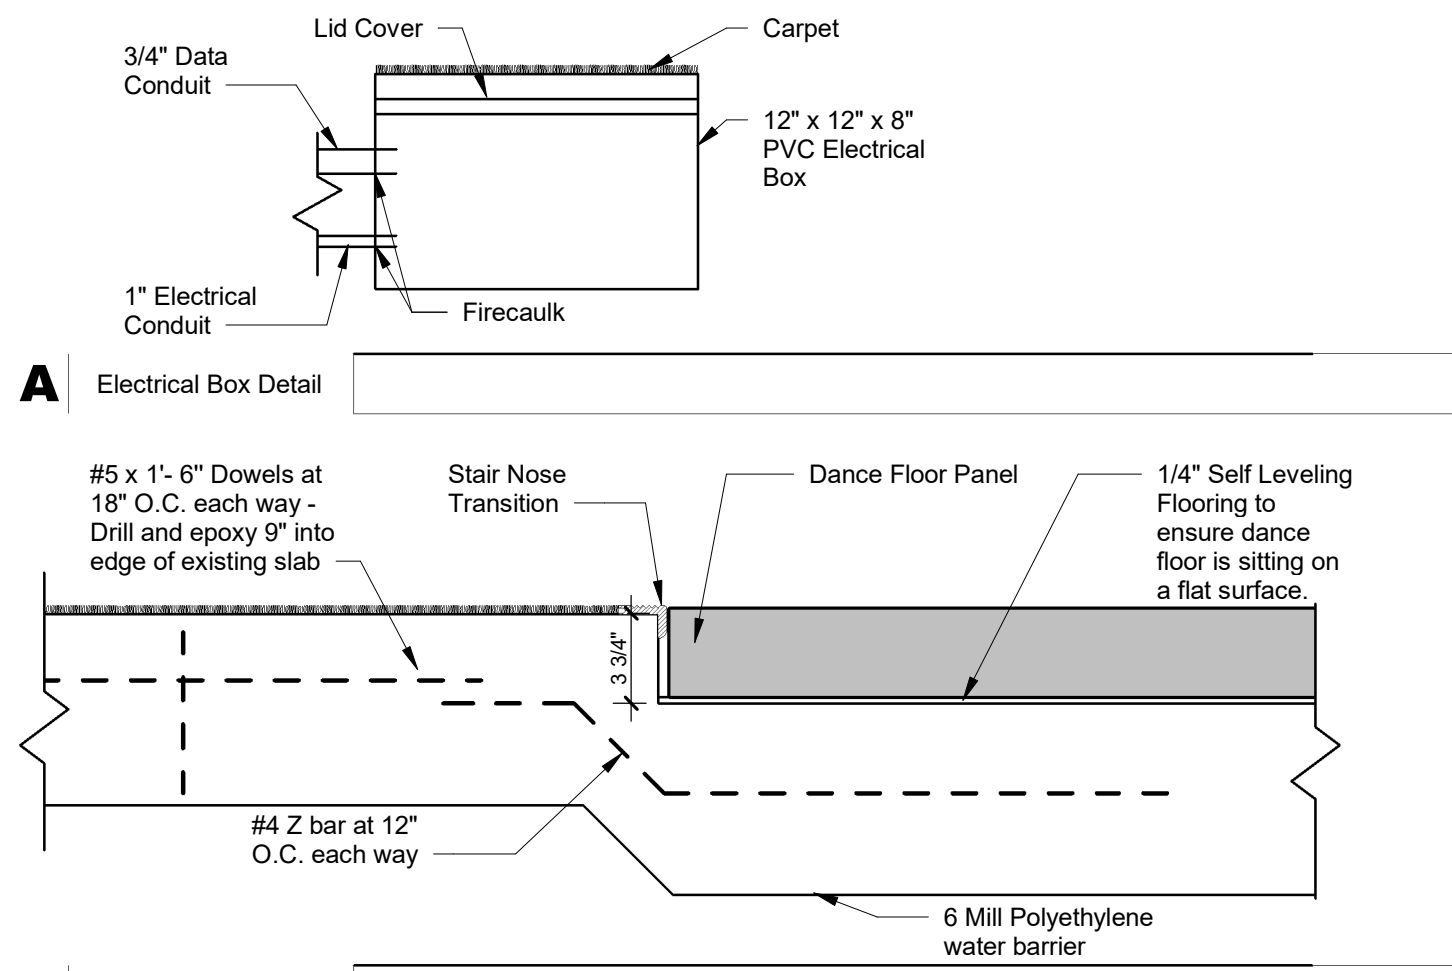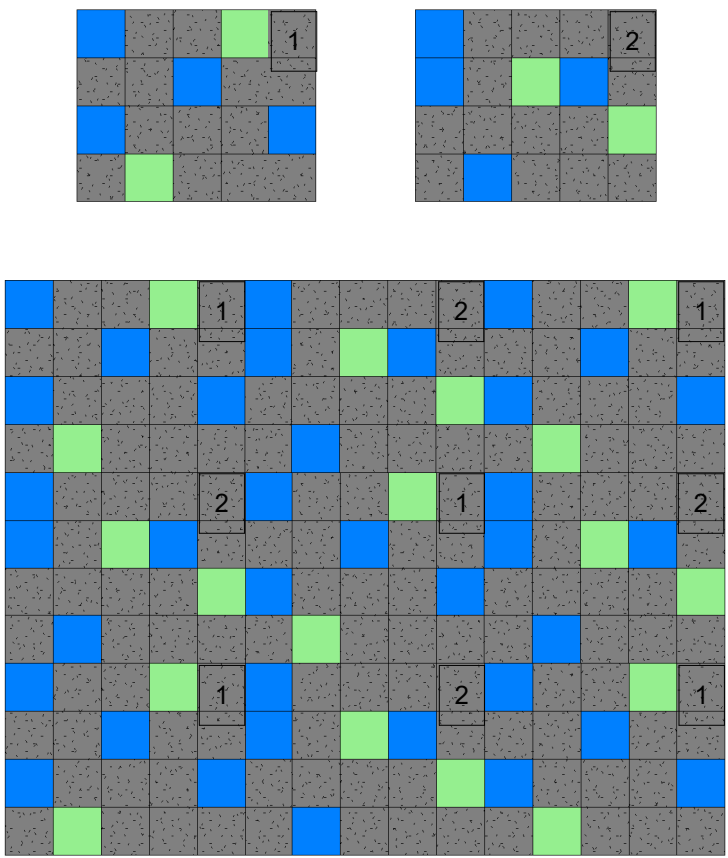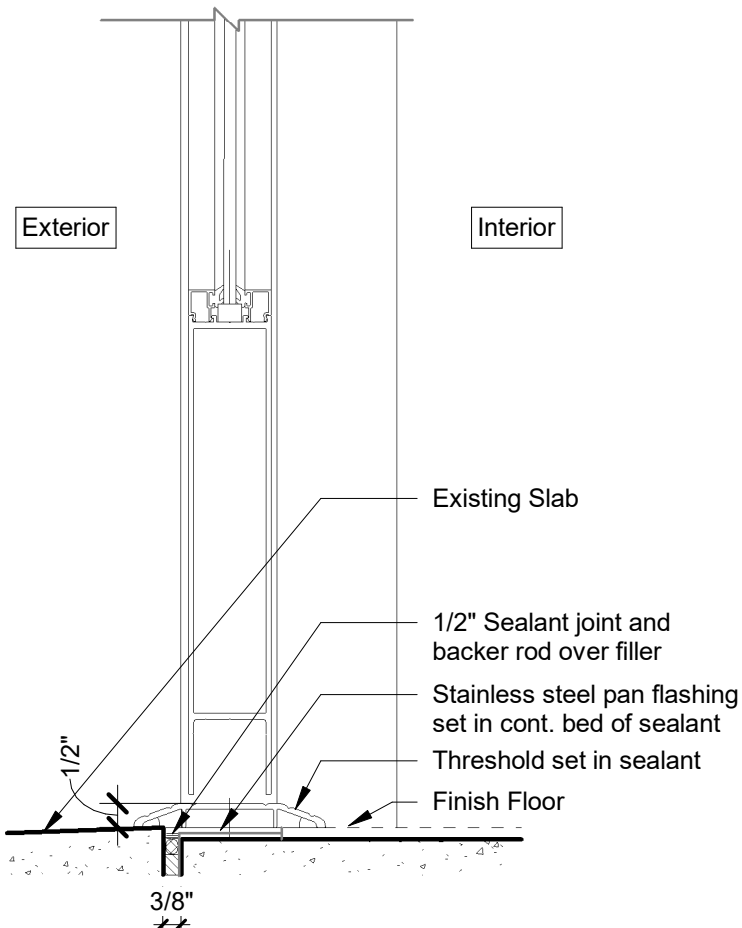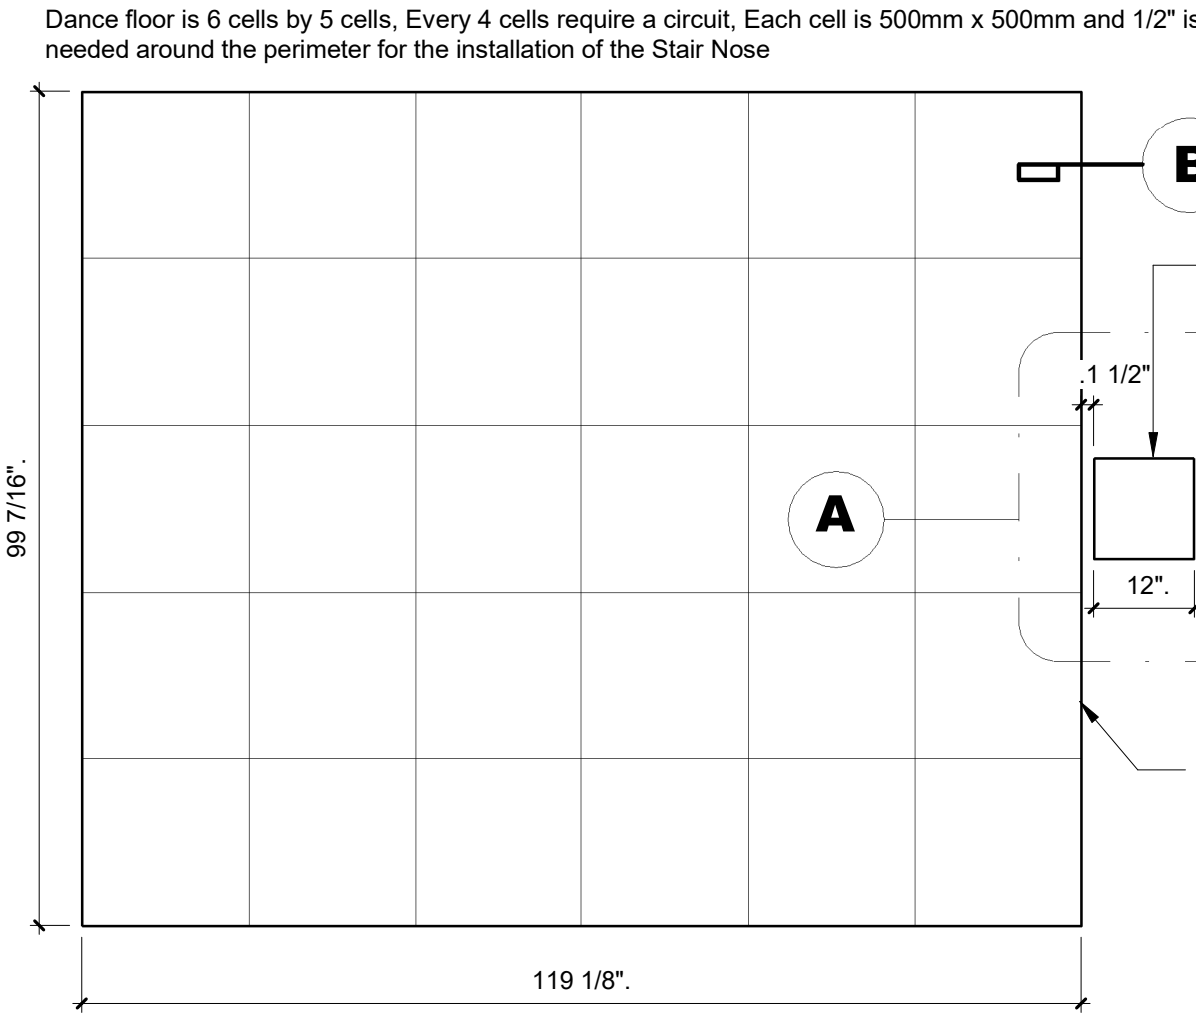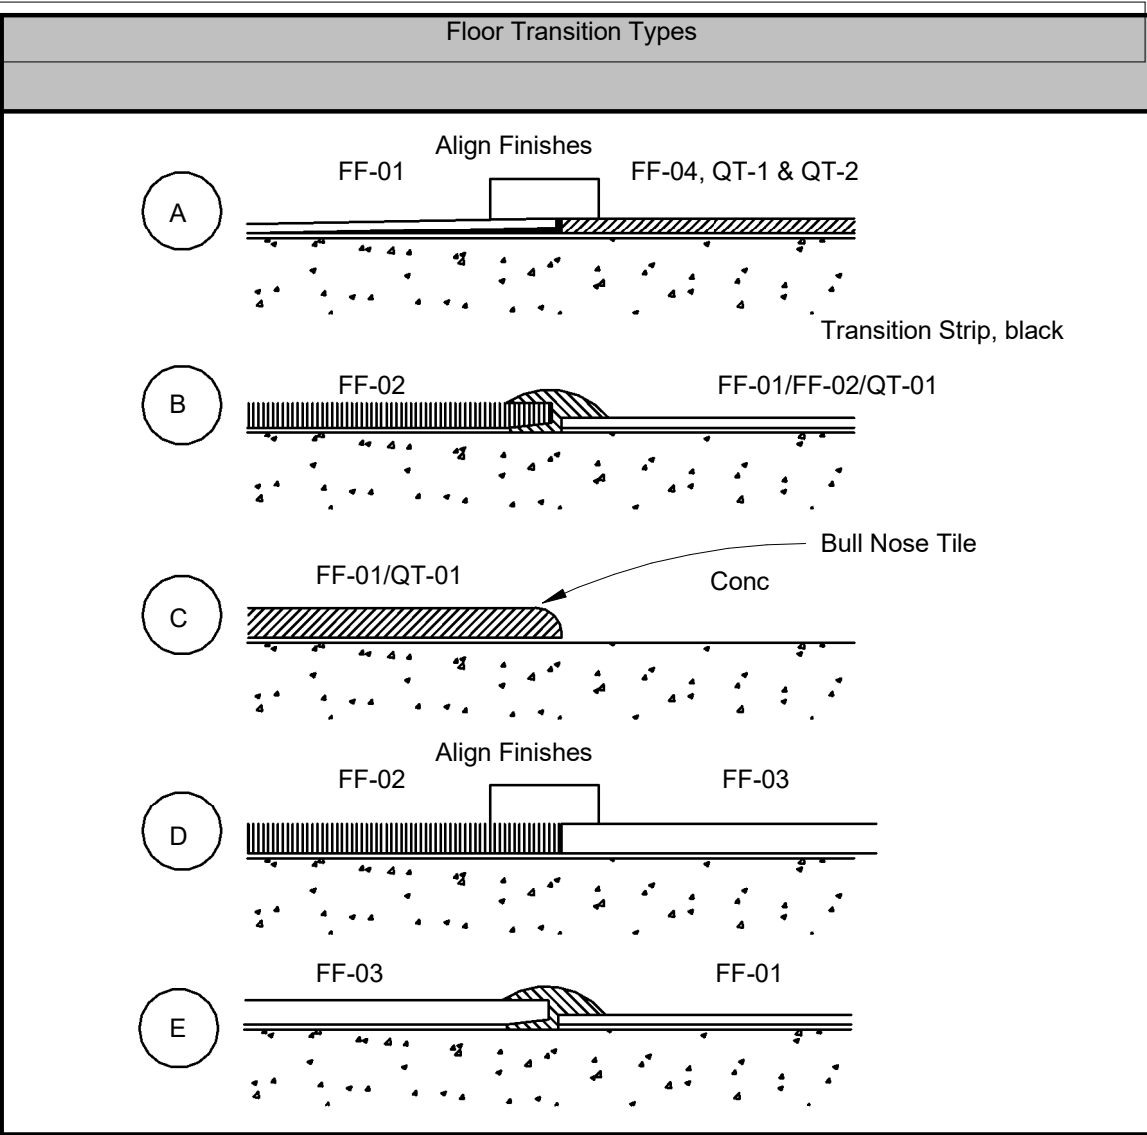

#605
6700 Abercorn Savannah, GA
31405

Owner:
CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect:
Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Michael Orr

MEP Engineer:
Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: (816)997.9627
Contact: Joe Hillsbrenner, P.E.




Architect: William D. Pounds

No.	Description	Date
A	Permit Set	2021/07/16


DRAWN BY: EO
CHECKED BY: VG
PROJ. NO: 94-21781
PKWY Architects, LLC © 2021

Floor Finish Plan

A2.0

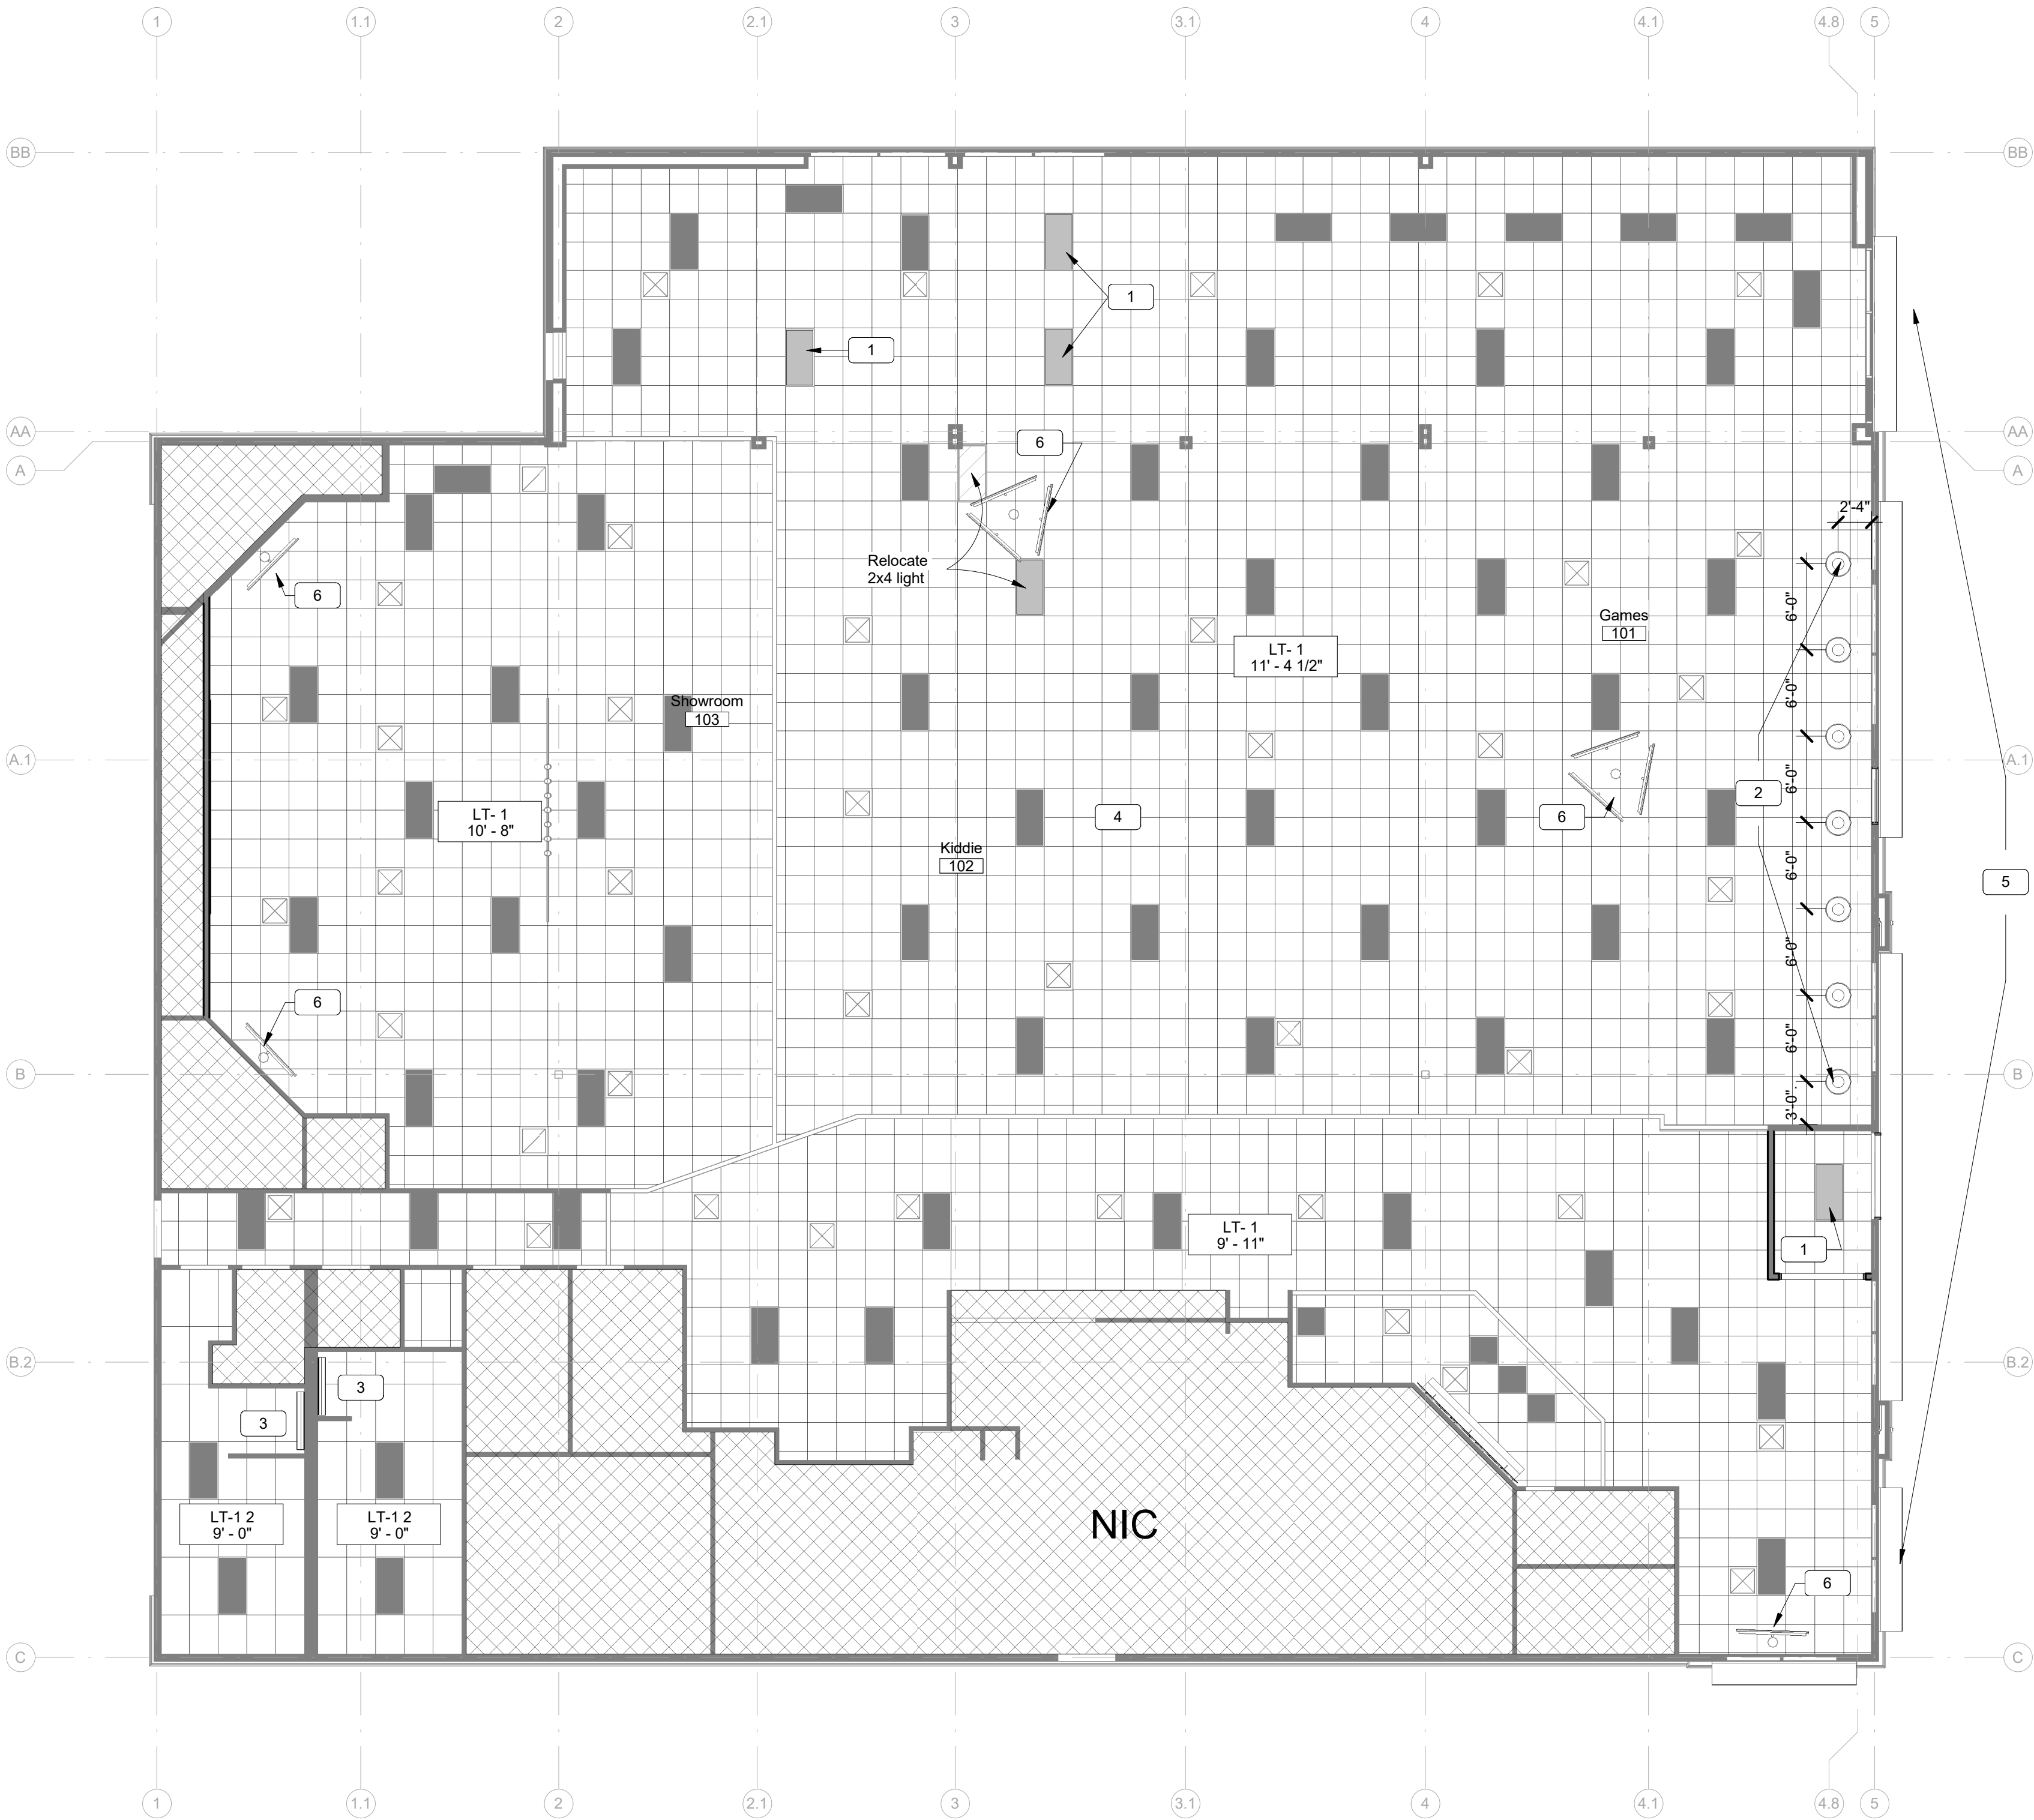

1 Reflected Ceiling Plan
1/8" = 1'-0"

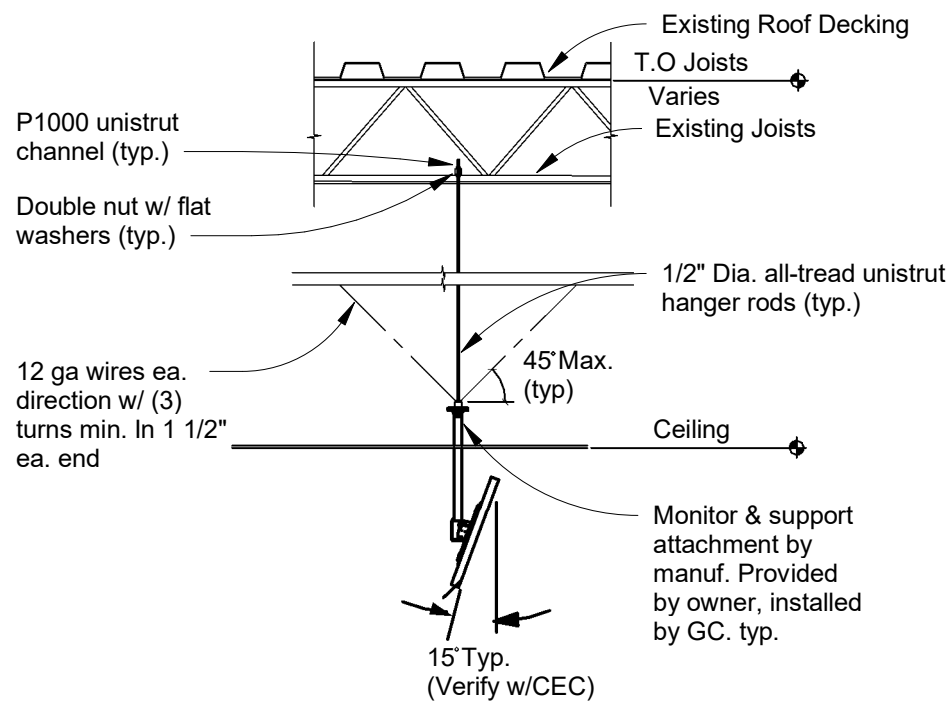

2 Monitor Frame section A
NTS

General Notes - RCP

- A All dimensions are to finish face.
- B Layout ceiling tile from center of room, both directions unless noted otherwise.
- C Sprinkler heads in suspended T-bar ceilings shall be centered in panels.
- D Coordinate all ductwork to avoid interference with ceiling support systems.
- E Light fixtures and HVAC diffusers shown on this drawing are for location and coordination purposes.
- F No fixtures, grilles, speakers, sprinkler heads, etc. shall touch the ceiling T's or shadow line; Center in panel.
- G Paint all grilles and recessed speakers to match ceiling grid.
- H All speakers wire shall home run to control room rack. Ref. AVI sheet for connections.
- J Exit Signage to be installed per OSSC 1011.
- K Ceiling grid installation shall be per section 9.6 of ASCE 7-02 and CISC guidelines for Seismic zones 3-4.
- L Refer to detail for Typical light bracing requirements.
- M GC to field verify all existing light and mechanical fixtures.
- N GC is responsible for coordination and verification of power for signage/awning prior to installation.
- O All non-rated partition to terminate 6" above finish ceiling. See wall types, drawings for additional information.
- P Coordinate all mechanical, electrical, and fire protection systems that are supported by interface w/ceiling systems.
- Q All insulation wiring and other construction items shall be non-combustible and rated as required by code for work in plenum spaces where indicated.
- R Replace damaged ceiling tiles up to 1,700sf; Paint ceiling grid to match existing as needed, typ.
- S Verify all exterior soffit lights are in working order and color temperatures match. Repair/replace as needed. Paint underside of soffit to match existing.

Legend - Reflected Ceiling Plan

- Existing Acoustical lay-in ceiling LT-1
- Existing Acoustical lay-in ceiling LT-2
- Gypsum ceiling
- Ceiling Tag
 - Ceiling Finish Code
 - Ceiling Height (A.F.F.)
- 24" x 48" Troffer
- Recessed Can Light
- Vanity Light - 7'-0" AFF
- Pendant - 6'-0" AFF
- Exterior Wall Sconce
- 48" Industrial Fluorescent Strip
- Wall mount Television
- Exit Sign
- Supply Diffuser (Ref. Mechanical)
- Return Diffuser (Ref. Mechanical)
- Access Panel

Scope Notes - RCP

- 1 New 2x4 troffer light.
- 2 Install (7) pendant lights 6'-0" AFF, center on new tables.
- 3 Install vanity light 7'-0" AFF.
- 4 Remove or relocate track lights as needed to illuminate wall art typical.
- 5 LED strip lights at canopy
- 6 Ceiling mounted monitor in games area. Adjust electric and data as indicated. Terminations by CEC, data runs with slack to floor +15'

CITY OF SAVANNAH
DEVELOPMENT
SERVICES

PLAN
APPROVED
08/02/2021



#605

6700 Abercorn Savannah, GA
31405

Owner:


CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect:

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Michael Orr

MEP Engineer:

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: (816)997.9627
Contact: Joe Hillebrenner, P.E.

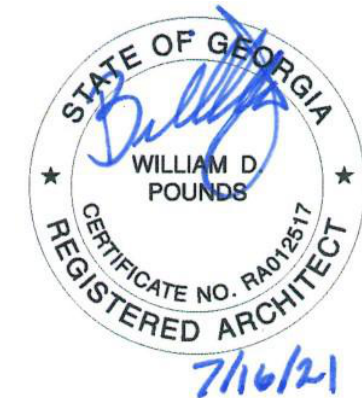

Architect: William D. Pounds

A	Permit Set	2021/07/16
No.	Description	Date

DRAWN BY: EO


CHECKED BY: VG

PROJ. NO: 94-21781


PKWY Architects, LLC © 2021

Reflected Ceiling Plan


A3.0

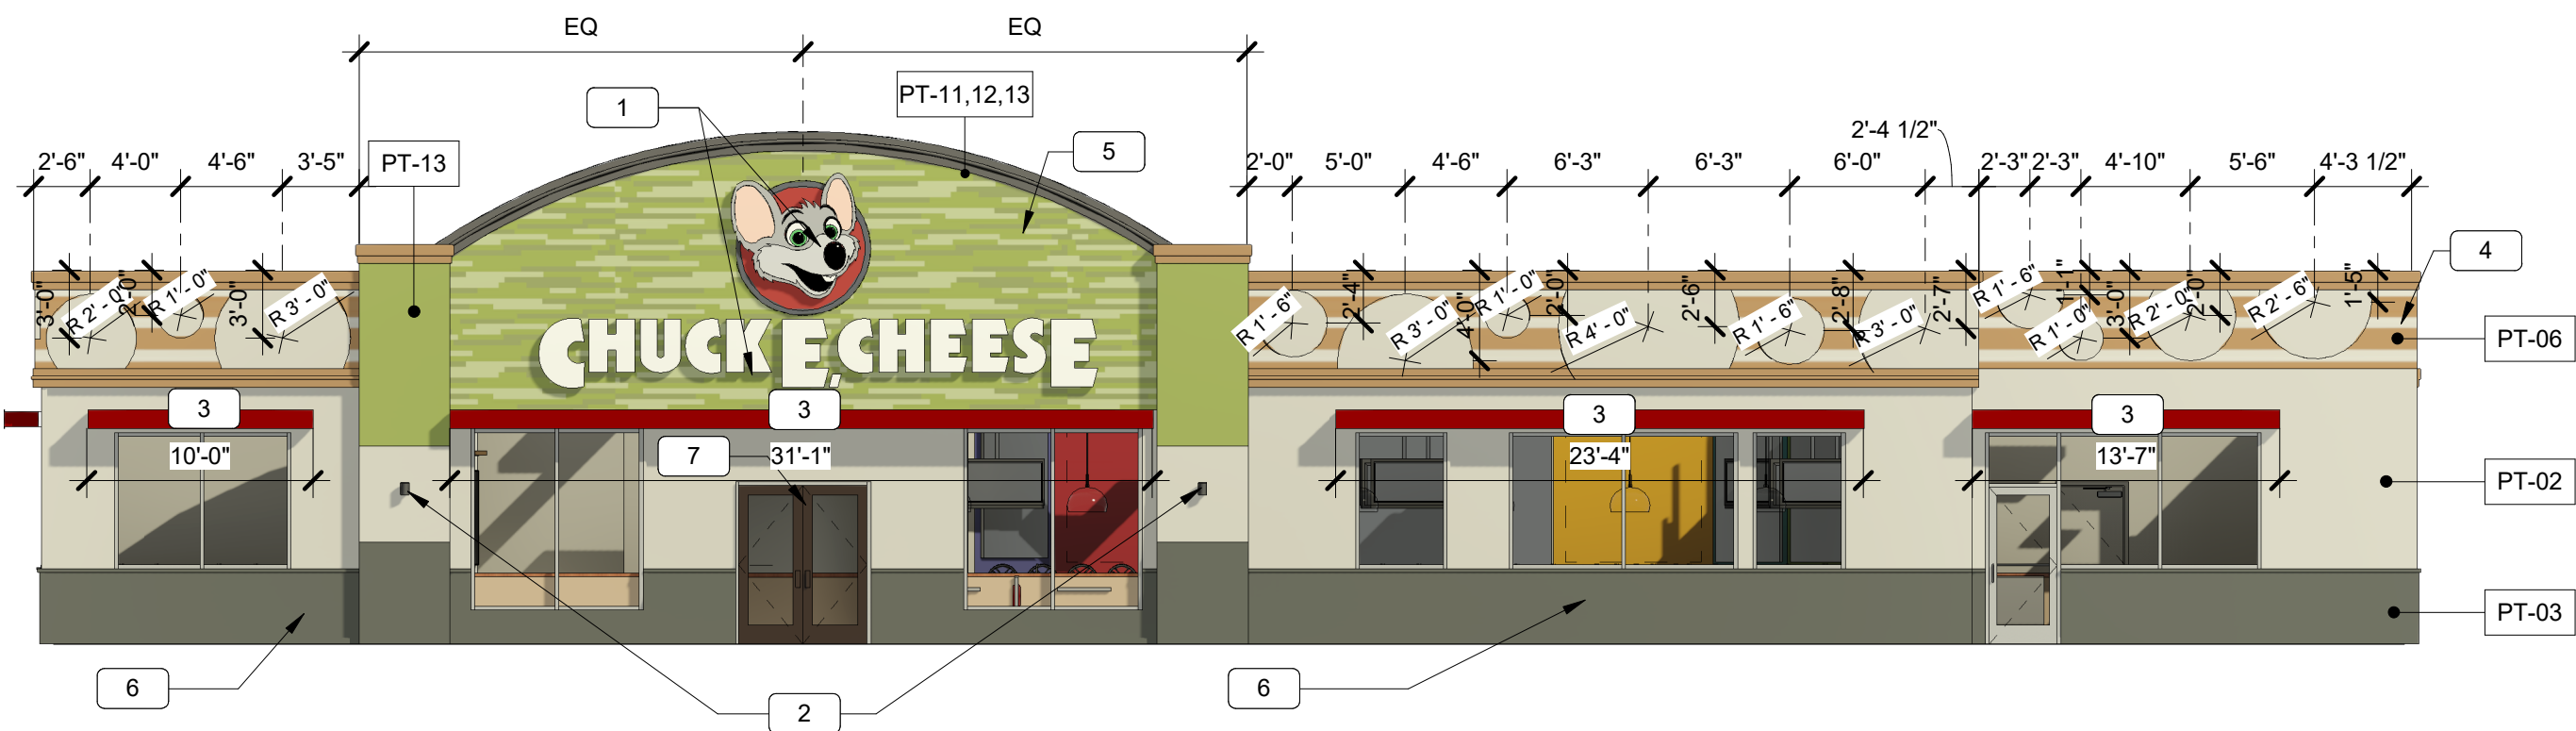


1 Front Elevation
1/8" = 1'-0"

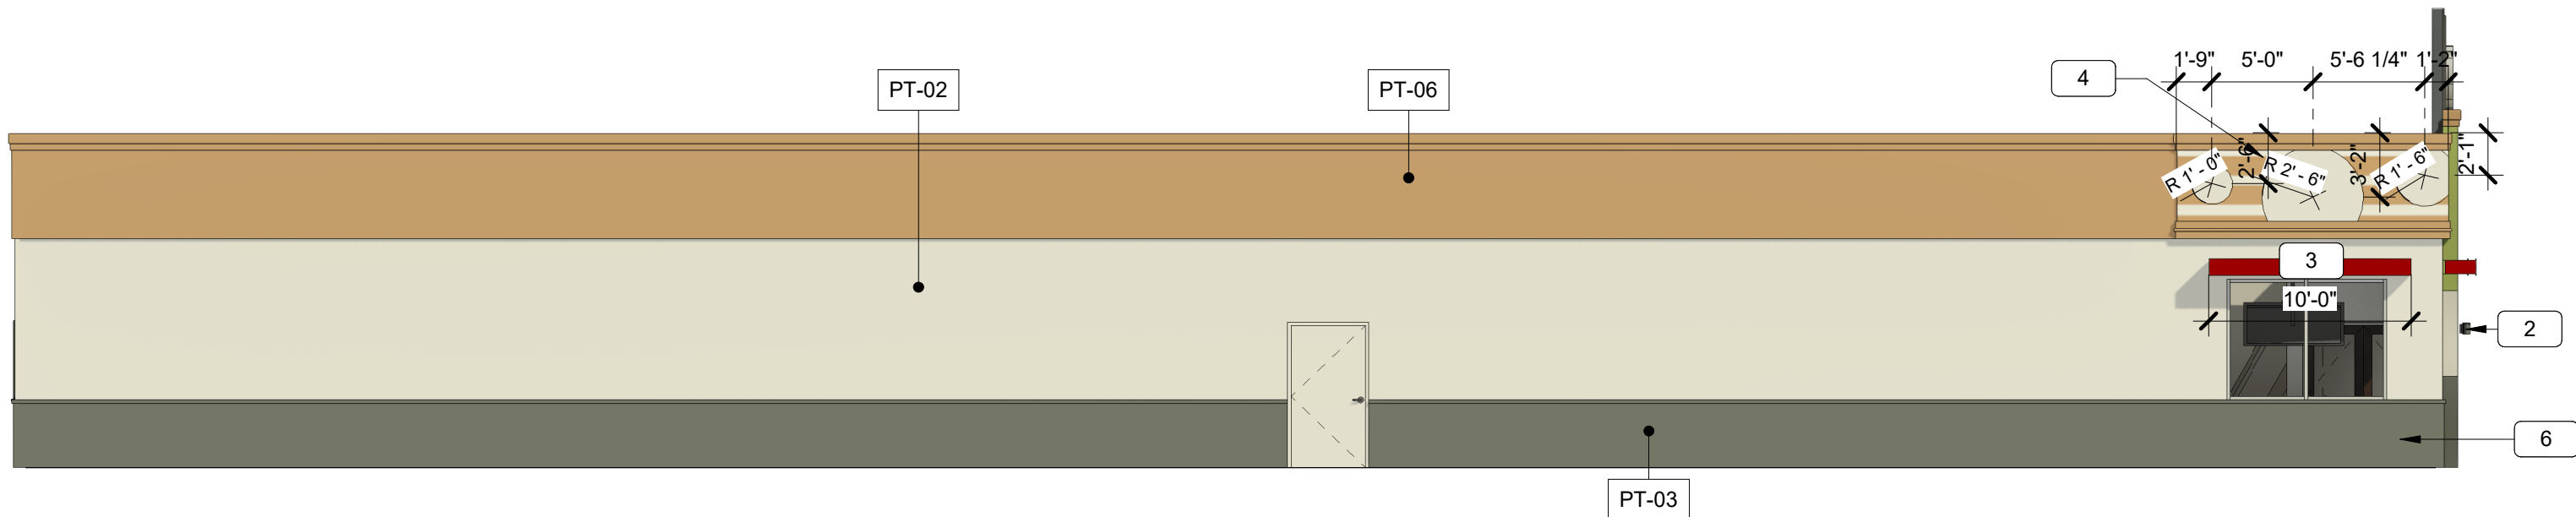

2 Side Elevation
1/8" = 1'-0"

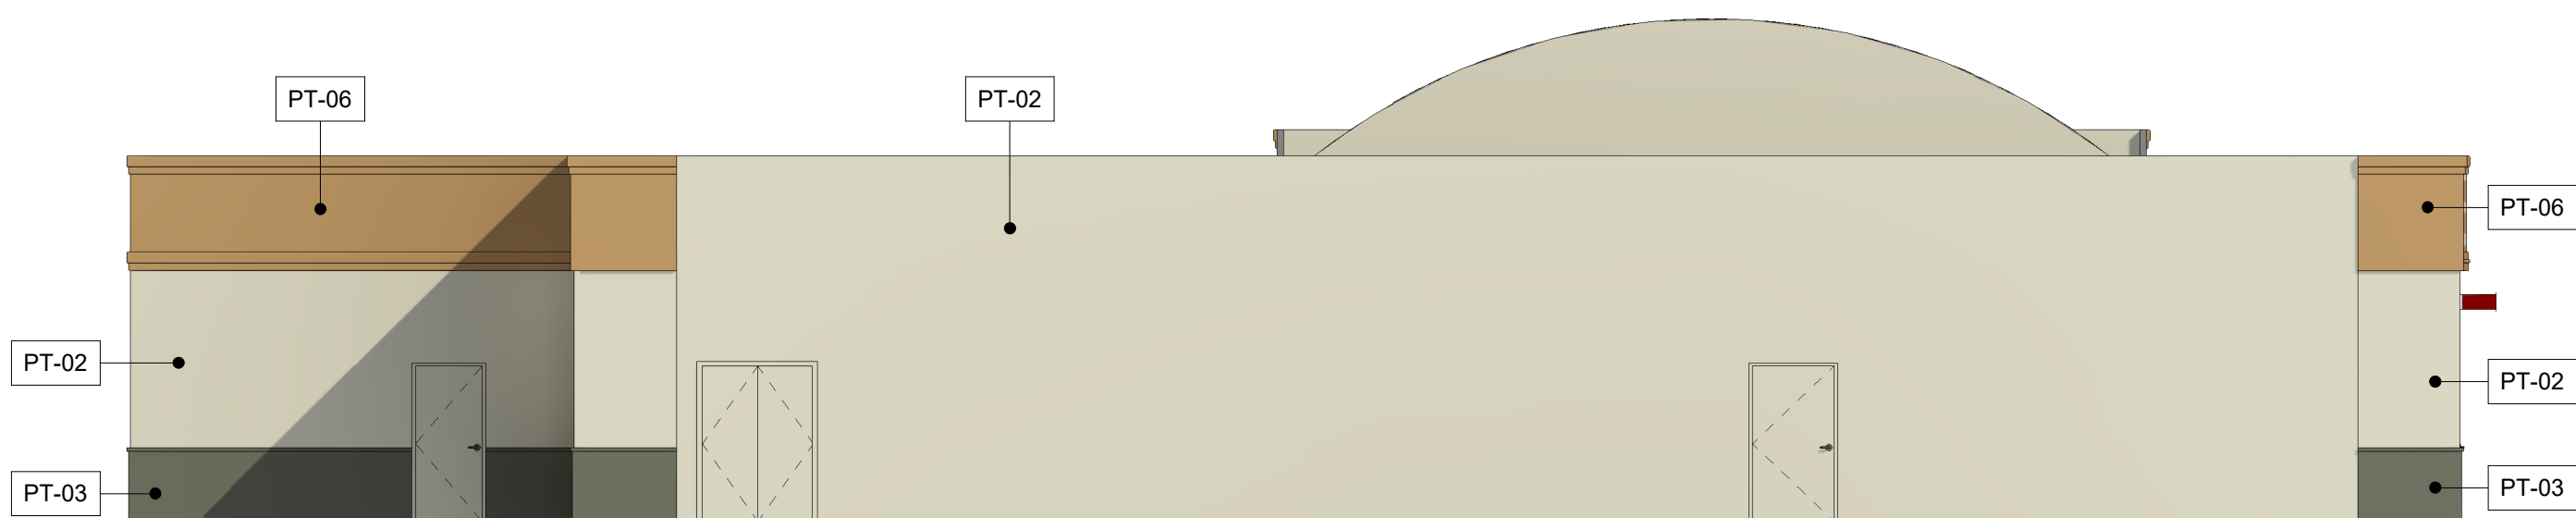

3 Rear Elevation
1/8" = 1'-0"

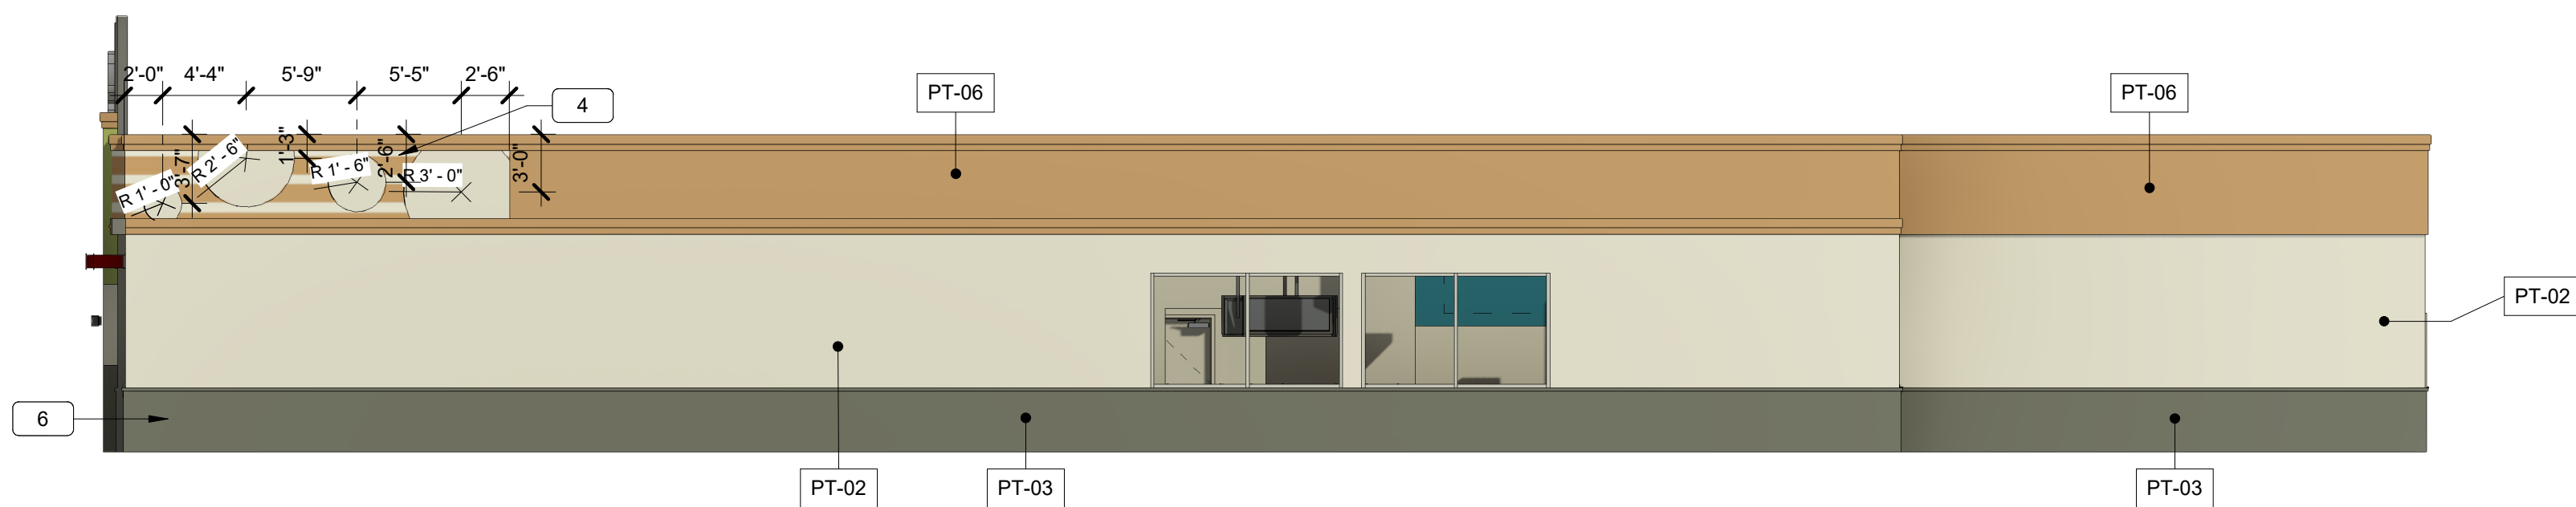

4 Right Elevation
1/8" = 1'-0"

General Notes - Elevation


- A Sign company shall obtain all required signage permits prior to installation of new work and repairs.
- B Painted fixtures: all downspouts, scuppers, electrical panels, grilles, conduits and piping, handrails visible to public, shall be painted to match existing or adjacent material finish and banding, U.N.O.
- C Unpainted items: do not paint over security cameras, security/ fire alarm bells and associated pumps fixtures fittings and others life safety fixtures. Do not paint over electrical and plumbing labels.
- D Vegetation: All plants, trees, vegetation, garden beds and associated pathways to be protected from any physical or paint damage prior to painting. Plants to be trimmed and maintained per instructions from CEC Entertainment INC.
- E Fill holes and skim coat wherever signs, awnings and lights are to be demolished, as well as areas where repairs are made, TYP.
- F Verify all wall packs are in working order, typ.
- G Any existing snow guards, rakes or rails encountered are to remain, protected from scheduled work.

Scope Notes - Exterior Elevations

- 1 New signage.
- 2 Install new sconce, typ.
- 3 Install eyebrow accent fixture and power above ceiling heigh, typ. Rain diverter at entry door only.
- 4 Paint cheese pattern.
- 5 Paint green board pattern.
- 6 Paint wainscot.
- 7 Dark bronze storefront door.

Paint Colors - Exterior

WT	Manufacturer	Color	Color #
PT-02	Benjamin Moore	Balboa Mist	1549
PT-06	Benjamin Moore	Etruscan	AF-355
PT-07	Benjamin Moore	Iron Mountain	2134-30
PT-09	Benjamin Moore	Cabot Trail	998
PT-11	Benjamin Moore	Sycamore Tree	539
PT-12	Benjamin Moore	Shades of Spring	537
PT-13	Benjamin Moore	Huntington Green	406
PT-E1	Sherwin Williams	Match Existing - Canoe	SW2043
PT-E2	Sherwin Williams	Match Existing - Sand	SW2059

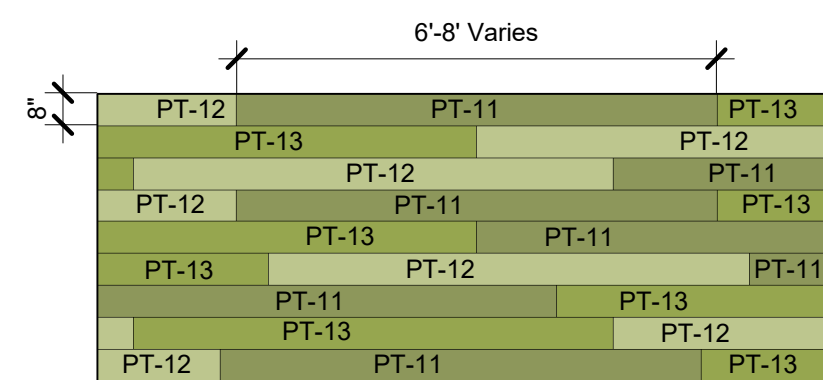

Note: Area to be painted with 8" x 6', 7', and 8' random length horizontal color band scheme. Including PT-11, PT-12, and PT-13.

Green Stripe Detail


1/4" = 1'-0"



Note: Area to be painted with 6" x 1'-0" horizontal color band scheme. Including PT-02 and PT-06.

Tan Stripe Detail

1/4" = 1'-0"

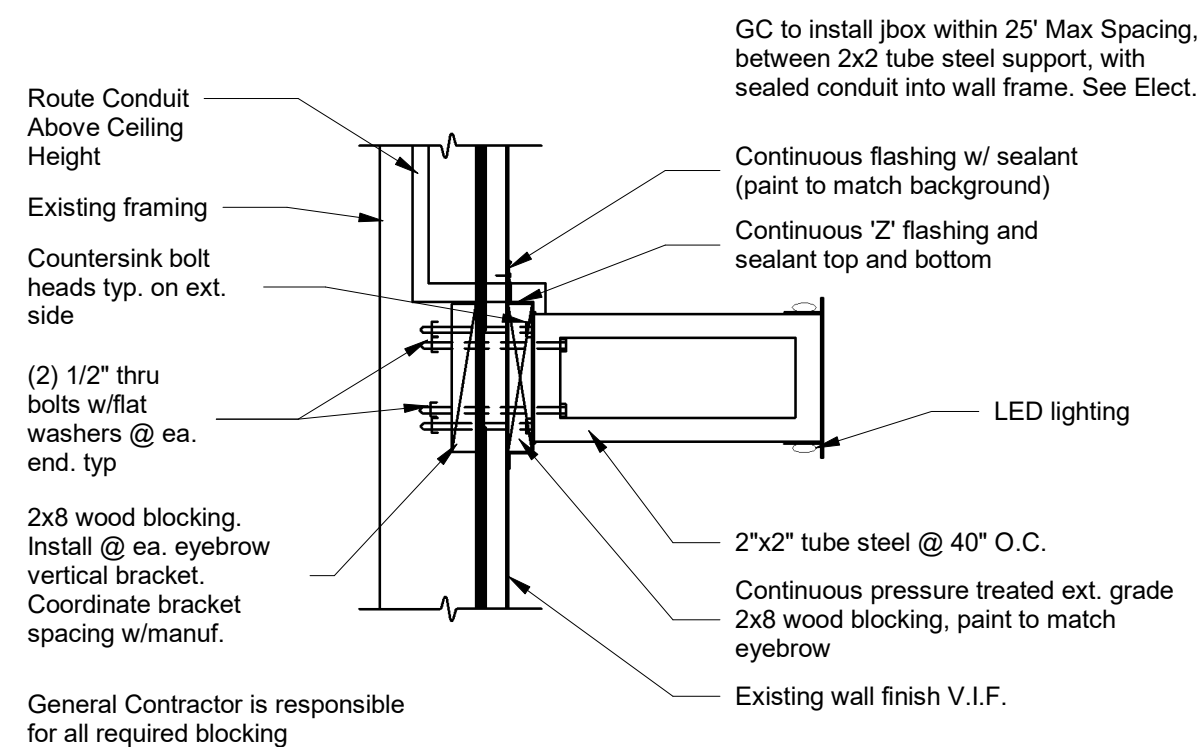

Eyebrow Section

1" = 1'-0"

CITY OF SAVANNAH
DEVELOPMENT
SERVICES

PLAN
APPROVED
08/02/2021



#605

6700 Abercorn Savannah, GA
31405

Owner:

CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect:

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Michael Orr

MEP Engineer:

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: (816)997.9627
Contact: Joe Hillebrenner, P.E.



Architect: William D. Pounds

A	Permit Set	2021/07/16
No.	Description	Date

DRAWN BY: EO

CHECKED BY: VG

PROJ. NO: 94-21781

PKWY Architects, LLC © 2021

Exterior Elevations

A4.0



**PLAN
APPROVED
08/02/2021**

**PLAN
APPROVED
08/02/2021**

**PLAN
APPROVED
08/02/2021**

**PLAN
APPROVED
08/02/2021**

**PLAN
APPROVED
08/02/2021**




**PLAN
APPROVED
08/02/2021**

**PLAN
APPROVED
08/02/2021**


**PLAN
APPROVED
08/02/2021**

**PLAN
APPROVED
08/02/2021**

**PLAN
APPROVED
08/02/2021**

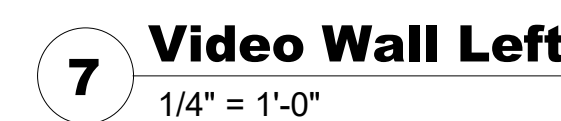


7 Video Wall Left
1/4" = 1'-0"

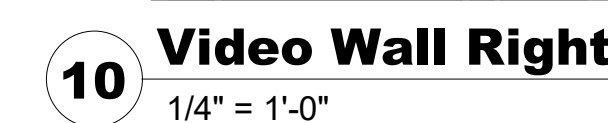


10 Video Wall Right
1/4" = 1'-0"




11 Games



12 Games North
1/4" = 1'-0"



13 **Showroom South**
1/4" = 1'-0"





14 Paint Stripe Detail

General Notes - Interior Finish

A	Ensure surfaces to receive finishes are clean, true and free of irregularities. Do not proceed with work until unsatisfactory conditions have been corrected.
B	No finish substitutions may be made without prior written authorization by Architect.
C	All finishes shall be applied in strict accordance with manufacturer's specifications.
D	Provide temporary protection for all installed finishes as work progresses.
E	Submit samples of finishes for approval prior to installation.
F	All paint shall be applied in accordance with the manufacturer's specifications for that particular surface.
G	Examine walls to ensure proper preparation before application of paint. Beginning work implies acceptance of condition.
H	Sign company to provide resized acrylic wall art. Install by GC. Coordinate final installation with CEO. Sign company to verify wall dimensions on all walls receiving artwork prior to final design and installation.
J	GC to install plastic corner guards at public areas.
K	Refer to A8.0 for schedules.
L	Paint all existing exposed steel columns in guest area PT-04.
M	All hollow metal exit doors & frames to be painted PT-05, typ.
N	Frames of interior doors in all public areas to be painted PT-05 (typ).

A	Ensure surfaces to receive finishes are clean, true and free of irregularities. Do not proceed with work until unsatisfactory conditions have been corrected.
B	No finish substitutions may be made without prior written authorization by Architect.
C	All finishes shall be applied in strict accordance with manufacturer's specifications.
D	Provide temporary protection for all installed finishes as work progresses.
E	Submit samples of finishes for approval prior to installation.
F	All paint shall be applied in accordance with the manufacturer's specifications for that particular surface.
G	Examine walls to ensure proper preparation before application of paint. Beginning work implies acceptance of condition.
H	Sign company to provide resized acrylic wall art. Install by GC. Coordinate final installation with CEO. Sign Company to verify wall dimensions on all walls receiving artwork prior to final design and installation.
J	GC to install plastic corner guards at public areas.
K	Refer to A8.0 for schedules.
L	Paint all existing exposed steel columns in guest area PT-04.
M	All hollow metal exit doors & frames to be painted PT-05, typ.
N	Frames of interior doors in all public areas to be painted PT-05 (typ).

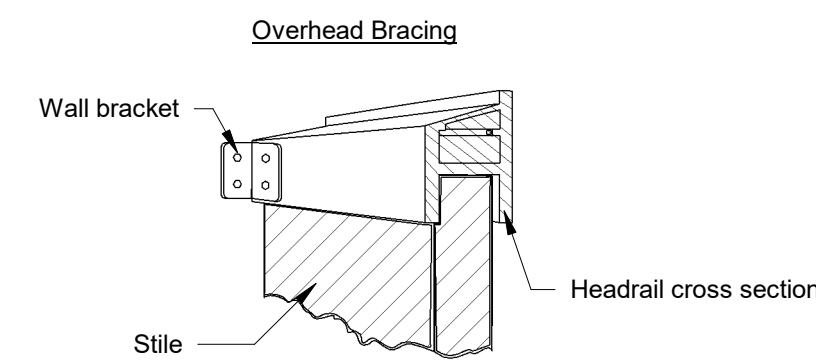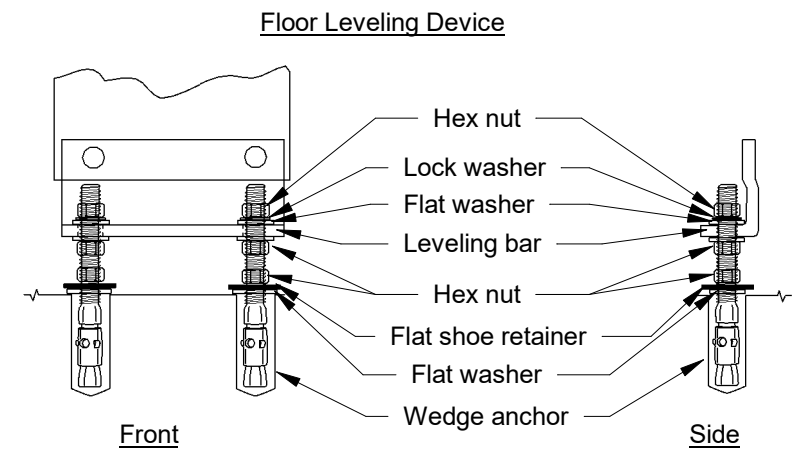


1 Toilet Partition Detail


1/2" = 1'-0"

Blocking Notes:


- Blocking conditions shown do not account for all conditions that may exist on the project. The contractor is to account for all blocking indicated in entire contract document package or specifically req'd by the manufactures of specified products & materials
- The contractor shall walk the site to finalize all locations of blocking in walls/ceiling prior to installation of gypsum wallboard.
- Coordinate the exact required linear footage and locations of blocking with each specific fixture. Accessory equipment, casework, and millwork. The contractor is to coordinate with millwork on all items to be supplied and/or installed by CEC.
- Where exact location of item requiring blocking will not be determined until after installation of the gypsum wallboard, extend blocking a min. of 12" beyond each side the estimated location of the designated item as indicated in the plans or as specified by manufacturer.
- All blocking is to be continuous along the full length of the item requiring blocking unless noted otherwise or indicated by manufacturer.
- Where specific code related or manufacturer load requirements are required, the contractor is to confirm the installation of the required blocking meets or exceeds the requirements of the code.

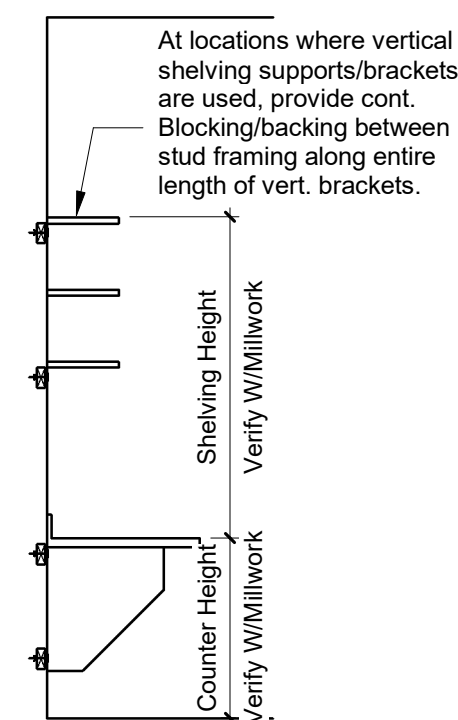


Blocking At Counter & Wall Shelving

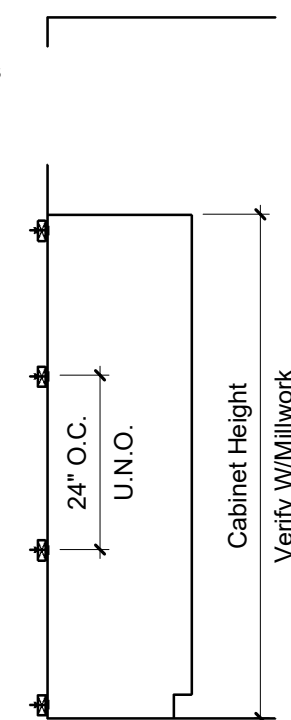


Blocking At Full Height Wall Cabinets

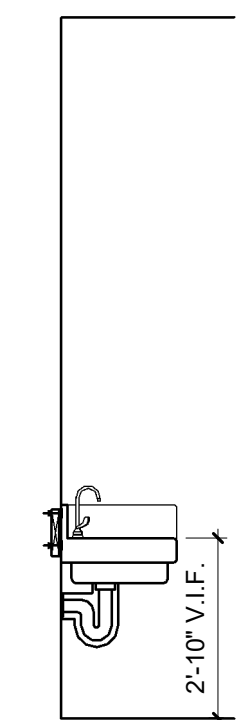


Blocking At Hand & Large Compartment Sinks

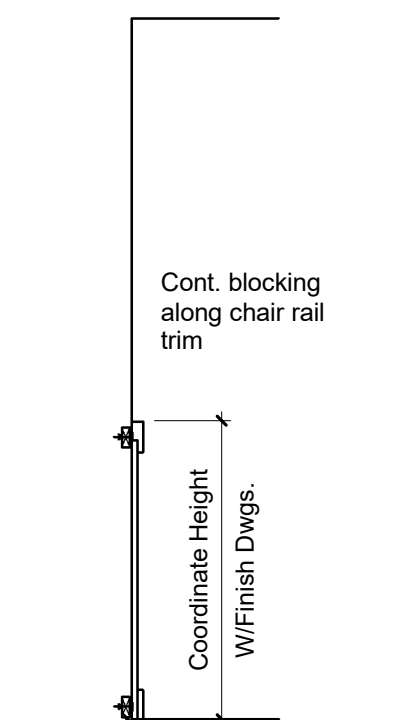

Blocking At Wainscot & Chairrail Locations

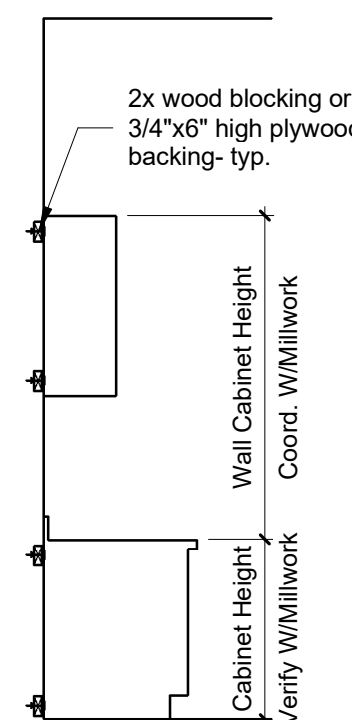

Blocking At Base & Wall Cabinets

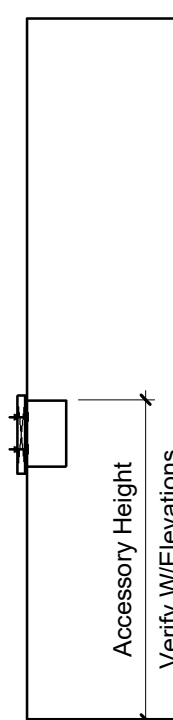


Blocking At Accessories

2 Typical Blocking Details

NTS


NOTE:
EXISTING WALL CONSTRUCTION
ASSUMED TO BE 5/8" GREEN BOARD
WITH 1/4" TILE APPLIED TO STUD
FRAMING.

NOTE:
ALL TUBING TO BE 2X2 S.O. 16GA. COLD
ROLL STEEL. CAP ALL EXPOSED ENDS
OF TUBE. ALL CORNERS TO BE
MITERED, FULLY WELDED AND GROUND
SMOOTH. POWDER COAT - COLOR TO
MATCH PAINT ALMOND.

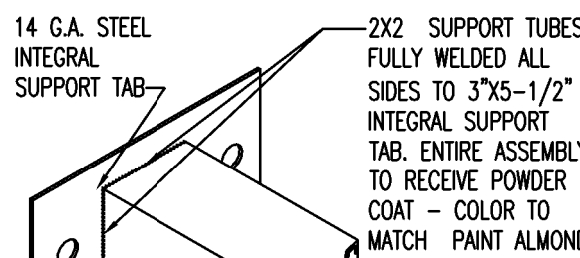


CONTINUOUS
LENGTH 2X2 STEEL
SUPPORT TUBES

INTEGRAL SUPPORT TAB ISO

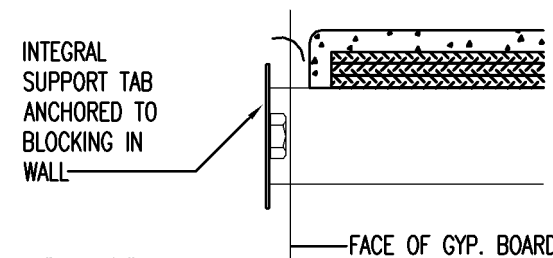


INTEGRAL SUPPORT TAB

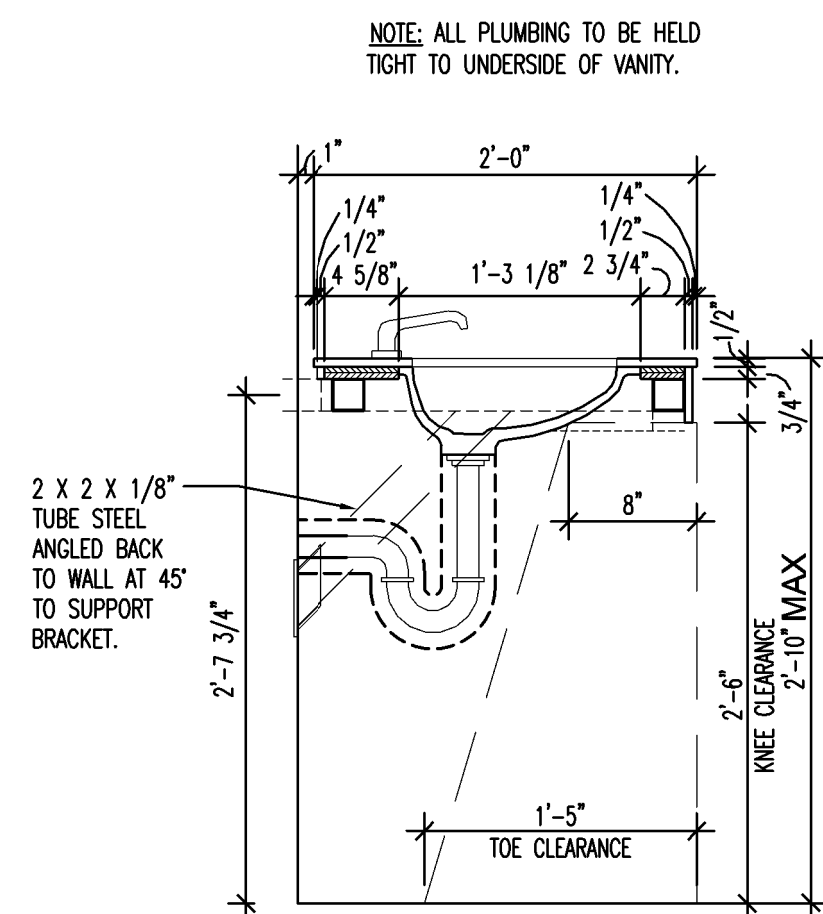



2 X 2 X 1/8" TUBE STEEL
ANGLED BACK TO WALL AT 45°
TO SUPPORT BRACKET.

3 Restroom Sink Detail


1" = 1'-0"

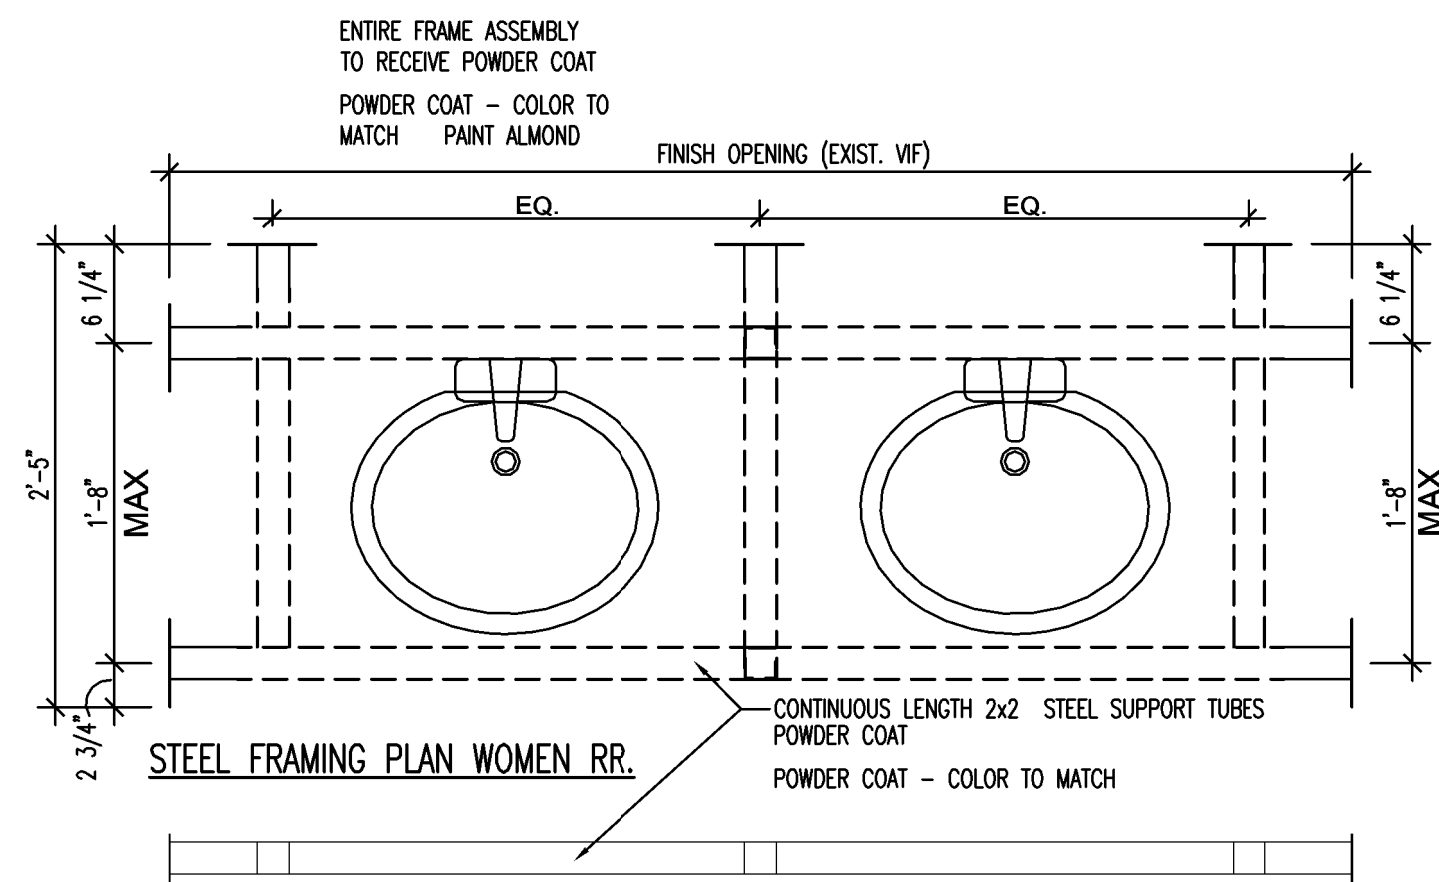

STEEL FRAMING PLAN WOMEN RR.

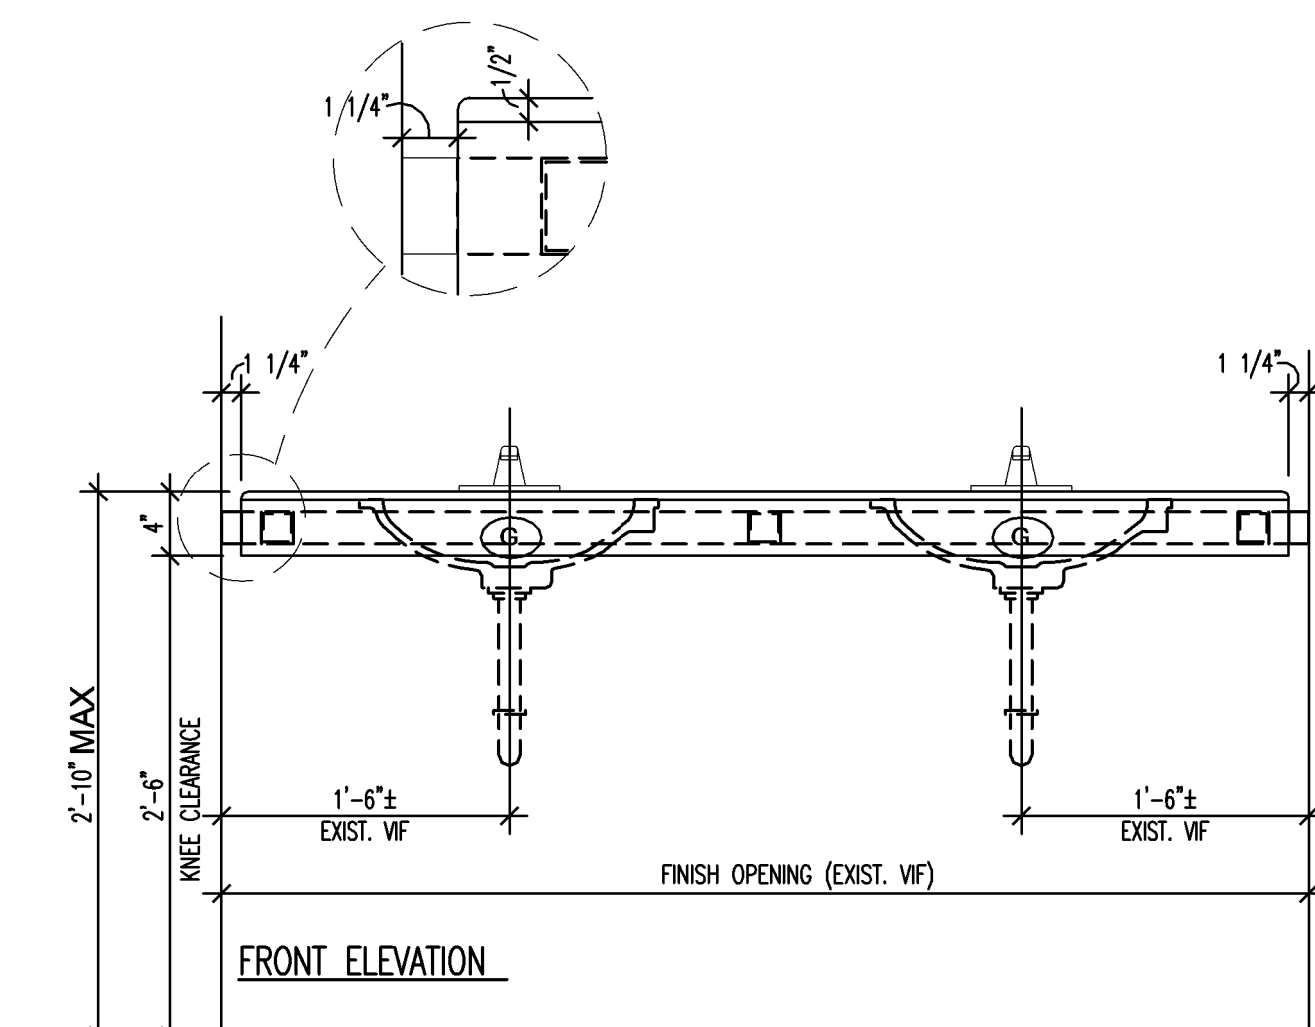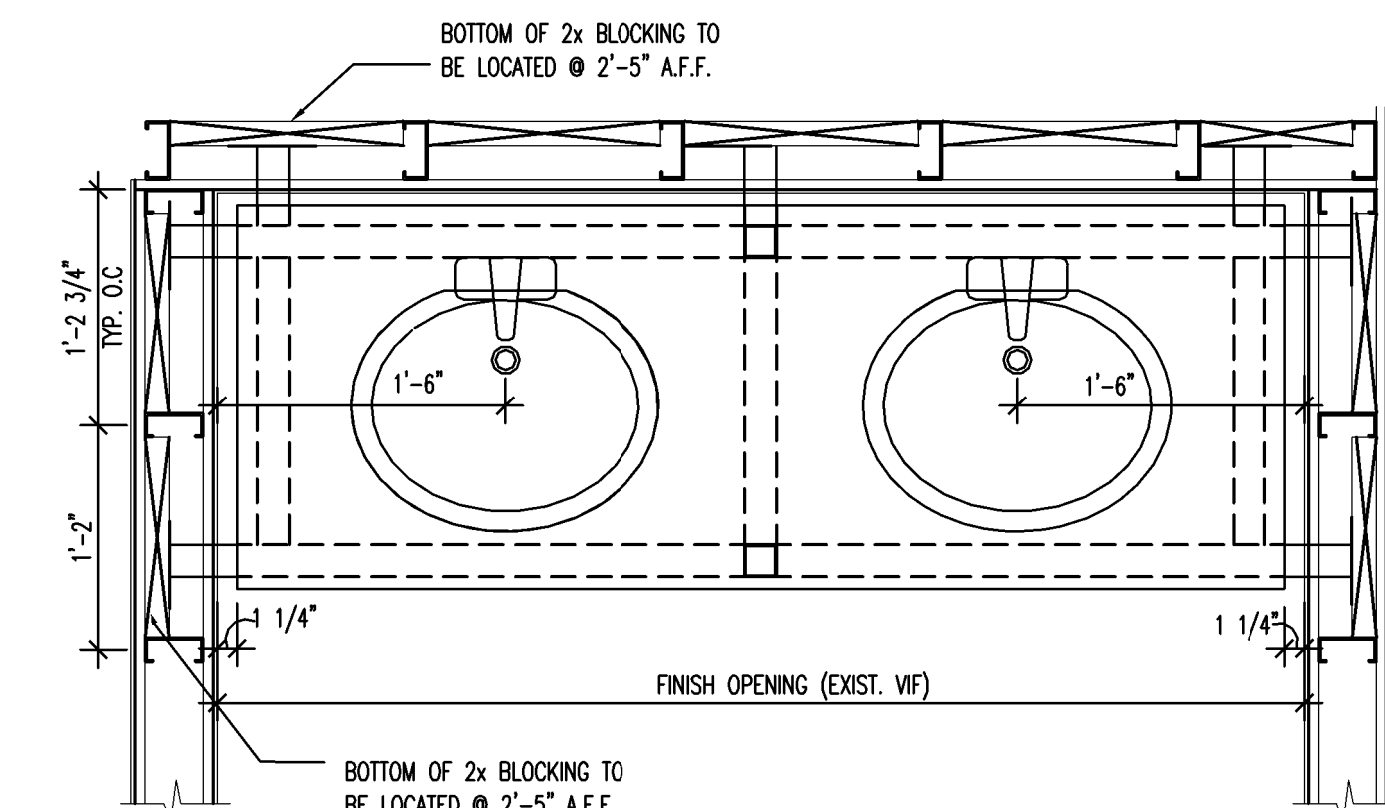

FRONT ELEVATION

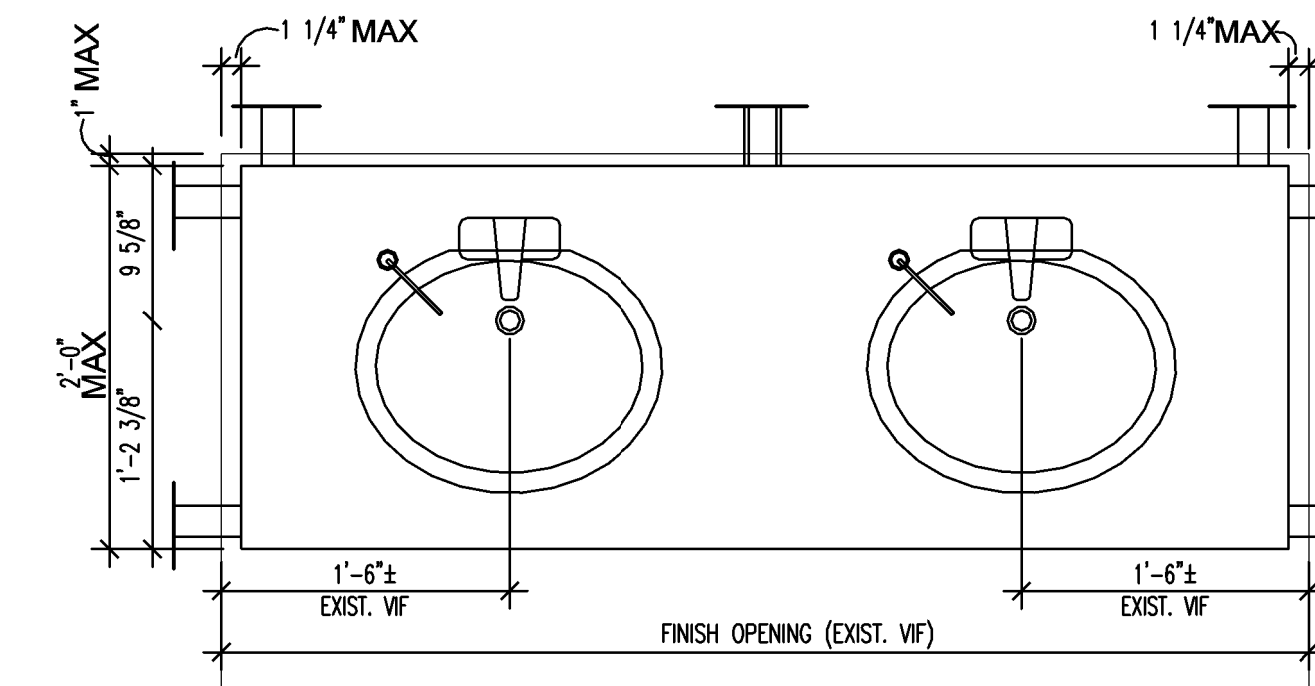

NOTE: ALL MOUNTING BOLTS TO BE
CONCEALED BEHIND GYP. BOARD

STEEL FRAMING PLAN

Toilet Room Accessibility Requirements

Note:




- Toilet rooms shall conform to all accessibility requirements of the Americans with Disabilities Act (ANSI 117.1) which includes but is not limited to the following:
- Contractor shall install one napkin disposal box in each stall of the women's restroom.
- Dimensions are from/to O.F.O. finish U.I.O.
- Knee clearance at lavatory: apron 29" min. height, 8" min. depth.
- Lavatory hot water and drainpipes to be insulated wherever exposed with form fitting wraps.
- Provide all 2x blocking as required.
- Silicone seal all fixtures to wall and/or floor as required.
- All accessories shall be thru-bolt at toilet partition locations.
- Install 5'-0" tall toilet partitions at 1'-0" A.F.F. See enlarged detail for centers.
- Install box wall sconce light 7'-0" A.F.F. See sheet A3.0 for location.
- Water closet seat height: 17" to 19" A.F.F.

- B. Grab bars at side of water closet: 42" long, T.O. bar mounted 33" to 36" A.F.F.
C. Toilet paper dispenser: centered, from front of toilet, 19" min. A.F.F.
E. Grab bar diameter: 1 1/4" to 1 1/2" O.D.
K. Grab bar behind water closet: 36" long, T.O. bar mounted 33" to 36" A.F.F.

INTERNATIONAL SYMBOL OF ACCESSIBILITY:

To be installed on exterior of the toilet room door. (Re: elevation detail below)

Identification signs are raised San Serif or Simple Serif and also have grade 2 braille pictorial symbols and include verbal description, room identification signs shall be installed on the wall adjacent to the latch side of the room door at a height of 60" A.F.F. provide clear floor space at sign.

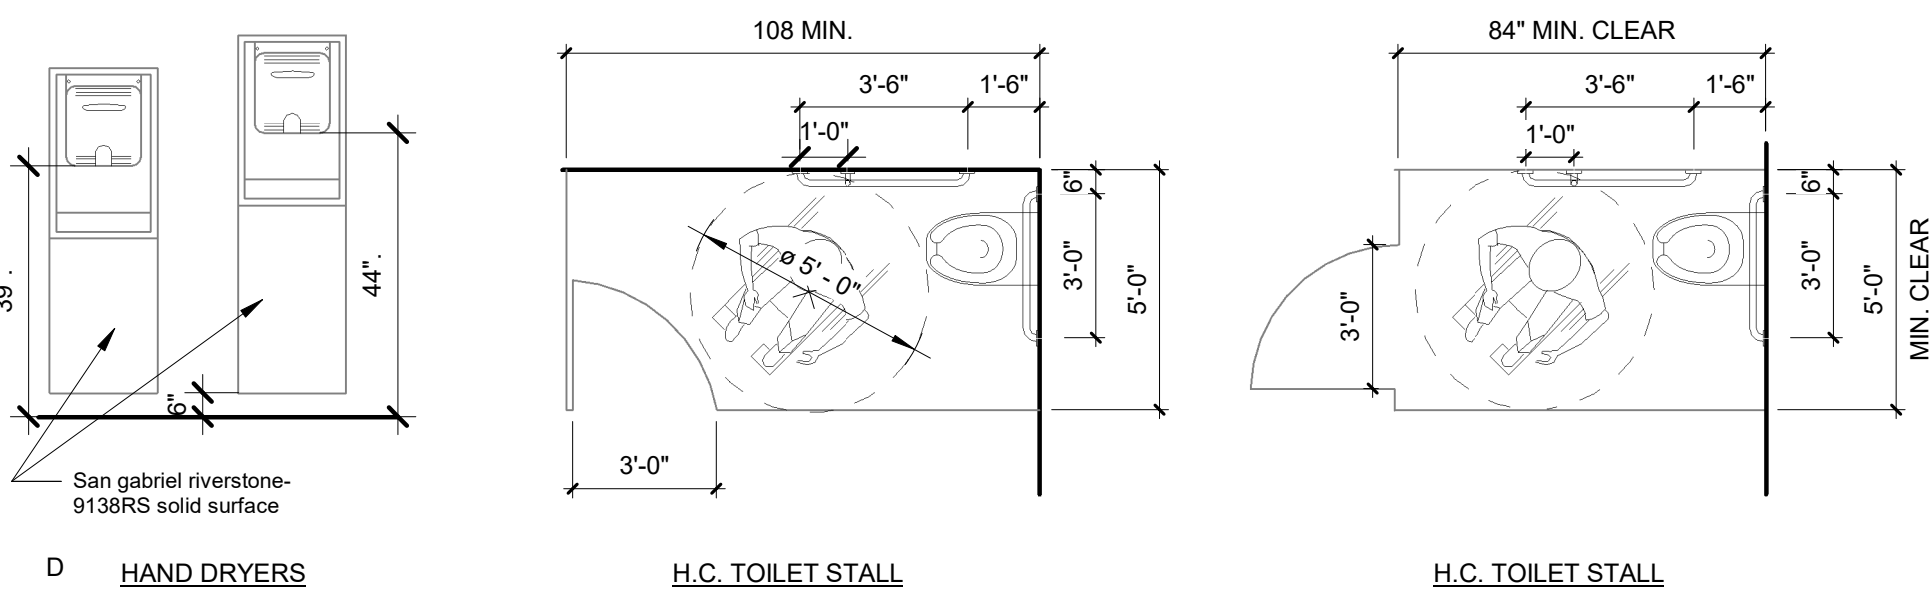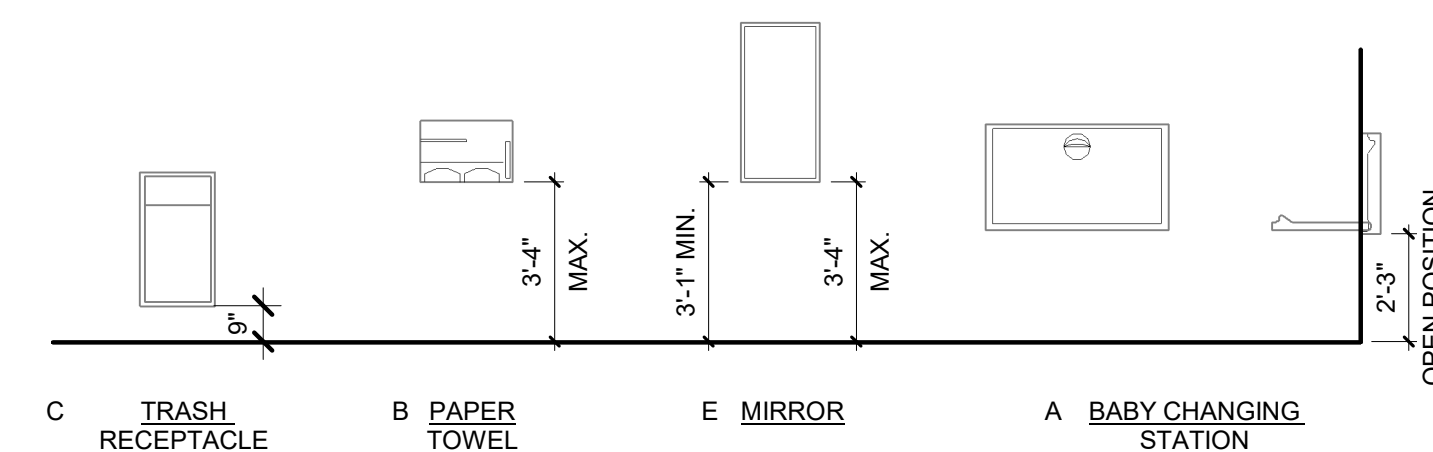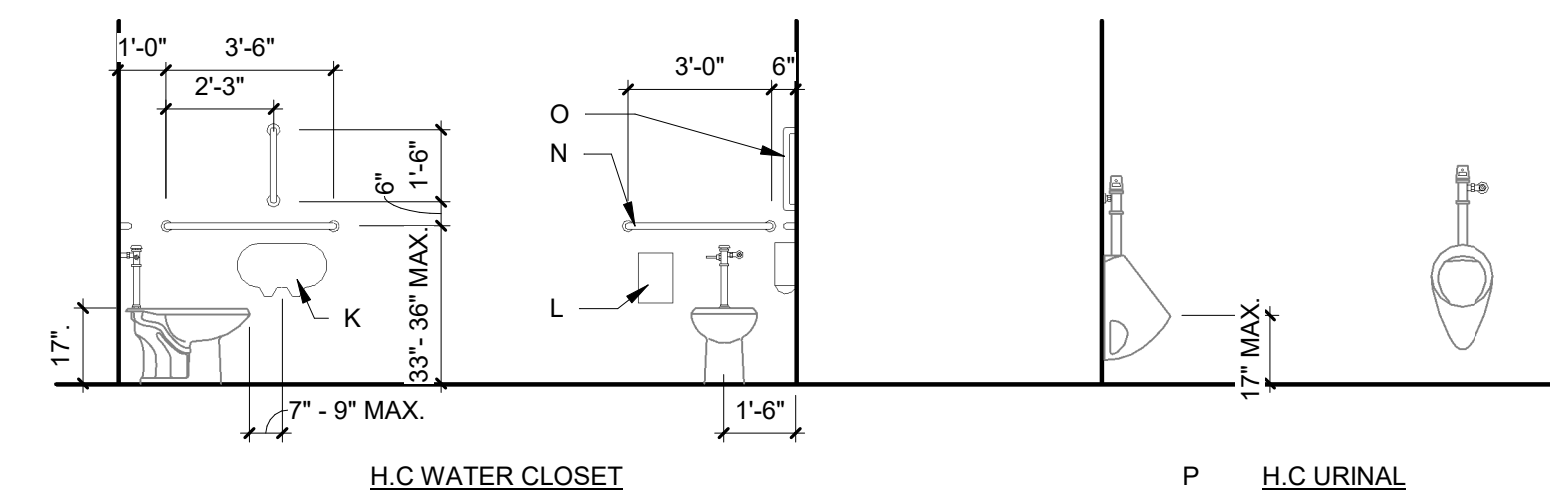

D. HAND DRYERS

1/32" raised tactile
pictogram 3" min.
height

Simple typeface
1/32" raised letters
and graphics

1/32" grade 2 braille

ROOM
IDENTIFICATION
SIGN

M
N
O

GRAB BARS

CITY OF SAVANNAH
DEVELOPMENT
SERVICES

PLAN
APPROVED
08/02/2021



#605

6700 Abercorn Savannah, GA
31405

Owner:

CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect:

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Michael Orr

MEP Engineer:

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: (816)997.9627
Contact: Joe Hillebrenner, P.E.



Architect: William D. Pounds

A	Permit Set	2021/07/16
No.	Description	Date

DRAWN BY: EO
CHECKED BY: VG
PROJ. NO: 94-21781
PKWY Architects, LLC © 2021

Interior Details

A7.3



5 Ceiling Lateral Tie Detail




6700 Abercorn Savannah, GA
31405

Owner:
CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect:
Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Michael Orr

MEP Engineer:
Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: (816)997.9627
Contact: Joe Hillebrenner, P.E.

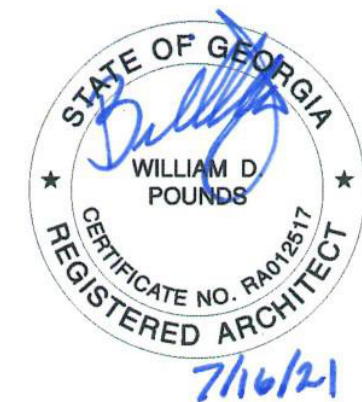

Architect: William D. Pounds

A	Permit Set	2021/07/16
No.	Description	Date

DRAWN BY: EO
CHECKED BY: VG
PROJ. NO: 94-21781
PKWY Architects, LLC © 2021


Interior Details

A7.4

PACK	PANEL SIZE	STYLE	SPECIFICATION			
ART PACK LEGEND						
AP-07	8' x 6'	Welcome wall				
AP-09	4' x 6'	Exit Message				
AP-10	4' x 4' ; 8'x4'	Mozzarella Message				
AP-11	4' x 4' ; 8'x4'	Veggie message				
AP-12	4' x 4' ; 8'x4'	Dough message				
AP-13	14'-6" x 8"	Where A Kid Can Be A Kid				
AP-14	20' x 6'	Game wall "Alley Classic"				
AP-15	12'x6'; 12'x7'; 16'x8'	Birthday Zone Art				
AP-16	8'x6' ; 8'x7' ; 8'x8'	Character wall - Pasqually				
AP-17	8'x6' ; 8'x7' ; 8'x8'	Character wall - Jasper Jowels				
AP-18	8'x6' ; 8'x7' ; 8'x8'	Character wall - Mr. Munch				
AP-19	8'x6' ; 8'x7' ; 8'x8'	Character wall - Helen Henney				
AP-20	8'x6' ; 8'x7' ; 8'x8'	Character wall - Chuck E Cheese				
AP-21	16'x6' ; 16'x7' ; 20'x8'	Party				
AP-21	20'x6' ; 24'x7' ; 28'x8'	Fresh				
AP-21	20'x6' ; 24'x7' ; 28'x8'	High Five				
AP-22	6'x2'	Drink message				
AP-22-V	5'-6"x1'-7 1/2"	Drink message - vinyl decal				
AP-25-FM	6'-8"x2'-7 3/4"	"You Won" Prize shop sign cabinet - flush mount	Top of cabinet 6" below CLG. Clg 12" AFF verify with CEC.			
AP-25-HK	6'-8"x2'	"You Won" Prize shop sign cabinet - ceiling mount	Top of cabinet 6" below CLG. Clg 12" AFF verify with CEC.			
AP-25-ST	Dimension Varies x18"	PVC FCO Tickets				
AP-25-LT	Dimension Varies x3'	PVC FCO Tickets				
AP-27		Painted stripes	GC to paint stripes			
AP-28	38"x42"	Pizza sizing guide				
AP-29-HK	9'x10"	Menu board ledge				
AP-31	4'x4' ; 8'x4'	Tomatoes Message				
AP-33	20'x6' ; 20'x7' ; 24'x8'	Game Wall				
AP-INSTA	6'x6'	CEC Instagram wall	18" AFF			
AP-AYCP	4'x4' ; 8'x4'	CEC All you can play signage				
AP-LOGO	1'-6"x1'-6"	Int logo - size determined by CEC				
Notes: Refer to Comet sign package for final decor legend and sizes. Panel height determined by ceiling height: 9' ceiling = 6' panel height 11' ceiling = 7' panel height 12' ceiling = 8' panel height Reference Interior elevations for custom panel dimensions and locations. CEC to approve final location.			Sign Company: Comet Signs 5003 Stout Dr San Antonio, TX 78219 Contact: Michael Gallegos 210-341-7244 micheal.gallegos@cometsign.com			
MARK	MANUFACTURER	PRODUCT	COLOR	COLOR #	FINISH	
PAINT				INT		EXT
PT-01	Benjamin Moore	N538 ULTRA SPEC 500	Alabaster	BM OC-129	Semi-Gloss	Eggshell
PT-02	Benjamin Moore	N538 ULTRA SPEC 500	Balboa Mist	BM1549	Semi-Gloss	Eggshell
PT-02a	Benjamin Moore	N538 ULTRA SPEC 500	Cumulus Cloud	BM1550	Semi-Gloss	Eggshell
PT-02b	Benjamin Moore	N538 ULTRA SPEC 500	Lapoloma Gray	BM1551	Semi-Gloss	Eggshell
PT-02c	Benjamin Moore	N538 ULTRA SPEC 500	River Reflections	BM1552	Semi-Gloss	Eggshell
PT-03	Benjamin Moore	N538 ULTRA SPEC 500	Ashwood Moss	BM1552	Semi-Gloss	Eggshell
PT-04	Benjamin Moore	N538 ULTRA SPEC 500	Million Dollar Red	2003-10	Eggshell	Eggshell
PT-05	Benjamin Moore	N538 ULTRA SPEC 500	Sabre Gray	1482	Semi-Gloss	Semi-Gloss
PT-06	Benjamin Moore	N538 ULTRA SPEC 500	Etruscan	BM AF-355	Semi-Gloss	Eggshell
PT-07	Benjamin Moore	N538 ULTRA SPEC 500	Iron Mountain	BM2134-30	Semi-Gloss	Eggshell
PT-09	Benjamin Moore	N538 ULTRA SPEC 500	Cabot Trail	BM998	Semi-Gloss	Eggshell
PT-10	Sherwin Williams	SUPERPAINT	Latte	SW6108	Semi-Gloss	Eggshell
PT-10 Alt.	Benjamin Moore	N538 ULTRA SPEC 500	Hillsborough Beige	1033	Semi-Gloss	Eggshell
PT-11	Benjamin Moore	N538 ULTRA SPEC 500	Sycamore Tree	BM539	Semi-Gloss	Eggshell
PT-12	Benjamin Moore	N538 ULTRA SPEC 500	Shades of Spring	BM537	Semi-Gloss	Eggshell
PT-13	Benjamin Moore	N538 ULTRA SPEC 500	Huntington Green	BM406	Semi-Gloss	Eggshell
PT-14	Sherwin Williams	SUPERPAINT	Outrageous Green	SW6922	Semi-Gloss	Eggshell
PT-14 Alt.	Benjamin Moore	N538 ULTRA SPEC 500	Sweet Pea	2031-30	Semi-Gloss	Eggshell
PT-15	Benjamin Moore	N538 ULTRA SPEC 500	Palm Coast Teal	BM733	Semi-Gloss	Eggshell
PT-16	Benjamin Moore	N538 ULTRA SPEC 500	Scandinavian Blue	BM2068-30	Semi-Gloss	Eggshell
PT-17	Sherwin Williams	SUPERPAINT	Real Red	SW6868	Semi-Gloss	Eggshell
PT-17 Alt.	Benjamin Moore	N538 ULTRA SPEC 500	Tricycle Red	2000-20	Semi-Gloss	Eggshell
PT-18	Benjamin Moore	N538 ULTRA SPEC 500	Golden Nugget	BM2019-20	Semi-Gloss	Eggshell
PT-19	Benjamin Moore	N538 ULTRA SPEC 500	Deep Ocean	BM2058-30	Semi-Gloss	Eggshell
PT-E1	Sherwin Williams		Match Existing - Canoe	SW2043		
PT-E2	Sherwin Williams		Match Existing - Sand	SW2059		
Paint Company: Benjamin Moore & Co. 101 Paragon Dr Montvale, NJ 07645 Contact: Gayle Bruen National Accounts Project Manager D: 210-949-6242 C: 201-258-0854 gayle.bruen@benjaminmoore.com		Benjamin Moore & Co. Contact: Christopher W. George Territory Representative North, East Texas/Dallas C: 469-688-9963 chris.george@benjaminmoore.com		BENJAMIN MOORE NATIONAL ACCOUNT #10014623		

SYMBOL	ITEM	SPECIFICATION & COLOR	DESCRIPTION	MANUFACTURER
FLOOR FINISH				
FF-01	PORCELAIN FLOOR TILE	PRODUCT: NORWAY NARVIK BRONZE 8"X40" GROUT: MAPEI ULTRACOLOR PLUS #7 "CHOCOLATE" GROUT LINE: 1/8" PATTERN: RUNNING BOND 1/3 OVERLAP COVE: SCHLUTER DILEX-AHK 1S 125 TSOB	PUBLIC AREA @ ORDER, MERCH, BEV, & SALAD	COMPANY: INTERCERAMIC CONTACT: LORI SHURAFI PHONE: 214-682-7479
		PRODUCT ALT: GRAINSWOOD 6"X24" GW07 WALNUT GROUT: MAPEI ULTRACOLOR PLUS #7 "CHOCOLATE" GROUT LINE: 1/8" PATTERN: RUNNING BOND 1/3 OVERLAP COVE: SCHLUTER DILEX-AHK 1S 125 TSOB		COMPANY: DAL-TILE CONTACT: FREDERICK DAVIS PHONE: 972-423-5465 469-964-3246 FRED.DAVIS@DALTILE.COM
		PRODUCT ALTERNATE: SADDLEBROOK SIZE: 6"X36" SD15 WALNUT GROUT: MAPEI ULTRACOLOR PLUS #7 "CHOCOLATE" GROUT LINE: 1/8" PATTERN: RUNNING BOND 1/3 OVERLAP COVE: SCHLUTER DILEX-AHK 1S 125 TSOB		
FF-02	CARPET TILE	PRODUCT SYNCOPATION 50cm - 10% 188442 WORK GREEN 19.69"x19.69" (50cm) TILES - 20% 188443 WORK BLUE 19.69"x19.69" (50cm) TILES - 70% 105773 ICE BREAKER JET MIST 19.69"x19.69" (50cm) TILES TRANSITION: ARMSTRONG VT060125 JET BLACK	PUBLIC AREA	COMPANY: INTERFACE CONTACT: JERRY ARNOLD PHONE: 415-515-9316 JERRY.ARNOLD@INTERFACE.COM
FF-03	WALK-OFF CARPET TILE	WALK-OFF CARPET - 104945 STEP REPEAT 999 ONYX 19.69"x19.69" (50cm) TILES	ENTRY VESTIBULE/ KID CHECK	
FF-04	PORCELAIN FLOOR TILE	PRODUCT: PINOTI GOLD MEUNIER SIZE: 20"X20" (INSTALL DIAGONAL) GROUT: MAPEI #42 - MOCHA 1/8"	RESTROOM FLOOR TILE	COMPANY: INTERCERAMIC CONTACT: JERRY ARNOLD PHONE: 415-515-9316 PHONE: 214-682-7479
	PORCELAIN FLOOR TILE	PRODUCT ALTERNATE: SLATE ATTACHE MULTI SIZE: 24"X24" GROUT: MAPEI #15 BONE		COMPANY: DAL-TILE CONTACT: FREDERICK DAVIS PHONE: 972-423-5465 469-964-3246 FRED.DAVIS@DALTILE.COM
Furniture Schedule				
FN-01	DINING CHAIR	PRODUCT: SPRINT SIDE CHAIR SPRI-SC COLOR: MATTE BLACK PC002/ PL-01 SIZE: 18" W 20" D 18" SH VERIFY SPEC. WITH ARCHITECT	FAMILY DINING BANQUET CHAIR *	COMPANY: DESIGNFORM CONTACT: KAYLA HODGE PHONE: 949-351-4288 EMAIL: kayla@globalsourceindustries.com
FN-02	PARTY BENCH		BIRTHDAY ROOM	COMPANY: JAK W CONTACT: LAURA KAHAR PHONE: 970-376-3151 EMAIL: laura@jak-w.com
FN-03	DINING TABLE	PRODUCT: DINING TABLE EDGE: EASED EDGE FINISH: PL-02 SIZE: 42" X 28" BASE: WRINKLE BLACK, CROSS SHAPED	FAMILY/ GAMES BANQUET TABLE	
FN-04	DINING TABLE	PRODUCT: DINING TABLE EDGE: EASED EDGE FINISH: PL-02 SIZE: 60" X 28" BASE: WRINKLE BLACK, CROSS SHAPED	FAMILY/ GAMES BOOTH TABLE	
FN-05	DINING TABLE	PRODUCT: DINING TABLE EDGE: EASED EDGE FINISH: PL-02 SIZE: 61" X 51" BASE: WRINKLE BLACK, CROSS SHAPED	FAMILY/ GAMES CORNER TABLE	
FN-06	DINING TABLE	PRODUCT: DINING TABLE EDGE: EASED EDGE FINISH: PL-02 SIZE: 42" X 28" BASE: WRINKLE BLACK, CROSS SHAPED	SHOWROOM LOOSE TABLE	COMPANY: MIDWEST CABINET CONTACT: SUSAN EICHENBERGER PHONE: 785-242-8181 EXT. 23 EMAIL: seichenberger@midwestcabinet.com
FN-07	DINING TABLE	PRODUCT: DINING TABLE EDGE: EASED EDGE FINISH: PL-02 SIZE: 60" X 26" BASE: WRINKLE BLACK, CROSS SHAPED	SHOWROOM LOOSE TABLE	
FN-08	DINING TABLE	PRODUCT: DINING TABLE EDGE: EASED EDGE FINISH: ROCK OF AGES LAMINATE PIONITE SIZE: 90" X 24" BASE: WRINKLE BLACK, CROSS SHAPED	SHOWROOM HIGHTOP TABLE	
FN-09	DINING TABLE	PRODUCT: DINING TABLE EDGE: EASED EDGE FINISH: PL-02 SIZE: 42" X 26" BASE: WRINKLE BLACK, CROSS SHAPED	SHOWROOM TABLE	
UPH-01	UPHOLSTERY	PRODUCT: THE SYMPHONY COLLECTION STUDIO STYLE: PERSUASION COLOR: CHINA RED TPE 010, SIZE: 54"	-	-
UPH-01	UPHOLSTERY	PRODUCT: THE SYMPHONY COLLECTION STUDIO STYLE: PERSUASION COLOR: MATADOR TPE 017, SIZE: 54"	-	-
UPH-01	UPHOLSTERY	PRODUCT: THE SYMPHONY COLLECTION STUDIO STYLE: PERSUASION COLOR: BEET TPE 004, SIZE: 54"	-	-
Ceiling Schedule				
LT-1	ACT	PRODUCT: #1761HA SECOND LOOK II FINE FISSURED 2"x4"x3/4" COLOR: MATCH EXISTING or HAZE GRID: PRELUDE XL 15/16" EXPOSED TEE	CEILING TILE	COMPANY: ARMSTRONG
LT-2	ACT	PRODUCT: #670 VINYLCLAD GYPSUM 2"x4"x1/2" COLOR: MATCH EXISTING or WHITE GRID: PRELUDE XL WHITE	CEILING TILE	
SURFACES FINISHES				
SS-01	SOLID SURFACE	PRODUCT: SOLID SURFACE COLOR: 9091 ML - MIDNIGHT MELANGE THICKNESS: 1/2" EDGE: EASED EDGE: 1/4" ROUND	ORDER/SALAD/BEV. BAR COUNTER	COMPANY: WILSONART
		PRODUCT: SOLID SURFACE COLOR: MIDNIGHT THICKNESS: 1/2" EDGE: EASED EDGE: 1/4" ROUND		COMPANY: CORIAN
SS-04	SOLID SURFACE	PRODUCT: SAN GABRIEL RIVERSTONE 9138RS	RESTROOM COUNTER & HAND DRYER WALL	COMPANY: WILSONART
		PRODUCT ALT: SOLID SURFACE COLOR: SEA STONE		
		PRODUCT ALT: SOLID SURFACE COLOR: FOSSIL		COMPANY: CORIAN

SYMBOL	ITEM	SPECIFICATION & COLOR	DESCRIPTION	MANUFACTURER	
WALL COVER					
WM-01	MARLITE	PRODUCT: SOLID COLOR COLOR: MORNING HAZE 5446-S2V SIZE: 1/4" BEVEL TONGUE GROOVE	INTERIOR WAINSCOT	COMPANY: MARLITE CONTACT: DONNA DEHART DDEHART@MARLITE.COM	
WT-03	GLAZED CERAMIC TILE	PRODUCT: X114 DESERT GREY 4"x12" GROUT: LATICRETE PERMACOLOR: 60 DUSTY GRAY TRIM: RONDEC SATIN ANODIZED ALUM. SCHLUTER	MENU BOARD WALL	COMPANY: DAL-TILE CONTACT: FREDERICK DAVIS PHONE: 972-423-5465	
		PRODUCT ALT.: SISTEMC SIZE: MRO FUMO-C SIZE: 4"x12" GROUT: LATICRETE PERMACOLOR SELECT: 60 DUSTY GRAY		COMPANY: MARAZZI COLOR: TARYN CONTACT: TARYN.FISCHER PHONE: 415-554-1937 TARYN.FISCHER@DALTILE.COM	
WT-05	GLAZED CERAMIC BASE	PRODUCT: 4"x8" BRITE ALMOND SIZE: 3"x8" GROUT: MAPEI NONSANDED #15 BONE 1/8"	RESTROOM WALL	COMPANY: INTERCERAMIC CONTACT: LORI SHURAFRA PHONE: 214-682-7479	
		PRODUCT ALTERNATE: 0135 ALMOND SIZE: 4"x8" GROUT: MAPEI NONSANDED #15 BONE 1/8"		COMPANY: DAL-TILE CONTACT: FREDERICK DAVIS PHONE: 972-423-5465 469-964-3246 FRED.DAVIS@DALTILE.COM	
WT-06	GLAZED PORCELAIN TILE	PRODUCT: PINOT/ GOLD MEUNIER SIZE: 4"x8" GROUT: MAPEI NONSANDED #15 BONE 1/8"	RESTROOM WALL ACCENT BAND	COMPANY: INTERCERAMIC CONTACT: LORI SHURAFRA PHONE: 214-682-7479	
		PRODUCT ALTERNATE: SLATE SA08 MULTI BROWN SIZE: 12"x24" GROUT: MAPEI NONSANDED #15 BONE 1/8"		COMPANY: DAL-TILE CONTACT: FREDERICK DAVIS PHONE: 972-423-5465 469-964-3246 FRED.DAVIS@DALTILE.COM	
FRP-02	FRP	PRODUCT: C 100-G63 STYLE: SUBWAY FRP COLOR: WHITE SIZE: 4' X 10' CAULK BUTT JOINTS NW/ PENNY SPACING	KITCHEN WALL OPEN TO PUBLIC VIEW	COMPANY: MARLITE	
FRP-03	MOSAIC FRP	PART NUMBER: #204137 VU-SKY CHUCK E. CHEESE BEVBAR 48X120 ADHESIVE: FRP MARLITE ADHESIVE. USE CAULK TO MATCH FRP LIGHT GREY SEAM JOINT: 6 PENNY SPACING NAIL BETWEEN PANELS. INSTALL PER MANF. INSTALLATION. PROVIDE BLACK OUTSIDE CORNER GUARDS.	KITCHEN WALL OPEN TO PUBLIC VIEW	COMPANY: MARLITE CONTACT: DONNA DEHART DDEHART@MARLITE.COM	
WALL BASE					
WB-01	VINYL WALL BASE	PRODUCT: 60-JET BLACK COLOR: INTEGRATED COVE: 6" COVED	INTERIOR WALL BASE WITH CARPET	COMPANY: ARMSTRONG	
WB-04	GLAZED CERAMIC BASE	PRODUCT: BRITE ALMOND SIZE: 6"x6" GROUT: MAPEI #15 BONE	RESTROOM COVE BASE	COMPANY: INTERCERAMIC CONTACT: LORI SHURAFRA PHONE: 214-682-7479	
		PRODUCT ALTERNATE: 0135 AIMOND SIZE: 4"x8" GROUT: MAPEI #15 BONE		COMPANY: DAL-TILE CONTACT: FREDERICK DAVIS PHONE: 972-423-5465 469-964-3246 FRED.DAVIS@DALTILE.COM	
WB-05	GLAZED CERAMIC BASE	PRODUCT: INTERCERAMIC NORWAY NARVIK BRONZE 8"x40" (OFFSET INSTALL FOR WOOD LOOK) GROUT: MAPEI #7 - "CHOCOLATE" GROUT LINE: USE A 1/8" COVE: DILEX-AHK 1S 125 TSOB SCHULTER	TILE BASE AROUND PUBLIC TILE AREA CUT 8" TILE DOWN TO 6" BASE HEIGHT.	COMPANY: INTERCERAMIC CONTACT: LORI SHURAFRA PHONE: 214-682-7479	
		PRODUCT ALTERNATE: SADDLEBROOK SIZE: 6"x36" SD15 WALNUT GROUT: MAPEI #7 - "CHOCOLATE" GROUT LINE: USE A 1/8" PATTERN: RUNNING BOND 1/3 OVER LAP COVE: DILEX-AHK 1S 125 TSOB SCHULTER		COMPANY: DAL-TILE CONTACT: FREDERICK DAVIS PHONE: 972-423-5465 469-964-3246 FRED.DAVIS@DALTILE.COM	
		PRODUCT ALTERNATE: GRAINSWOOD SIZE: 6"x24" GW07 WALNUT GROUT: MAPEI #7 - "CHOCOLATE" GROUT LINE: USE A 1/8" PATTERN: RUNNING BOND 1/3 OVER LAP COVE: DILEX-AHK 1S 125 TSOB SCHULTER		COMPANY: DAL-TILE CONTACT: FREDERICK DAVIS PHONE: 972-423-5465 469-964-3246 FRED.DAVIS@DALTILE.COM	
LAMINATE					
PL-05	PLASTIC LAMINATE	PRODUCT: KHAKI BROWN D50-60	BOTH FACES	COMPANY: WILSONART	
HARDWARE SCHEDULE					
Entrry Storefront				Contact:	
1 EA	TOP PIVOT - FRAME	834 OP-6 CLR FINISH	OLD CASTLE	COMPANY: UNIVERSAL MANUFACTURING CONTACT: THERESA LAND PHONE: 901-458-5881	
1 EA	TOP PIVOT - DOOR	838 OP-7 CLR FINISH	OLD CASTLE		
1 EA	BOTTOM PIVOT - FRAME	805/836 OP-10 CLR FINISH	OLD CASTLE		
1 EA	BOTTOM PIVOT - INTERNAL	846 OP-9 CLR FINISH	OLD CASTLE		
1 EA	PULL HANDLE	12368 PH-21 YB CLR FINISH	OLD CASTLE		
1 EA	EXIT DEVICE	CD35474A-TL LESS 386T US28	VON DUPRIN		
1 EA	RIM CYLINDER	198 CY-5 CLR FINISH	OLD CASTLE		
1 EA	THRESHOLD	TH-43	OLD CASTLE		
1 EA	WEATHERSTRIP	4299 V-231 CLR FINISH	OLD CASTLE		
1 EA	SURFACE CLOSER	4041 90-DEGREE STOP	LCN		
1 EA	DOOR SWEEP	200NA X WIDTH	NATIONAL GUARD		
1 EA	DOOR STOP	267F	HAGER		
Entrry Vestibule					
1 EA	TOP PIVOT - FRAME	834 OP-6 CLR FINISH	OLD CASTLE		
1 EA	TOP PIVOT - DOOR	838 OP-7 CLR FINISH	OLD CASTLE		
1 EA	BOTTOM PIVOT - FRAME	805/838 OP-10 CLR FINISH	OLD CASTLE		
1 EA	BOTTOM PIVOT - INTERNAL	846 OP-9 CLR FINISH	OLD CASTLE		
1 EA	PULL HANDLE	12368 PH-21 YB CLR FINISH	OLD CASTLE		
1 EA	PUSH BAR	142 PB-16 CLR FINISH	OLD CASTLE		
1 EA	SURFACE CLOSER	4041 90-DEGREE STOP	LCN		
Note: Install door sweeps at all egress doors.					

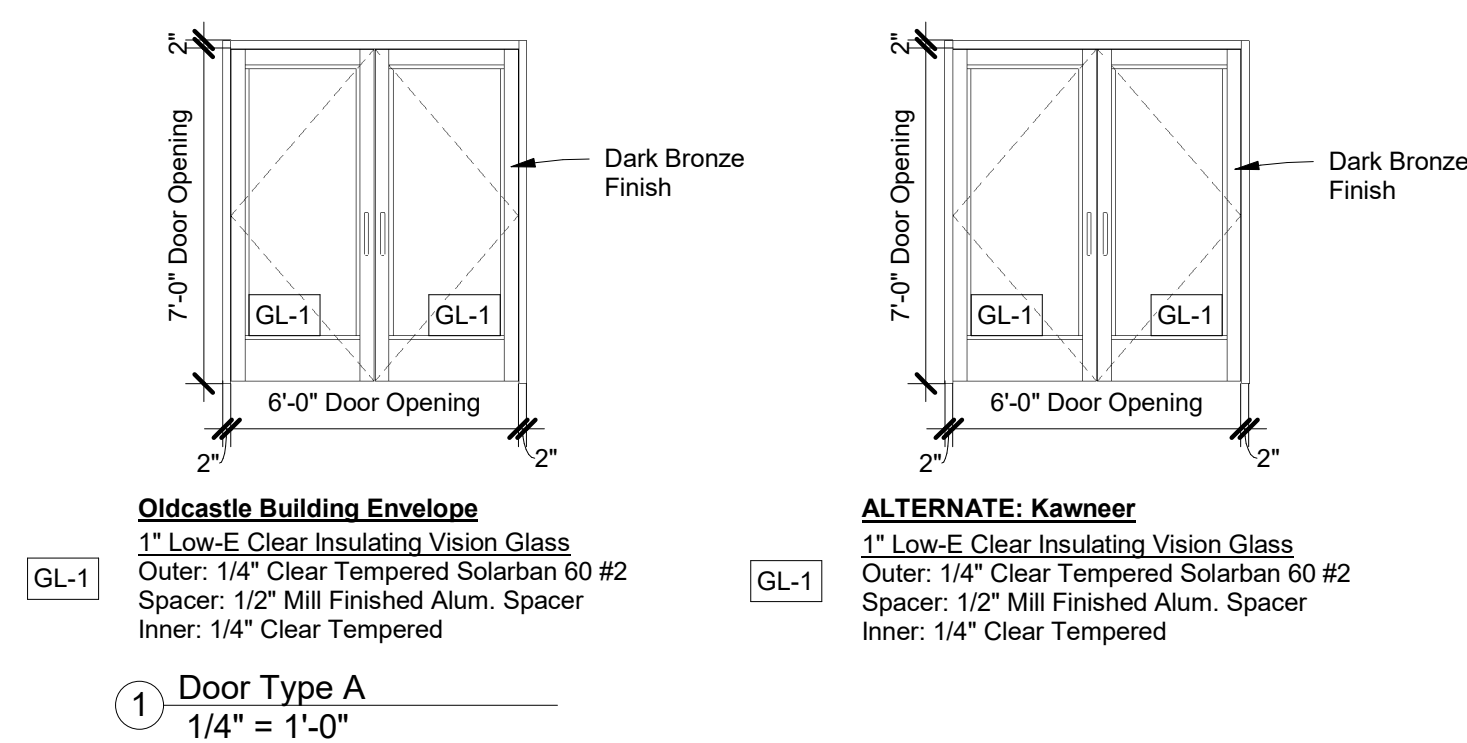

**CITY OF SAVANNAH
DEVELOPMENT
SERVICES**

**PLAN
APPROVED
08/02/2021**



#605

6700 Abercorn Savannah, GA
31405

Owner:

CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect:

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Michael Orr

MEP Engineer:

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: (816)997.9627
Contact: Joe Hillebrenner, P.E.










Architect: William D. Pounds

A	Permit Set	2021/07/16
No.	Description	Date

DRAWN BY: EO
CHECKED BY: VG
PROJ. NO: 94-21781
PKWY Architects, LLC © 2021

Schedules


A8.0

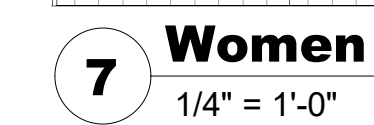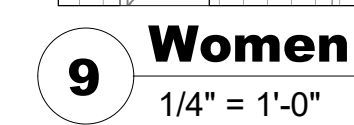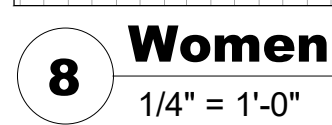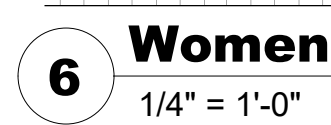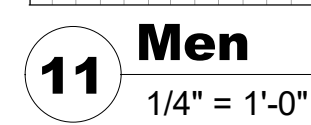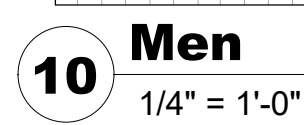

Toilet Partitions

Provide and install floor mounted toilet partitions.


1. Flush Metal Phenolic Compartments:
 - A. Colors: Wilsonart - Tungsten EV 4814-60
 1. Doors: 1" thick with sharp edges removed.
 2. Panels: 1" thick
 3. Pillasters: 1 1/4" thick
2. Top Brackets:
 - A. Bright anodized aluminum channel 1 7/16" x 1 1/4" anti-grip design and thru-bolted through fronts.
 - B. Front shall be secured to the floor with 12GA type 304 stainless angle and two (2) 5/16" studs with leveling nuts and washers.
3. Accessories: Combination coat hook and bumper at each stall.
4. Hardware: Compartments shall have all hardware and fasteners necessary for complete installation.
 - A. Hinges shall be surface mounted and made of chrome plated zamac.
 - B. Top hinges shall have concealed abs adjustable cams with chrome plated zamac reinforcing pin.
 - C. Stop, keeper, and slide latch shall be chrome plated zamac.
 - D. All brackets shall be chrome plated zamac.
 - E. All hardware shall be thru-bolted with one-way fasteners.



Owner:
CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect:
Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Michael Orr

MEP Engineer:
Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: (816)997.9627
Contact: Joe Hillebrenner, P.E.

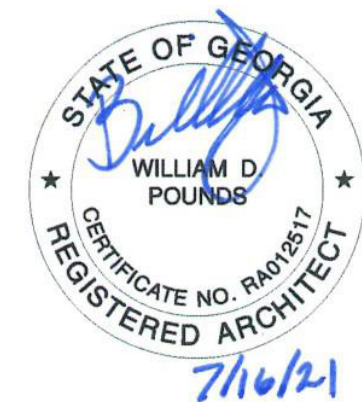


Architect: William D. Pounds

A	Permit Set	2021/07/16
No.	Description	Date

DRAWN BY: EO
CHECKED BY: VG
PROJ. NO: 94-21781
PKWY Architects, LLC © 2021

Enlarged Restroom Plan

A9.2

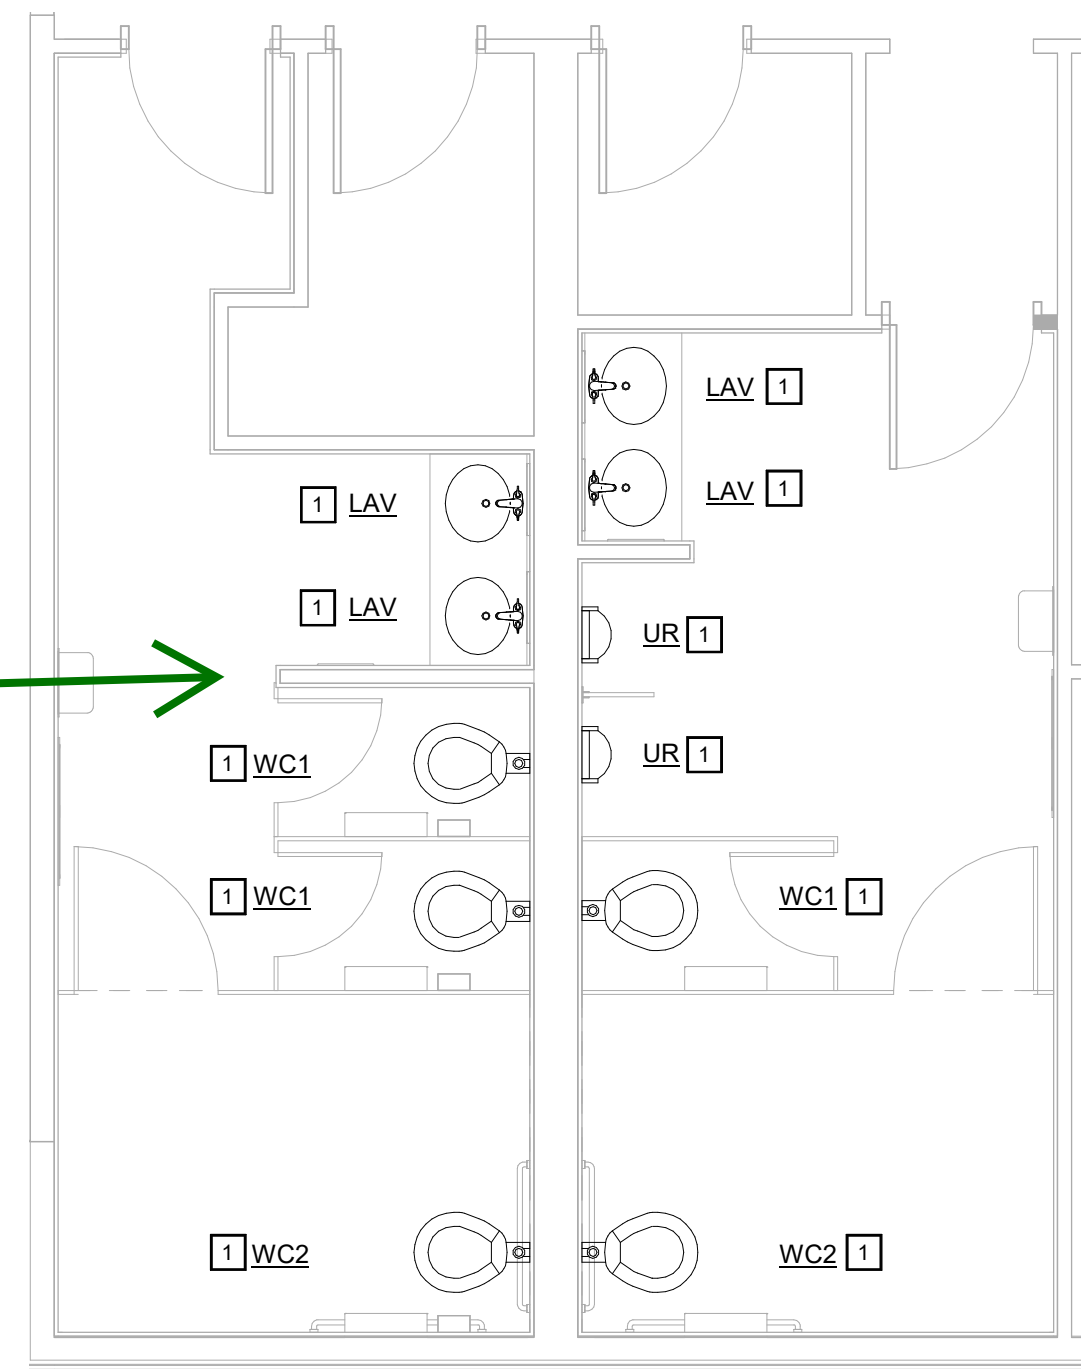

Pay attention to the 2018 IPC Section 405.3.1 concerning bath room plumbing fixture clearances. See A9.2

01 ENLARGED RESTROOM PLUMBING PLAN

$$1/4" = 1'-0"$$


PLUMBING PLAN NOTES

1 PROVIDE NEW PLUMBING FIXTURE AND ACCESSORIES IN SIMILAR LOCATION. EXISTING WASTE, VENT, AND SUPPLY PIPING TO BE MODIFIED AS NECESSARY FOR CONNECTIONS TO NEW FIXTURE. REFER TO ARCHITECTURAL DRAWINGS FOR FIXTURE LOCATIONS AND DETAILS.

PLUMBING SYMBOLS LEGEND

ABBREVIATIONS:

AFI/FG	ABOVE FINISHED FLOOR/GRADE
AHJ	AUTHORITY HAVING JURISDICTION
AS	ANGLE STOP
BFP	BACKFLOW PREVENTER
CO	CLEANOUT
ETR	EXISTING TO REMAIN
FPC	FIRE PROTECTION CONTRACTOR
FFCO/FGO	FLUSH FLOOR/GRADE CLEANOUT
FSEC	FOOD SERVICE EQUIPMENT CONTRACTOR
GC	GENERAL CONTRACTOR
IW	INDIRECT WASTE
OC	ON CENTERS
MC	MECHANICAL CONTRACTOR
NPFA	NATIONAL FIRE PROTECTION ASSOCIATION
PC	PLUMBING CONTRACTOR
RI	ROUGH-IN
TYP	TYPICAL
VTR	VENT THRU ROOF
WCO	WALL CLEANOUT

LINETYPES:

— — — — —	COLD WATER (CW)
— — — — —	HOT WATER (HW)
— — — — —	HOT WATER RETURN (HWR)
— — — — —	SANITARY WASTE (SAN) - BELOW SLAB/GRADE
— — — — —	PLUMBING VENT (V)
— — V — —	PLUMBING VENT (V) - BELOW SLAB/GRADE
— — CW — —	COLD WATER BELOW SLAB/GRADE
— — HW — —	HOT WATER BELOW SLAB/GRADE
— — BEV — —	BEVERAGE CONDUIT (BEV)
— — CO2 — —	CO2 CONDUIT (CO2)

PIPE SYMBOLS:

	PIPE TURNING UP/DOWN
	TEE TURNING UP/DOWN
	SHUTOFF VALVE (BALL TYPE)
	END CAP
	CONNECT TO EXISTING

FIRE PROTECTION CRITERIA

THIS SPACE IS CURRENTLY SERVED BY AN AUTOMATIC WET PIPE FIRE SPRINKLER SYSTEM. CONTRACTOR SHALL BE RESPONSIBLE FOR THE MODIFICATION OF THE EXISTING FIRE SPRINKLER SYSTEM IN ACCORDANCE WITH NFPA REQUIREMENTS. PROVIDE ALL MATERIALS AND LABOR REQUIRED FOR COMPLETE INSTALLATION. SYSTEM MODIFICATIONS SHALL BE DESIGNED UNDER THE SUPERVISION OF A LICENSED PROFESSIONAL ENGINEER, AND CONTRACTOR SHALL PREPARE ALL REQUIRED SIGNED/SEALED DRAWINGS. ALL WORK SHALL BE SUBJECT TO APPROVAL OF ALL STATE, LOCAL, AND INSURANCE UNDERWRITING AUTHORITIES. THE SPRINKLER SYSTEM SHALL BE TESTED UNDER PRESSURE BY CONTRACTOR, AND INSPECTED AND APPROVED BY LOCAL FIRE MARSHAL, PRIOR TO ACCEPTANCE BY OWNER.

THIS SHEET IS PART OF THE CONSTRUCTION DOCUMENTS. DRAWINGS, SPECIFICATIONS AND OTHER SHEETS APPLY AND NEED TO BE REVIEWED IN TOTAL. ITEMS SHOWN ARE FOR DIAGRAMMATIC REPRESENTATION AND MAY NOT BE RELIED ON OR USED AS SHOP DRAWINGS. PROVIDE ALL MODIFICATIONS REQUIRED TO CONFORM TO SITE CONDITIONS, EQUIPMENT AND MATERIAL USED. VERIFY LOCATIONS AND DIMENSIONS OF ALL ARCHITECTURAL AND STRUCTURAL ELEMENTS PER THEIR RESPECTIVE DOCUMENTS. AS THESE ELEMENTS ARE SHOWN ONLY FOR REFERENCE, THE ENGINEER'S LIABILITY IS LIMITED TO FABRICATION OR CONSTRUCTION. ENGINEER HAS NO LIABILITY FOR THE ACCURACY OF THESE ASSOCIATED ELEMENTS, OR FOR ANY WORK THE ENGINEER HAS NOT SIGNED AND SEALED.



Dialectic Group, Inc.
310 W 20th Street, Suite 200
Kansas City, MO 64108

California Certificate of
Authorization Number C1716

T 816-997-9601
F 816-997-9602
DialecticEng.com

Copyright 2021

PLUMBING FIXTURE SCHEDULE					
REFER TO ARCHITECTURAL SHEET A103 ENLARGED RESTROOM PLAN FOR FINAL PLUMBING FIXTURE SPECIFICATIONS					
ID	FIXTURE TYPE	MANUFACTURER	MODEL NO.	DESCRIPTION	TRIM AND REMARKS
<u>LAV</u>	LAVATORY	WILSONART	#BV123 CREAM 1572-SL	SOLID SURFACE INTEGRAL MOUNT SINK	PROVIDE WITH A TOTO #TLG03301W/CP 1.2 GPM, MANUAL, SINGLE HANDLE, ADA COMPLIANT, CHROME FINISH, BRASS CONSTRUCTION, LEVER HANDLE CERAMIC DISC VALVE CARTRIDGE CONSTRUCTION. WILKINS #ZW388700T, MIXING VALVE SET TO 105 DEGREES. PROVIDE WITH GRID STRAINER DRAIN WITH TAILPIECE, CHROME PLATED CAST BRASS P-TRAP WITH CLEANOUT, WASTE ARM TO WALL WITH ESCUTCHEON AND LOOSE KEY ANGLE STOPS. INSULATE WATER AND WASTE PIPING UNDER LAVATORY WITH TRUEBRO "LAV GUARD2" #102E-Z. FAUCET ALTERNATIVES - IN EVENT THE SPECIFIED FAUCET IS UNAVAILABLE DUE TO SCHEDULING: ALTERNATIVE #1: KOHLER KUMIN SINGLE-HANDLE BATHROOM SINK FAUCET K-98827-4 FINISH (CP) ALTERNATIVE #2: PFISTER PFIIR1 SERIES SINGLE CONTROL LAVATORY FAUCET LG142-0600 FINISH (C)
<u>UR</u>	URINAL	TOTO	#UT105U 0.125 GPF	HIGH-EFFICIENCY 0.125 GPF WALL HUNG WHITE VITREOUS CHINA WASHOUT URINAL	PROVIDE WITH TOTO "ECOPOWER" #TEU1U1A12#CP FLUSH VALVE.
<u>WC2</u>	WATER CLOSET ADA	AMERICAN STANDARD	#3043.001	ADA FLOOR MOUNT FLUSHOMETER VALVE TOILET, VITREOUS CHINA 16-1/2" HEIGHT	BATTERY POWERED AUTOMATIC FLUSH VALVE #B605.161.002, WHITE HEAVY-DUTY OPEN FRONT LESS COVER SEAT #5901.100. PROVIDE WITH VACUUM BREAKER, ANGLE CHECK STOP, AND FITTINGS REQUIRED FOR INSTALLATION.
<u>WC1</u>	WATER CLOSET	AMERICAN STANDARD	#2243.001	FLOOR MOUNT FLUSHOMETER VALVE TOILET, VITREOUS CHINA 15" HEIGHT	PROVIDE WITH AMERICAN STANDARD TOILET BATTERY POWERED AUTOMATIC FLUSH VALVE #B605.161.002, WHITE HEAVY-DUTY OPEN FRONT LESS COVER SEAT #5901.100. PROVIDE WITH VACUUM BREAKER, ANGLE CHECK STOP, AND FITTINGS REQUIRED FOR INSTALLATION.

**CITY OF SAVANNAH
DEVELOPMENT
SERVICES**

**PLAN
APPROVED
08/02/2021**

Whiteoak, LLC
Savannah, TX 75407
Phone: (972) 221-1379
Fax: (972) 221-1379



#605

6700 Abercorn Savannah, GA
31405

Owner:


CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Michael Orr

MEP Engineer

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: 816-997-9627
Contact: Joe Hillebrenner, P.E.

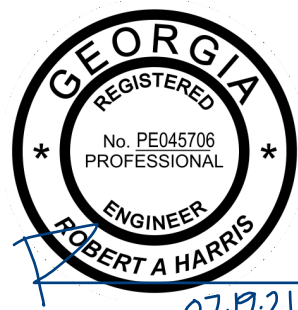

No.	Description	Date

DRAWN BY: JMB


CHECKED BY: NRP

PROJ. NO: 94-21781

Copyright PKWY Architects, LLC 2019 ©

MECHANICAL &
PLUMBING

MP1.0

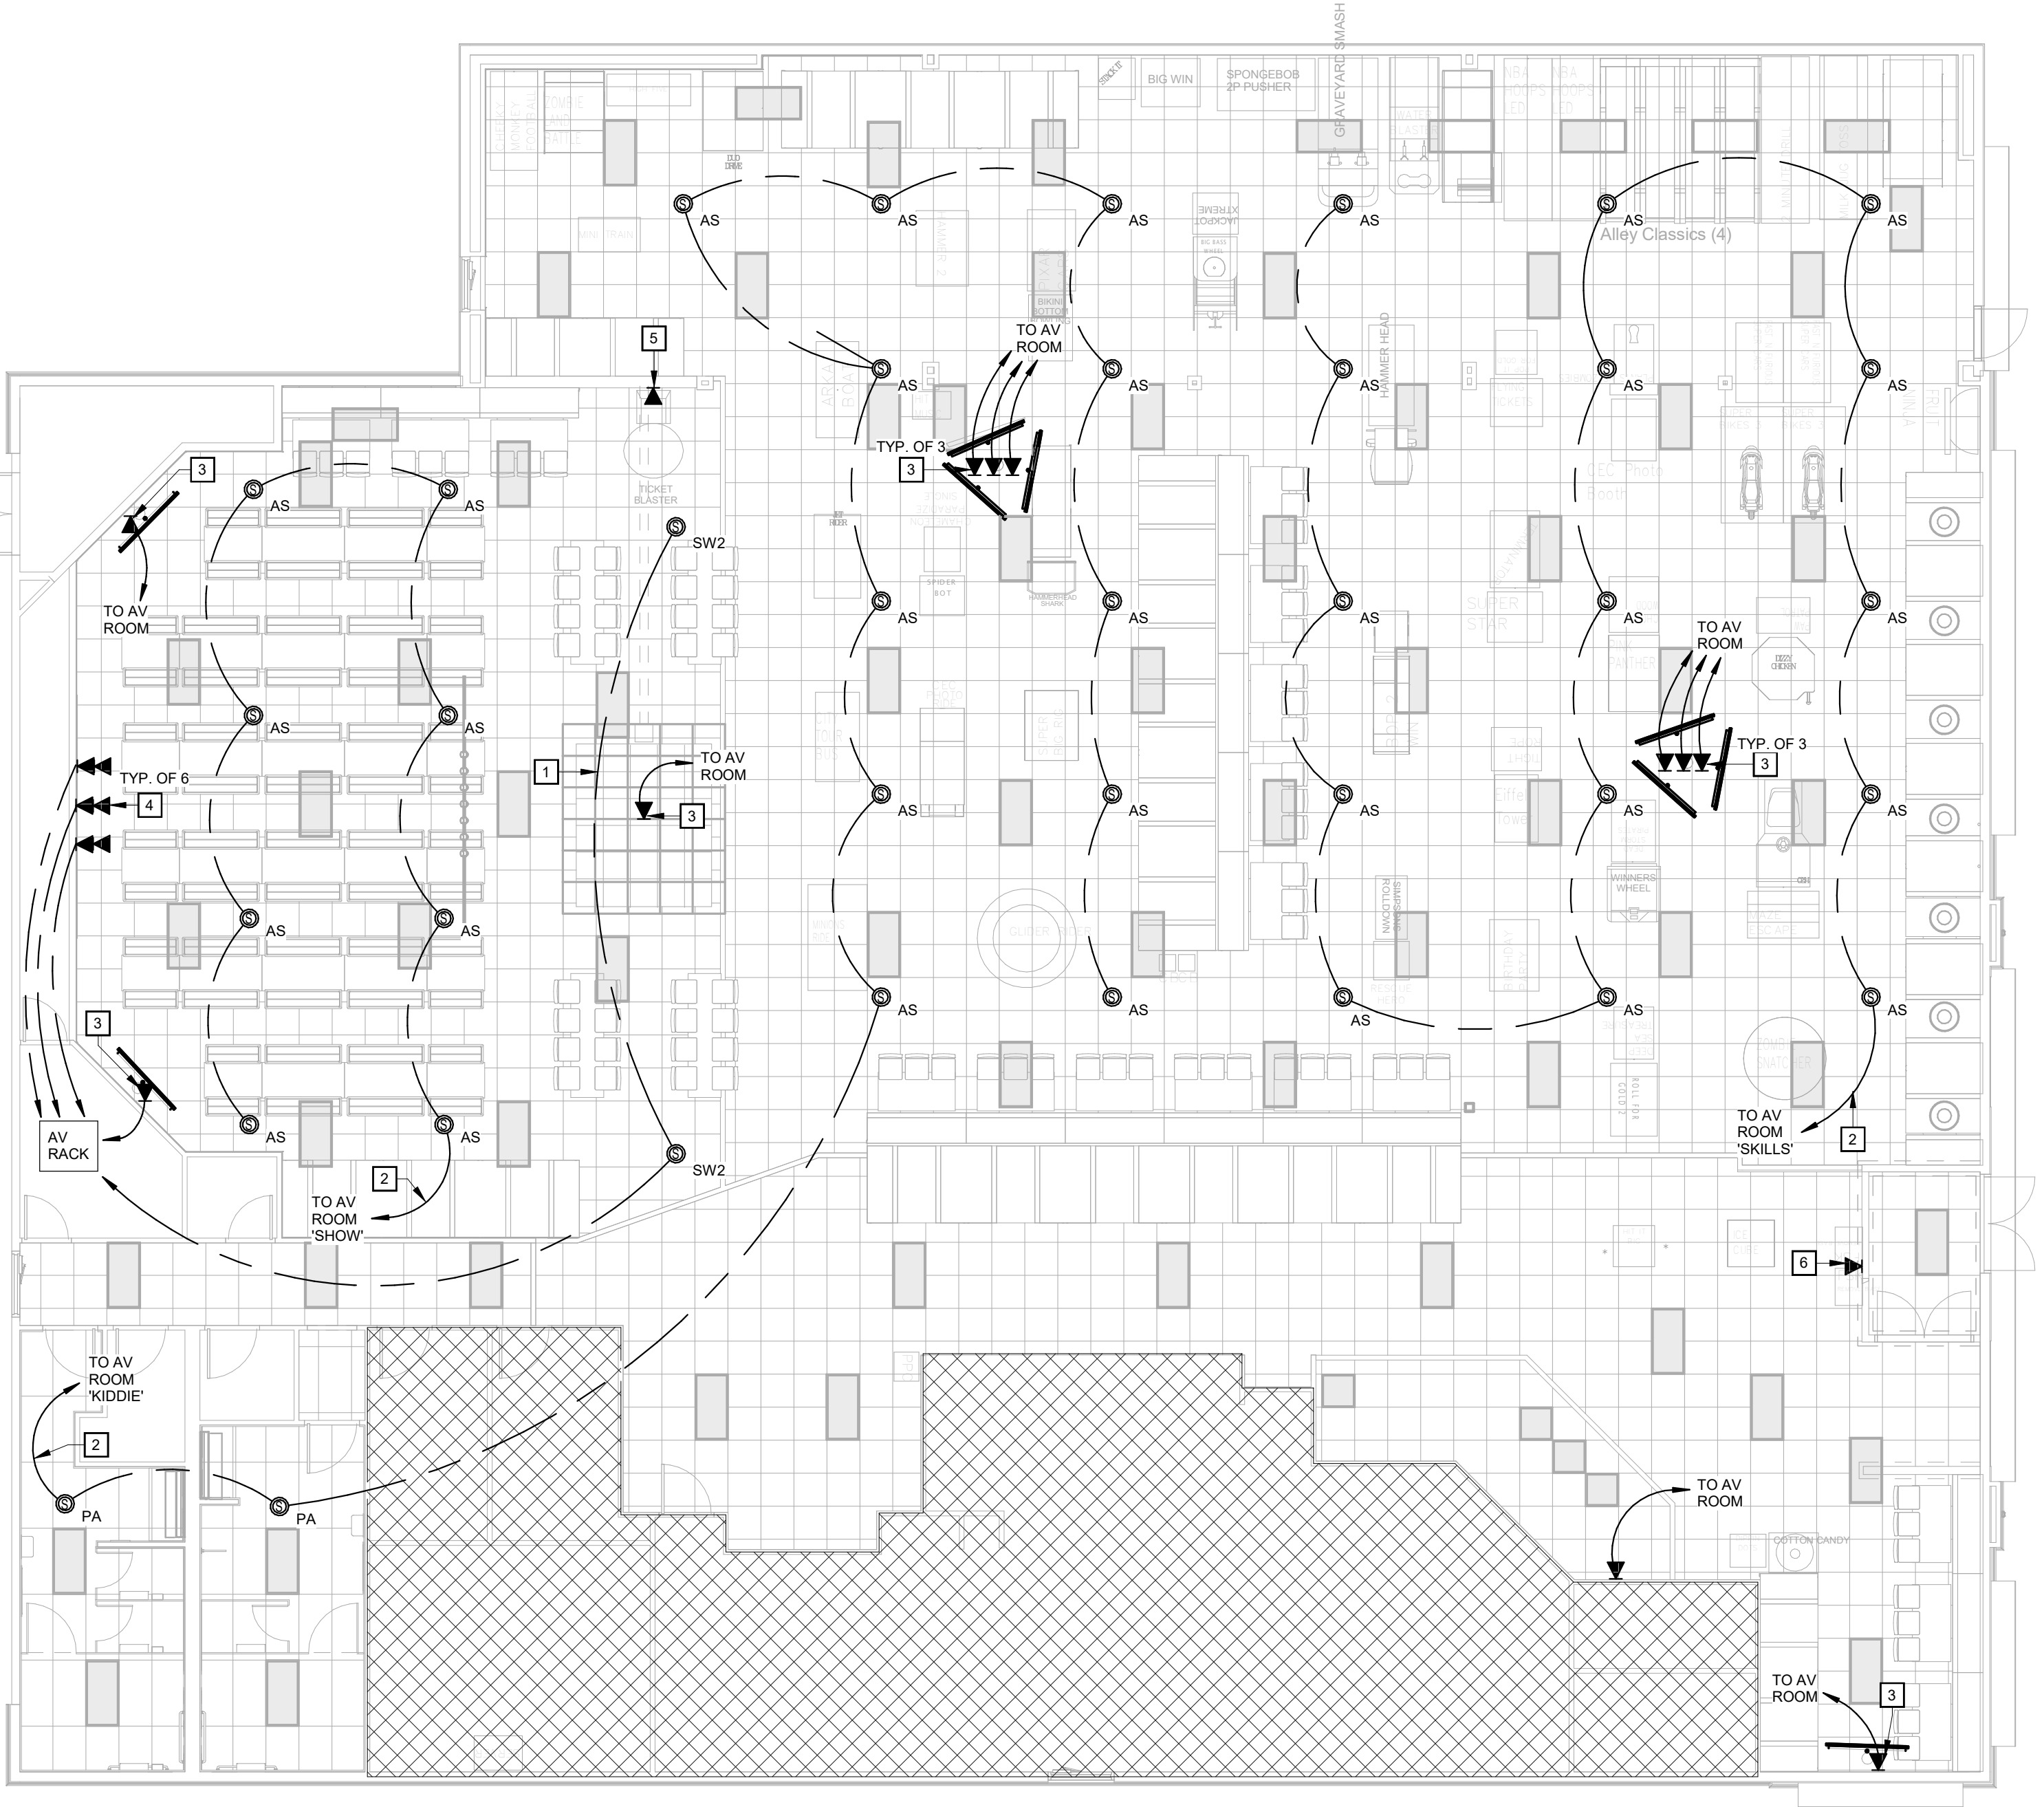

01 SPEAKER PLAN

1/8" = 1'-0"



SPEAKER PLAN LEGEND:

- AS ATLAS SPEAKER (CEILING)
- PA RESTROOM SPEAKER (CEILING)
- SW CEILING SUBWOOFER
- AUDIO
- - - - DATA/MONITOR

SPEAKER NOTES

- 1 INSTALL NEW ATLAS FAP42T SPEAKERS AT 16'-0" ON CENTER MAX. OR AS INDICATED. SET TO 70V, 16W
- 2 DO NOT INSTALL SPEAKERS OVER THE FOLLOWING:
 - 2A. FURNITURE
 - 2B. SKYTUBES
 - 2C. MERCHANDISE OR POS STATIONS
 - 2D. BEVERAGE BAR
 - 2E. SKEEBALL OR ALLEY ROLLER CLASSICS
- 3 16 AWG - 2 CONDUCTOR WIRE RUNS - CEC PROVIDED.
- 4 G.C. TO MOUNT SW1 & SW2.
- 5 G.C. TO RUN CABLES AND MAKE CONNECTIONS AS INDICATED ON PLANS.
- 6 G.C. TO PROVIDE WIRING FROM SW1 TO SW2 TO AV ROOM.
- 7 SET 'SW' SPEAKERS TO 8 OHMS

ELECTRICAL KEYNOTES

- 1 1 RUN SW1 TO AC ROOM LABELED "SUBS", 1 RUN SW1 TO SW2.
- 2 EACH ZONE TO BE WIRED IN SERIES. THE RUNS WILL GO BACK TO THE SHOW RACK WHERE THEY ARE TO BE LABELED BY ZONE SO INSTALLER CAN IDENTIFY AND TAP INTO THE CORRECT CHANNEL ON THE AMPLIFIER.
- 3 DATA OUTLET MOUNTED TO CEILING. BLACK CAT 6 RUN AT EACH TV TO AV ROOM (CEC PROVIDED) TO FLOOR +10'
- 4 DATA FOR VIDEO WALL. VERIFY MOUNTING HEIGHT. BLACK CAT 6 RUN AT EACH TV TO AV ROOM (CEC PROVIDED) TO FLOOR +10'
- 5 CABLE AT 18" A.F.F. BEHIND TICKET BLASTER.
- 6 PROVIDE DATA PORT FOR FSK EQUIPMENT ROUTED THROUGH POWER POLE.



Dialectic Group, Inc.
310 W 20th Street, Suite 200
Kansas City, MO 64108
California Certificate of
Authorization Number C1716
T 816-997-9601
F 816-997-9602
DialecticEng.com
Copyright 2021

CITY OF SAVANNAH
DEVELOPMENT
SERVICES

PLAN
APPROVED
08/02/2021



#605

6700 Abercorn Savannah, GA
31405

Owner:

CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect:

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Michael Orr

MEP Engineer:

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: 816-997-9627
Contact: Joe Hillebrenner, P.E.




No.	Description	Date
A	Permit Issue	2021.07.16

DRAWN BY: AAR
CHECKED BY: ATF
PROJ. NO: 94-21781
Copyright PKWY Architects, LLC 2019 ©

SPEAKER PLAN

AV1.0

ELECTRICAL SYMBOLS LEGEND

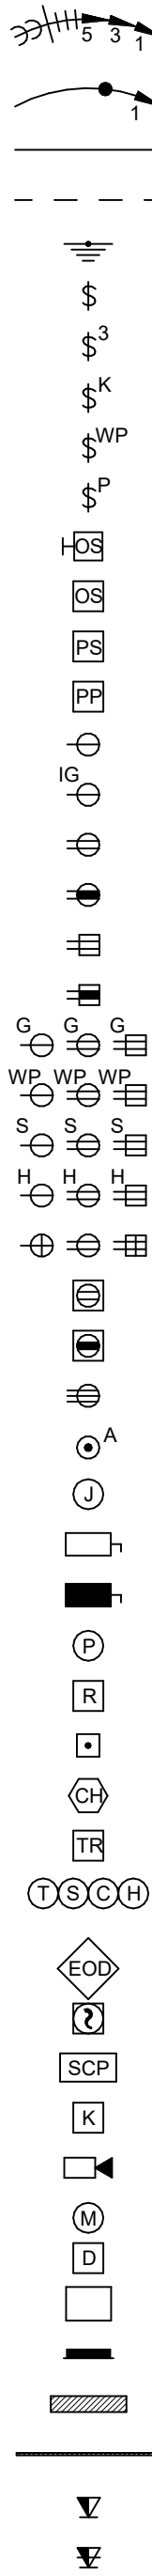

HOME RUN TO PANEL. CIRCUIT NUMBERS, PHASE, NEUTRAL, AND GROUND CONDUCTORS INDICATED ALONG WITH ISOLATED GROUND CONDUCTOR IF APPLICABLE. PARTIAL CIRCUIT.

CONDUIT INSTALLED CONCEALED ABOVE CEILING OR IN WALL.

CONDUIT INSTALLED CONCEALED BELOW FLOOR SLAB OR UNDERGROUND.

GROUND CONNECTION.

SINGLE POLE SWITCH, +3'-10" OR AS NOTED.

THREE-WAY SWITCH, +3'-10" OR AS NOTED.

KEY OPERATED SWITCH, +3'-10" OR AS NOTED.

WEATHERPROOF TOGGLE SWITCH, +3'-10" OR AS NOTED.

SINGLE POLE SWITCH WITH PILOT LIGHT, +3'-10" OR AS NOTED.

WALL MOUNTED OCCUPANCY SENSOR, +3'-10" OR AS NOTED.

CEILING MOUNTED OCCUPANCY SENSOR.

CEILING MOUNTED INTERIOR DAYLIGHT HARVESTING PHOTOCELL SENSOR.

POWER PACK, INSTALLED ABOVE ACCESSIBLE CEILING.

SIMPLEX RECEPTACLE, +18" OR AS NOTED.

ISOLATED GROUND SIMPLEX RECEPTACLE, +18" OR AS NOTED.

DUPLEX RECEPTACLE, +18" OR AS NOTED.

ISOLATED GROUND DUPLEX RECEPTACLE, +18" OR AS NOTED.

QUADRUPLEX RECEPTACLE +18" OR AS NOTED.

ISOLATED GROUND QUADRUPLEX RECEPTACLE, +18" OR AS NOTED.

GROUND FAULT INTERRUPTING RECEPTACLE, +18" OR AS NOTED.

WEATHERPROOF GROUND FAULT INTERRUPTING RECEPTACLE, +18" OR AS NOTED.

SURGE PROTECTED RECEPTACLE, +18" OR AS NOTED.

RECEPTACLE INSTALLED HORIZONTALLY AT +18" OR AS NOTED.

RECEPTACLE INSTALLED HORIZONTALLY, BOTTOM AT +6" ABOVE COUNTER TOP.

RECEPTACLE INSTALLED FLUSH IN CEILING.

ISOLATED GROUND RECEPTACLE INSTALLED FLUSH IN CEILING.

SPECIAL RECEPTACLE, NEMA STYLE AS NOTED, +18" OR AS NOTED.

FLUSH FLOOR MOUNTED RECEPTACLE, LETTER INDICATES TYPE.

JUNCTION BOX.

DISCONNECT SWITCH, TOP AT +6'-0" OR AS NOTED.

DISCONNECT SWITCH PROVIDED WITH EQUIPMENT.

EXTERIOR PHOTOCELL, INSTALLED ON ROOF FACING NORTH.

CONTROL OR POWER RELAY, INSTALLED AS NOTED.

PUSHBUTTON, TOP AT +4'-6" OR AS NOTED.

DOOR BELL CHIMEM, +8'-0" OR AS NOTED.

CONTROL TRANSFORMER, INSTALLED AS NOTED.

THERMOSTAT, TEMPERATURE SENSOR, CARBON DIOXIDE SENSOR AND HUMIDISTAT PROVIDED BY MECHANICAL CONTRACTOR, +3'-10" OR AS NOTED.

ELECTRICALLY OPERATED DAMPER, PROVIDED BY MECHANICAL CONTRACTOR.

120 VOLT DUCT TYPE SMOKE DETECTOR, PROVIDED BY MECHANICAL CONTRACTOR.

SECURITY SYSTEM CONTROL PANEL, TOP AT 6'-0".

KEYPAD, +46" OR AS NOTED.

SECURITY CAMERA.

MOTION DETECTOR, CEILING MOUNTED.

DOOR CONTACTS.

TRANSFORMER, FLOOR MOUNTED OR SUSPENDED FROM STRUCTURE AS NOTED.

BRANCH CIRCUIT PANELBOARD, TOP AT +6'-0" OR AS NOTED.

DISTRIBUTION PANEL, TOP AT +6'-0" OR AS NOTED.

PLYWOOD PHONEBOARD, INSTALLED AS NOTED.

TELEPHONE/DATA OUTLET, +18" WITH 1" CONDUIT TO ABOVE CEILING.

TELEPHONE/DATA OUTLET, +6" WITH ABOVE COUNTER WITH 1" CONDUIT TO ABOVE CEILING.

GENERAL REFERENCES/NOTATIONS:

AC	MOUNT DEVICE +6" ABOVE TOP OF COUNTER TO BOTTOM OF DEVICE.
+48"	MOUNTING HEIGHT ABOVE FINISHED FLOOR TO CENTERLINE OF DEVICE.
03/E5	DETAIL OR SECTION REFERENCE.
???	FOODSERVICE EQUIPMENT DESIGNATION.
#	REVISION DESIGNATION.
TYPE ?	EQUIPMENT DESIGNATION.

ABBREVIATIONS:

AFF/AFG	ABOVE FINISHED FLOOR/GRADE.	NEC	NATIONAL ELECTRICAL CODE.
AHJ	AUTHORITY HAVING JURISDICTION.	NFPA	NATIONAL FIRE PROTECTION ASSOCIATION.
BAS	BUILDING AUTOMATION SYSTEM.	NL	NIGHT LIGHT.
DNR	DEPARTMENT OF NATURAL RESOURCES.	NF	NON-FUSED.
EC	ELECTRICAL CONTRACTOR.	PA	PUBLIC ADDRESS.
EM	EMERGENCY.	PC	PLUMBING CONTRACTOR.
ETR	EXISTING TO REMAIN.	SPD	SURGE PROTECTION DEVICE.
FA	FIRE ALARM.	TYP	TYPICAL.
FPC	FIRE PROTECTION CONTRACTOR.	UL	UNDERWRITERS LABORATORIES.
FSEC	FOOD SERVICE EQUIPMENT CONTRACTOR.	UNO	UNLESS NOTED OTHERWISE.
GC	GENERAL CONTRACTOR.	UPS	UNINTERRUPTIBLE POWER SUPPLY.
MC	MECHANICAL CONTRACTOR.	WP	WEATHERPROOF.

- SYMBOL & LEGEND NOTES:
1. REFER TO LIGHT FIXTURE SCHEDULE FOR SPECIFICATION AND INFORMATION ON ALL LUMINAIRES.
 2. REFER TO SPECIFICATIONS AND PLAN NOTES FOR DETAILED DESCRIPTION OF ALL DEVICES SHOWN IN THIS SCHEDULE, PROVIDED BY THIS CONTRACTOR.
 3. MOUNTING HEIGHTS INDICATED ARE MEASURED FROM FINISHED FLOOR TO THE CENTERLINE OF THE DEVICE UNLESS NOTED OTHERWISE.


ELECTRICAL GENERAL NOTES

- 1 INCLUDE ALLOWANCE FOR UNFORSEEN CONDITIONS THAT MAY EFFECT THE SCOPE OF WORK. MINOR DEVIATIONS REQUIRED FOR ACCOMPLISHING THE INTENT OF THIS DESIGN ARE TO BE INCLUDED IN THIS ALLOWANCE.
- 2 ELECTRICAL DESIGN HAS BEEN BASED ON THE INSTALLATION OF 75°C CONDUCTORS CONNECTED TO TERMINAL LUGS AND EQUIPMENT U.L. LISTED FOR A MINIMUM 75°C CONDUCTORS TERMINATED ON EQUIPMENT WITH A LOWER RATING 60°C) OR NO RATING SHOWN TO HAVE CONDUCTOR SIZE INCREASED TO CONFORM TO ADOPTED ELECTRICAL CODE AND UL/CUL NO. 489 REQUIREMENTS.
- 3 CONDUIT INSTALLED INDOORS SHALL BE ELECTRICAL METALLIC TUBING (EMT), MINIMUM 1/2" OR AS NOTED.
- 4 CONDUIT INSTALLED BELOW SLAB SHALL BE RIGID STEEL, IMC, PVC OR HDPE. MINIMUM 3/4". IF PVC OR HDPE IS USED, TRANSITION TO RIGID STEEL BEFORE TURNING UP AND PENETRATING FLOOR SLAB.
- 5 CONDUCTORS SHALL BE A MINIMUM OF #12 THHN/THWN COPPER UNLESS NOTED OTHERWISE ON PLANS OR IN SPECIFICATIONS. BRANCH CIRCUITS SHALL BE PROVIDED WITH (2) #12 CONDUCTORS AND (1) #12 EQUIPMENT GROUND CONDUCTOR UNLESS NOTED OTHERWISE.
- 6 BRANCH CIRCUITS SHOWN WITH TWO GROUNDING CONDUCTORS SHALL HAVE ONE EQUIPMENT GROUND CONDUCTOR (GREEN) AND ONE ISOLATED GROUND CONDUCTOR (GREEN W/ YELLOW STRIP) INSTALLED IN RACEWAY.
- 7 DIRECT CURRENT WIRING SHALL BE (2) #10 IN 1/2" CONDUIT UNLESS NOTED OTHERWISE.
- 8 CONTROL VOLTAGE WIRING SHALL BE PLENUM RATED OR INSTALLED IN CONDUIT.
- 9 PROVIDE FLEXIBLE CONNECTIONS ONLY FOR FINAL CONNECTION TO EQUIPMENT, 6'-0" MAXIMUM LENGTH. PROVIDE LIQUID TIGHT FLEXIBLE EQUIPMENT, 6'-0" MAXIMUM LENGTH. PROVIDE LIQUID TIGHT FLEXIBLE CONNECTION AT EXTERIOR LOCATIONS AND WHERE EXPOSURE TO MOISTURE IS POSSIBLE.
- 10 ALL EMPTY CONDUITS SHALL BE PROVIDED WITH A PULL WIRE.
- 11 ALL RACEWAYS SHALL CONTAIN A GROUNDING ELECTRODE SIZED PER THE ADOPTED ELECTRICAL CODE.
- 12 COORDINATE WORK ABOVE THE CEILING WITH OTHER TRADES TO PROVIDE THE GREATEST POSSIBLE CLEARANCE. CONDUIT RUNS SHALL BE RUN THROUGH TRUSSES WHERE POSSIBLE.
- 13 VERIFY EXACT PLACEMENT OF ALL DEVICES SHOWN ON THE CONSTRUCTION DOCUMENTS PRIOR TO FINAL PLACEMENT.
- 14 ALL PANELBOARDS, SWITCHBOARDS AND LINE VOLTAGE CONTROL EQUIPMENT SHALL BE FIELD MARKED TO WARN QUALIFIED PERSONS OF POTENTIAL ELECTRIC ARC FLASH HAZARDS. MARKING SHALL BE LOCATED SO AS TO BE CLEARLY VISIBLE TO QUALIFIED PERSONS BEFORE EXAMINATION, ADJUSTING, SERVICING OR MAINTENANCE OF EQUIPMENT. MARKING SHALL BE SLEF ADHESIVE, COMMERCIAL LABEL CONFORMING TO ADOPTED CODES.
- 15 LIGHT SWITCHES, ELECTRICAL OUTLETS, THERMOSTATS AND OTHER ENVIRONMENTAL CONTROLS LOCATED NO HIGHER THAN 48" AND NO LOWER THAN 15" ABOVE THE FLOOR. IF THE REACH IS OVER AN OBSTRUCTION BETWEEN 20" AND 25" IN DEPTH, THE MAXIMUM HEIGHT IS TO BE REDUCED TO 44" FOR FORWARD APPROACH OR 46" FOR SIDE APPROACH. PROVIDED THE OBSTRUCTION IS NO MORE THAN 24" IN DEPTH. OBSTRUCTIONS SHALL NOT EXTEND MORE THAN 25" FROM THE WALL BENEATH A CONTROL.
- 16 TERMS: SHALL - ACTION THAT IS REQUIRED WITHOUT OPTION OR QUALIFICATION. FURNISH - CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING. INSTALL - CONTRACTOR SHALL BE RESPONSIBLE FOR LABOR AND CONSTRUCTION EQUIPMENT NECESSARY TO SET IN PLACE, CONNECT, CALIBRATE AND/OR TEST EQUIPMENT FURNISHED BY HIM OR OTHERS. PROVIDE - CONTRACTOR SHALL FURNISH AND INSTALL.

REMODEL GENERAL NOTES

- 1 ALL EXISTING EQUIPMENT, WIRING DEVICES, LIGHTS, CONDUIT, WIRING, CIRCUITING, ETC., NOT DISTURBED BY NEW CONSTRUCTION WORK SHALL BE MAINTAINED AND UNDAMAGED. THESE DEVICES, IF SHOWN, ARE SHOWN FOR INFORMATION PURPOSES ONLY. VISIT THE JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND FAMILIARIZE THEMSELVES WITH ALL WORK TO BE DONE AT THE JOB SITE. FAILURE TO DO SO SHALL NOT RELIEVE CONTRACTOR OF THE RESPONSIBILITY FOR PERFORMING ALL WORK NECESSARY TO PROVIDE A WORKMANLIKE INSTALLATION.
- 2 EXISTING SERVICES (ELECTRICAL, FIRE ALARM, ETC.) SHALL NOT BE INTERRUPTED WITHOUT PRIOR SCHEDULING OF SUCH OUTAGES WITH THE OWNER, ARCHITECT, AND ALL OTHER PARTIES INVOLVED.
- 3 MAINTAIN ACCURATE RECORDS OF ALL MODIFICATIONS TO EXISTING SYSTEMS WHICH ARE TO REMAIN. DELIVER ALL "RECORD" DRAWINGS TO THE OWNER INDICATING SUCH CHANGES.
- 4 DISCONNECT AND LABEL ABANDONED FEEDERS AND CIRCUITS.
- 5 REMOVE ALL EXPOSED CONDUITS, CONDUITS ABOVE LAY-IN CEILINGS, OR EQUIPMENT WHICH IS ABANDONED.
- 6 WHERE NEW WORK INTERFERES WITH CIRCUITS IN ROOMS OTHERWISE UNDISTURBED, EXISTING CIRCUITS SHALL BE REWORKED AS REQUIRED TO MAINTAIN SERVICE.
- 7 ALL EQUIPMENT, FIXTURES, PANELBOARDS, CONDUIT AND WIRING THAT ARE REMOVED SHALL BE REMOVED FROM THE JOB SITE, UNLESS DIRECTED OTHERWISE BY THE ARCHITECT OR OWNER'S REPRESENTATIVE.
- 8 EXISTING ROUGH-IN BOXES AND CONDUIT MAY BE UTILIZED IF THEY ARE OF PROPER SIZE AND IN SUITABLE LOCATION(S) FOR NEW CONSTRUCTION. DEVICES AND WIRING SHALL BE NEW.
- 9 CIRCUIT ROUTINGS SHOWN IN REMODELED AREAS MAY BE MODIFIED TO SUIT FIELD CONDITIONS. KEEP DEVICES AND/OR FIXTURE CIRCUITS APPROXIMATELY AS INDICATED TO LIMIT VOLTAGE DROP OF FEEDER AND BRANCH CIRCUITS.
- 10 VERIFY THE LOCATION AND CONDITION OF ALL EXISTING UTILITIES AND PROTECT DURING THE COURSE OF THEIR WORK. EXISTING UTILITIES, BUILDING MATERIALS AND ANY ASSOCIATED ITEMS WHICH ARE DAMAGED BY CONTRACTOR'S NEGLIGENCE SHALL BE REPAIRED OR REPLACED AT THE CONTRACTOR'S EXPENSE (IN A TIMELY MANNER) AND TO THE OWNER'S APPROVAL.
- 11 COORDINATE THE REMOVAL OR RELOCATION OF ALL MECHANICAL AND PLUMBING EQUIPMENT. DISCONNECT AND REMOVE ALL ELECTRICAL POWER AND CONTROL CIRCUITS FOR EQUIPMENT BEING REMOVED OR RELOCATED. EXISTING CONDUIT AND ROUGH-IN MAYBE USED FOR RELOCATED OR NEW EQUIPMENT. ALL CONDUCTORS SHALL BE NEW.
- 12 REMOVE ALL EXISTING DATA, TELEPHONE, FIRE ALARM CABLING AND ANY OTHER LOW VOLTAGE WIRING THAT ARE NOT TO BE USED.
- 13 DESIGN IS BASED ON FIELD INFORMATION, AS-BUILT DRAWINGS AND OWNER FURNISHED INFORMATION. VERIFY ACCURACY OF ALL EXISTING CONDITIONS. IN CASE OF DISCREPANCY, PROVIDE ALL NECESSARY CONDUIT, WIRE, BOXES, FITTINGS, ETC. FOR A COMPLETE OPERATING ELECTRICAL SYSTEM. ENTIRE INSTALLATION TO COMPLY WITH SPECIFICATIONS AND ADOPTED ELECTRICAL CODE.

THIS SHEET IS PART OF THE CONSTRUCTION DOCUMENTS. DRAWINGS, SPECIFICATIONS AND OTHER SHEETS APPLY AND NEED TO BE REVIEWED IN TOTAL. ITEMS SHOWN ARE FOR DIAGRAMMATIC REPRESENTATION AND MAY NOT BE RELIED ON OR USED AS SHOP DRAWINGS. PROVIDE ALL MODIFICATIONS REQUIRED TO CONFORM TO SITE CONDITIONS, EQUIPMENT AND MATERIAL USED. VERIFY LOCATIONS AND DIMENSIONS OF ALL ARCHITECTURAL AND STRUCTURAL ELEMENTS PER THEIR RESPECTIVE DOCUMENTS, AS THESE ELEMENTS ARE SHOWN ONLY FOR REFERENCE, AND REQUIRE VERIFICATION PRIOR TO FABRICATION OR CONSTRUCTION. ENGINEER HAS NO LIABILITY FOR THE ACCURACY OF THESE ASSOCIATED ELEMENTS, OR FOR ANY WORK THE ENGINEER HAS NOT SIGNED AND SEALED.

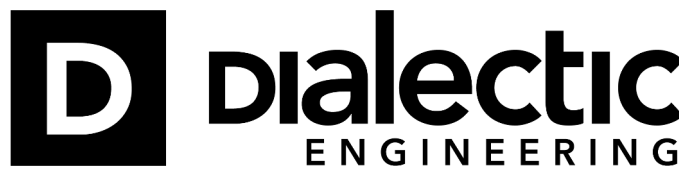

Dialectic Group, Inc.
310 W 20th Street, Suite 200
Kansas City, MO 64108
California Certificate of
Authorization Number C1716

T 816-997-9601
F 816-997-9602
DialecticEng.com
Copyright 2021

CITY OF SAVANNAH
DEVELOPMENT
SERVICES

PLAN
APPROVED
08/02/2021



#605

6700 Abercorn Savannah, GA
31405

Owner:

CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect:

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Michael Orr

MEP Engineer:

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: 816-997-9627
Contact: Joe Hillebrenner, P.E.



A	Permit Issue	2021.07.16
No.	Description	Date

DRAWN BY: AAR
CHECKED BY: ATF
PROJ. NO: 94-21781
Copyright PKWY Architects, LLC 2019 ©

LEGEND & KEYNOTES


E0.0

1. CONNECT EXIST SIGNS, EMERGENCY AND NIGHT LIGHTS TO AN UNSWITCHED LIGHTING CIRCUIT, NOT CONTROLLED BY ANY OCCUPANCY SENSORS, SWITCHES OR CONTACTORS.
2. OUTLETS, SWITCHES, AND PLATES SHALL BE:
 - A) STAINLESS STEEL
 - B) GIGREY AT MARLITE. SAFETY RECEPTACLES, LEVITON 5262-SGG RECEPTACLES, 80703 EG PLATE.
 - C) WHITE AT ALL OTHER AREAS.
 - D) CEILING OUTLET SHALL BE PAINTED TO MATCH CEILING COLOR.
3. PROVIDE A DEDICATED NEUTRAL WITH ALL DIMMING SYSTEM CIRCUITS. NO COMMON NEUTRALS SHALL BE ALLOWED.
4. REFER TO ARCHITECTURAL REFLECTED CEILING PLAN AND DETAILS FOR THE LOCATION OF ALL LIGHTING FIXTURES AND ALL OTHER EQUIPMENT INSTALLED IN THE CEILING SYSTEM. VERIFY MOUNTING HEIGHTS AND FINISHES WITH ARCHITECT PRIOR TO ROUGH-IN.
5. REFER TO THE POWER PLANS FOR LOCATIONS OF ELECTRICAL EQUIPMENT


- 1 PROVIDE JUNCTION BOX FOR SIGNAGE TRANSFORMER WITH CODE REQUIRED DISCONNECT, MOUNTED 24" ABOVE FINISHED ROOF. COORDINATE FINAL LOCATIONS AND REQUIREMENTS WITH SIGNAGE VENDOR PRIOR TO ROUGH-IN. ALL TRANSFORMERS SHALL BE GROUNDED TO JUNCTION BOX. ROUTE CIRCUIT THROUGH PARAPET WALL. DO NOT PENETRATE ROOF.
- 2 CIRCUIT SHALL BE CONTROLLED THRU EXISTING CONTACTOR ACTIVATED BY PHOTOCELL MOUNTED ON ROOF AND DEACTIVATED BY A TIME CLOCK.
- 3 CONNECT TO AND REUSE THE EXISTING BRANCH CIRCUIT AND CONTROLS. PROVIDE OCCUPANCY SENSOR FOR RESTROOMS. EC TO VERIFY CIRCUITS ARE NOT OVERLOADED.
- 4 CONNECT TO EXISTING SPARE LIGHTING BRANCH CIRCUIT. ROUTE THRU SPARE LIGHTING CONTROL SYSTEM CHANDEL. PROVIDE CONTACTOR IF EXISTING SPARE IS NOT AVAILABLE. CONTRACTOR SHALL VERIFY THE LOAD ON THE BRANCH CIRCUIT WHEN COMPLETE AND REPORT FINDINGS TO THE GC/PM IN WRITING.
- 5 RECEPTACLE AND DATA FOR TV MONITORS SUSPENDED FROM STRUCTURE.
- 6 WEATHER PROOF JUNCTION BOX FOR CONNECTIONS TO EYEBROW FEATURE LIGHT FIXTURES. VERIFY EXACT LOCATION. COORDINATE WITH SIGN MANUFACTURER.
- 7 CONNECT TO EXISTING SPARE CIRCUIT. IF NO SPARE CIRCUITS ARE LEFT PROVIDE A 20A CIRCUIT BREAKER MATCHING EXISTING EQUIPMENT.




THIS SHEET IS PART OF THE CONSTRUCTION DOCUMENTS. DRAWINGS, SPECIFICATIONS AND OTHER SHEETS APPLY AND NEED TO BE REVIEWED IN TOTAL. ITEMS SHOWN ARE FOR DIAGRAMMATIC REPRESENTATION AND MAY NOT BE RELIED ON OR USED AS SHOP DRAWINGS. PROVIDE ALL MODIFICATIONS REQUIRED TO CONFORM TO SITE CONDITIONS, EQUIPMENT AND MATERIALS USED. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL ARCHITECTURAL AND STRUCTURAL ELEMENTS PER THEIR RESPECTIVE DOCUMENTS, AS THESE ELEMENTS ARE SHOWN ONLY FOR REFERENCE, AND REQUIRE VERIFICATION PRIOR TO FABRICATION OR CONSTRUCTION. ENGINEER HAS NO LIABILITY FOR THE ACCURACY OF THESE ASSOCIATED ELEMENTS, OR FOR ANY WORK THE ENGINEER HAS NOT SIGNED AND SEALED.

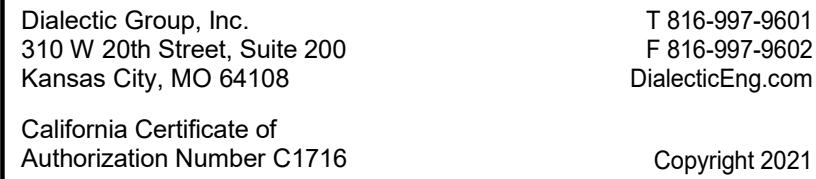


PLAN
APPROVED
02/2021



MEP Engineer:
Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: 816-997-9627
Contact: Joe Hillebrenner, P.E.

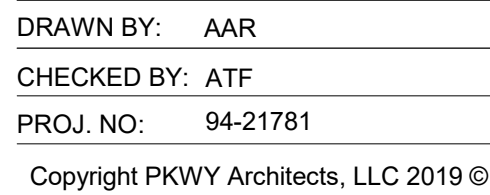

E1.0

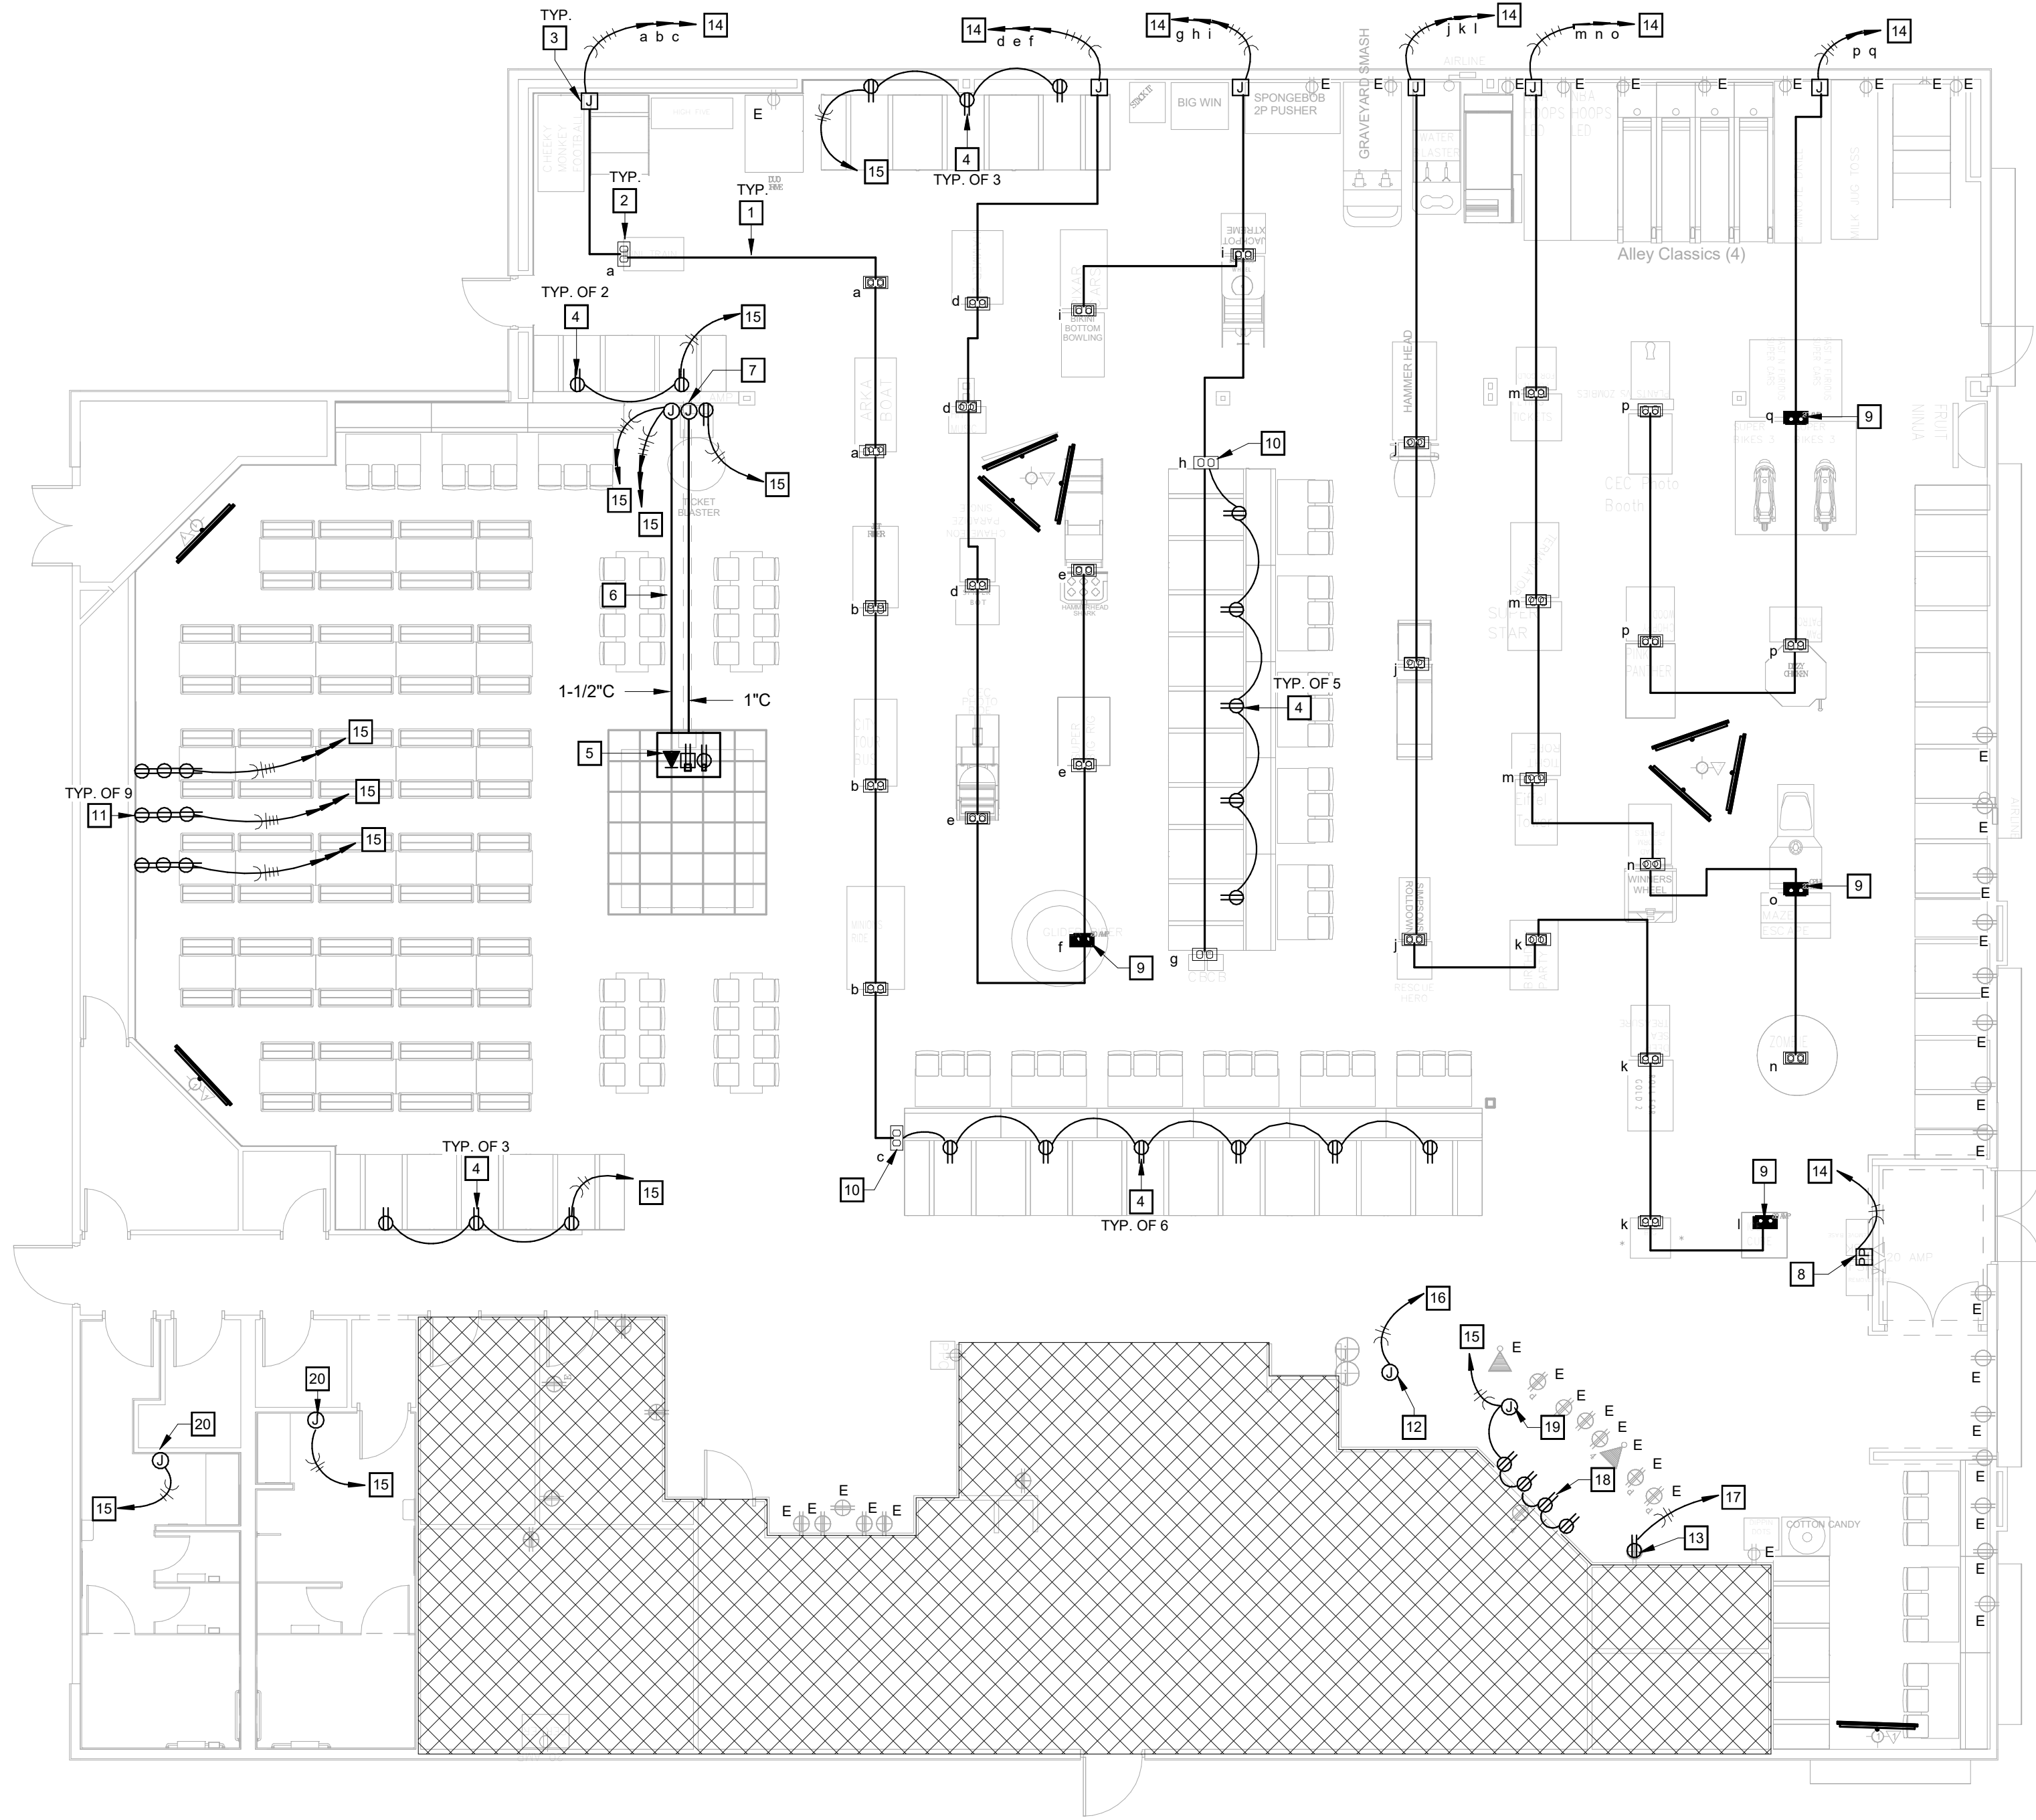

01 POWER FLOOR PLAN

1/8" = 1'-0"



POWER GENERAL NOTES

- 1 ALL OUTLETS ACCESSIBLE TO PUBLIC SHALL BE TAMPER RESISTANT.
- 2 OUTLETS SHALL BE CONCEALED FROM PUBLIC AND LOCATED BEHIND EQUIPMENT.
- 3 REFER TO SHEET A1.2 FOR FLOOR RECEPTACLE LOCATIONS.
- 4 ELECTRICAL CONTRACTOR TO FIELD VERIFY ALL CIRCUIT REQUIREMENTS WITH OWNER AND EXISTING SPARE PANEL SPACE IS AVAILABLE IN PANELS.
- 5 ELECTRICAL CONTRACTOR TO FIELD VERIFY WORKING ORDER AND QUANTITY OF EXISTING CIRCUITS SERVING GAMES.
- 6 CONFIGURATION OF 12'X12'X8" DANCE FLOOR RESESSED BOX MAY VARY PER LOCATION. VERIFY EXACT CONDITIONS WITH OWNER PRIOR TO ROUGH-IN.

BID NOTES

- 1 CONTRACTOR SHALL PROVIDE BID TO INSTALL UNDER CARPET WIRING SYSTEM FOR POWER DISTRIBUTION TO ARCADE GAMES. SYSTEM SHALL COMPLY WITH NEC REQUIREMENTS AND BE AS PROVIDED BY TYCOAMP SYSTEMS. CONTACT SARAH MAKE (817) 213 1533, Sarah.Moake@graybar.com FOR INFORMATION AND QUANTITIES OF FCC AND ACCESSORIES FOR UNDER CARPET WIRING INSTALLATION.
- 2 ADDITIONAL CABLE/FLOOR PREPARATION SHALL BE REQUIRED FOR PROPER INSTALLATION. E.G. FLOOR PREPARATION, TOP SHIELD, ADHESIVE, HOLD-DOWN TAPE, PATCHING, BONDING CLIPS, ETC. COORDINATE WITH MANUFACTURERS RECOMMENDED INSTALLATION TECHNIQUES AND ACTUAL FIELD CONDITIONS. PROVIDE AS NEEDED.

ELECTRICAL KEYNOTES

- 1 TYCOAMP UNDER CARPET WIRING SYSTEM CABLE ROUTE. INSTALL PER MANUFACTURERS RECOMMENDATIONS AND REQUIREMENTS. SEE DETAIL "1" ON SHEET E3.0.
- 2 TYCOAMP UNDER CARPET WIRING SYSTEM ACTIVATION AND OUTLET BOX. INSTALL PER MANUFACTURERS RECOMMENDATIONS AND REQUIREMENTS. VERIFY WITH PROJECT MANAGER ANY FINAL CHANGE TO GAME LAYOUT PRIOR TO INSTALLING. SEE DETAIL "2" ON SHEET E3.0.
- 3 PROVIDE FULLY RECESSED TRANSITION BOX FOR UNDER CARPET WIRING SYSTEM CONNECTION. SEE DETAIL "3" ON SHEET E3.0.
- 4 PROVIDE DUPLEX RECEPTACLE WITH TWO(2) INTEGRAL USB CHARGING PORT AT EACH RECEPTACLE. MOUNT DEVICE HORIZONTALLY ALONG DIMENSION MOUNT @2'-8" A.F.F. INSTALL MC CABLE OR FLEX CONDUIT IN FURNITURE HOLLOW SPACE BETWEEN BOOTHS. VERIFY REQUIREMENTS IN FIELD.
- 5 GC FURNISHED 12"X12'X8" BOX RECESSED INTO FLOOR. (1) QUAD RECEPTACLE SPLIT TO RECEIVE (4) DEDICATED 20A CIRCUITS AND (1) DUPLEX RECEPTACLE TO RECEIVE (1) DEDICATED 20A CIRCUIT. (2) YELLOW CAT6 CABLES STUBBED INTO BOX.
- 6 (2) YELLOW CAT6 CABLES FROM FLOOR BOX TO AV ROOM WITH 12' OF SLACK. YELLOW CAT6 PROVIDED BY CEC AND INSTALLED BY GC.
- 7 EXTEND 1" CONDUIT TO ABOVE ACCESSIBLE CEILING SPACE WITH (2)YELLOW CAT6 BACK TO AV ROOM. YELLOW CAT6 FURNISHED BY CEC.
- 8 SATIN ANODIZED ALUMINUM, 10'-5" TELE-POWER POLE WITH TWO SEPARATE WIREWAY COMPARTMENTS. ONE COMPARTMENT FOR POWER WIRING WITH TWO DUPLEX, 20A, 125 VOLT RECEPTACLES IN COVER FACE AND POWER JUNCTION BOX AT TOP OF POLE. SECOND COMPARTMENT FOR COMMUNICATION WIRING WITH REMOVEABLE COVER SECTION AT BOTTOM OF POLE FOR CABLE ACCESS. WIREMOLD #4MDTF-4.
- 9 GAMES IN THIS LOCATION REQUIRE A DEDICATED 20A, 120V CONNECTION.
- 10 USB DUPLEX INSTALLED AT SEETTES BY MILL.WORK SUPPLIER. GC TO DAISY-CHAIN POWER TO J-BOX.
- 11 RECEPTACLES FOR VIDEO WALL. VERIFY MOUNTING HEIGHT WITH ARCHITECTURAL ELEVATIONS.
- 12 PROVIDE FINAL CONNECTIONS TO STRUCTURE HUNG "YOU WON" SIGN. VERIFY LOCATION WITH ARCHITECT.
- 13 PROVIDE RECESSED RECEPTACLES FOR PROMO BOARD. VERIFY MOUNTING HEIGHT WITH ARCHITECTURAL ELEVATIONS.
- 14 RE-USE EXISTING GAME CIRCUIT
- 15 CONNECT TO EXISTING SPARE CIRCUIT. IF NO SPARE CIRCUITS ARE LEFT PROVIDE A 20A CIRCUIT BREAKER FLOORING EXISTING EQUIPMENT.
- 16 TIE INTO NEAREST GAMES FLOOR LIGHTING CIRCUIT. VERIFY CIRCUIT HAS ENOUGH SPARE CAPACITY FOR NEW LOAD.
- 17 TIE INTO NEAREST CIRCUIT. VERIFY CIRCUIT HAS ENOUGH SPARE CAPACITY FOR NEW LOAD.
- 18 DISCONNECT AND RECONNECT WIRING FROM EXISTING MENU BOARDS. INSTALL (4) DATA AND (4) DUPLEX OUTLETS FOR DIGITAL MENU BOARDS. REF MENU BOARD SECTION DETAIL 2 ON ARCHITECTURAL SHEET A403.
- 19 (1) FLEXIBLE WHIP FOR "PIZZERIA & GAMES" SHALL NOT EXCEED 72" IN LENGTH ROUTE FROM J-BOX IN CEILING TO DIRECT CONNECTION TO SIGN LOCATION OVER DIGITAL MENUS. EXACT WALL PENETRATION LOCATION TO BE VERIFIED WITH SIGN COMPANY.
- 20 PROVIDE RECESSED JUNCTION BOX FOR HAND DRYERS. VERIFY MOUNTING HEIGHT AND EXACT LOCATION WITH ARCHITECT PRIOR TO ROUGH-IN.

THIS SHEET IS PART OF THE CONSTRUCTION DOCUMENTS. DRAWINGS, SPECIFICATIONS AND OTHER SHEETS APPLY AND NEED TO BE REVIEWED IN TOTAL. ITEMS SHOWN ARE FOR DIAGRAMMATIC REPRESENTATION AND MAY NOT BE RELIED ON OR USED AS SHOP DRAWINGS. PROVIDE ALL MODIFICATIONS REQUIRED TO CONFORM TO SITE CONDITIONS, EQUIPMENT AND MATERIAL USED. VERIFY LOCATIONS AND DIMENSIONS OF ALL ARCHITECTURAL AND STRUCTURAL ELEMENTS PER THEIR RESPECTIVE DOCUMENTS, AS THESE ELEMENTS ARE SHOWN ONLY FOR REFERENCE, AND REQUIRE VERIFICATION PRIOR TO FABRICATION OR CONSTRUCTION. ENGINEER HAS NO LIABILITY FOR THE ACCURACY OF THESE ASSOCIATED ELEMENTS, OR FOR ANY WORK THE ENGINEER HAS NOT SIGNED AND SEALED.



Dialectic Group, Inc.
310 W 20th Street, Suite 200
Kansas City, MO 64108

California Certificate of
Authorization Number C1716

T 816-997-9601
F 816-997-9602
DialecticEng.com

Copyright 2021

CITY OF SAVANNAH
DEVELOPMENT
SERVICES

PLAN
APPROVED
08/02/2021



#605

6700 Abercorn Savannah, GA
31405

Owner:

CEC ENTERTAINMENT, INC.
1707 Market Place Blvd. Suite 200
Irving, TX 77063
Ph: 972-258-5521
Contact: Walter Boyd

Architect:

Parkway C&A, LP
1000 Civic Circle
Lewisville, TX 75287
Ph: 972-221-1979
Contact: Michael Orr

MEP Engineer:

Dialectic Engineering
310 W 20th Street 200
Kansas City, MO 64108
Ph: 816-997-9627
Contact: Joe Hillebrenner, P.E.



A	Permit Issue	2021.07.16
No.	Description	Date

DRAWN BY: AAR
CHECKED BY: ATF
PROJ. NO: 94-21781
Copyright PKWY Architects, LLC 2019 ©

POWER FLOOR PLAN

E2.0



**PLAN
APPROVED
08/02/2021**

**PLAN
APPROVED
08/02/2021**

**PLAN
APPROVED
08/02/2021**

**PLAN
APPROVED
08/02/2021**

**PLAN
APPROVED
08/02/2021**

**PLAN
APPROVED
08/02/2021**



**PLAN
APPROVED
08/02/2021**


**PLAN
APPROVED
08/02/2021**

**PLAN
APPROVED
08/02/2021**

**PLAN
APPROVED
08/02/2021**


**PLAN
APPROVED
08/02/2021**

**PLAN
APPROVED
08/02/2021**

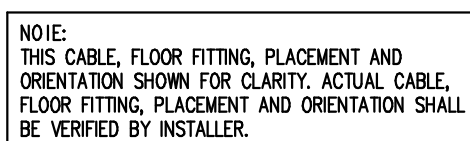

NOTE:
THIS CABLE, FLOOR FITTING, PLACEMENT AND ORIENTATION SHOWN FOR CLARITY. ACTUAL CABLE, FLOOR FITTING, PLACEMENT AND ORIENTATION SHALL BE VERIFIED BY INSTALLER.

NOTE:
THIS CABLE, FLOOR FITTING, PLACEMENT AND ORIENTATION SHOWN FOR CLARITY. ACTUAL CABLE, FLOOR FITTING, PLACEMENT AND ORIENTATION SHALL BE VERIFIED BY INSTALLER.

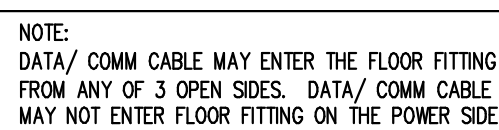

NOTE:
DATA/ COMM CABLE MAY ENTER THE FLOOR FITTING
FROM ANY OF 3 OPEN SIDES. DATA/ COMM CABLE
MAY NOT ENTER FLOOR FITTING ON THE POWER SIDE

NOTE:
DATA/ COMM CABLE MAY ENTER THE FLOOR FITTING
FROM ANY OF 3 OPEN SIDES. DATA/ COMM CABLE
MAY NOT ENTER FLOOR FITTING ON THE POWER SIDE


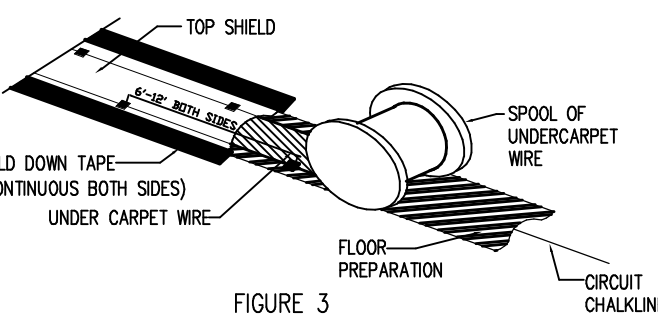


FIGURE 3

FIGURE 3

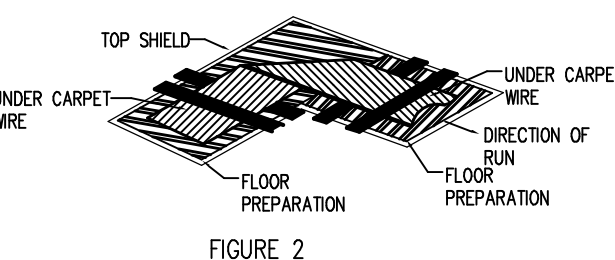

PANEL SCHEDULE NOTES	
GENERAL NOTES:	
	BALANCE PANELS WITHIN 10% PHASE TO PHASE.
EX R	EXISTING CIRCUIT TO REMAIN REUSE EXISTING CIRCUIT BREAKER. VERIFY SPARE BREAKER IS IN GOOD WORKING CONDITION. REPLACE AS REQUIRED.
LOC	HAND LOCK "OFF" CLAMP DEVICE

PANEL SCHEDULE NOTES	
GENERAL NOTES:	
	BALANCE PANELS WITHIN 10% PHASE TO PHASE.
EX R	EXISTING CIRCUIT TO REMAIN REUSE EXISTING CIRCUIT BREAKER. VERIFY SPARE BREAKER IS IN GOOD WORKING CONDITION. REPLACE AS REQUIRED.
LOC	HAND LOCK "OFF" CLAMP DEVICE

PANEL SCHEDULE NOTES	
GENERAL NOTES:	
	BALANCE PANELS WITHIN 10% PHASE TO PHASE.
EX R	EXISTING CIRCUIT TO REMAIN REUSE EXISTING CIRCUIT BREAKER. VERIFY SPARE BREAKER IS IN GOOD WORKING CONDITION. REPLACE AS REQUIRED.
LOC	HAND LOCK "OFF" CLAMP DEVICE

PANEL SCHEDULE NOTES	
GENERAL NOTES:	
	BALANCE PANELS WITHIN 10% PHASE TO PHASE.
EX R	EXISTING CIRCUIT TO REMAIN REUSE EXISTING CIRCUIT BREAKER. VERIFY SPARE BREAKER IS IN GOOD WORKING CONDITION. REPLACE AS REQUIRED.
LOC	HAND LOCK "OFF" CLAMP DEVICE

PANEL SCHEDULE NOTES	
GENERAL NOTES:	
	BALANCE PANELS WITHIN 10% PHASE TO PHASE.
EX R	EXISTING CIRCUIT TO REMAIN REUSE EXISTING CIRCUIT BREAKER. VERIFY SPARE BREAKER IS IN GOOD WORKING CONDITION. REPLACE AS REQUIRED.
LOC	HAND LOCK "OFF" CLAMP DEVICE

PANEL SCHEDULE NOTES	
GENERAL NOTES:	
	BALANCE PANELS WITHIN 10% PHASE TO PHASE.
EX R	EXISTING CIRCUIT TO REMAIN REUSE EXISTING CIRCUIT BREAKER. VERIFY SPARE BREAKER IS IN GOOD WORKING CONDITION. REPLACE AS REQUIRED.
LOC	HAND LOCK "OFF" CLAMP DEVICE

PANEL SCHEDULE NOTES	
GENERAL NOTES:	
	BALANCE PANELS WITHIN 10% PHASE TO PHASE.
EX R	EXISTING CIRCUIT TO REMAIN REUSE EXISTING CIRCUIT BREAKER. VERIFY SPARE BREAKER IS IN GOOD WORKING CONDITION. REPLACE AS REQUIRED.
LOC	HAND LOCK "OFF" CLAMP DEVICE



4 NOT TO SCALE

4 NOT TO SCALE

D **dialectic**
ENGINEERING

T 816-997-9601
F 816-997-9602
DialecticEng.com

Copyright 2021

Copyright 2021

Permit #: 21-06530-BC

Address: 6700 Abercorn Street

Project Name: _____

Date: 7/23/2021

**CITY OF SAVANNAH
DEVELOPMENT SERVICES**

July 23, 2021

Flood Review
Approved: _____ BPrice

**CITY OF SAVANNAH
DEVELOPMENT SERVICES**

July 23, 2021

Mechanical Review
Approved: _____ danliker

**CITY OF SAVANNAH
DEVELOPMENT SERVICES**

July 23, 2021

Electrical Review
Approved: _____ MBignault

**CITY OF SAVANNAH
DEVELOPMENT SERVICES**

July 26, 2021

Building Review
Approved: _____ MShareef

**CITY OF SAVANNAH
PLANNING & URBAN DESIGN**

August 02, 2021

Zoning Review
Approved: _____ tbolton

• Plans reviewed for City of Savannah Construction & Life Safety Codes

This examination of the submitted documents does not relieve the owner, designers and contractor, nor their representatives, from their individual or collective responsibility to comply with the applicable provisions of the State Minimum Standard Codes and all applicable local codes. This examination is not to construe as a check of every item in the plans and does not prevent the Building Official from hereafter requiring corrections of errors in plans or construction.

A complete set of reviewed plans and specifications shall be maintained on the construction site.

• Smoke and CO Detector

☐ Yes ☐ No

Smoke detectors are required in each sleeping room, outside each sleeping area in the immediate vicinity of the bedrooms and on each story. Carbon monoxide detectors are required outside of sleeping areas in the immediate vicinity of bedrooms.

• Special Inspection

When special inspections in accordance with IBC Chapter 17 are required, refer to and coordinate with the statement of special inspections and schedule of special inspections as prepared by the Registered Design Professional. All required documents shall be submitted at the end of project completion or at the end of that phase of work before issuance of the Certificate of Occupancy. Submittal of inspection reports shall be organized per each section of the schedule. The Building Official may require interim reports before completion. Special inspectors engaged to perform the inspections shall be certified in accordance to State Amendment of the latest adopted IBC.

• Sprinkler and Fire Alarm

Refer to Fire Marshal's Office 912-644-5960 or 5961 for new or retrofit of fire sprinkler, fire alarm and/or fire suppression system.

• Revision

For any revisions of approved plans reviewed by the Building Official, pertaining to but not limited to reconfiguration of space, layout, structural and MEP, requires submittal of two sets of revised plans before proceeding, unless approved by the Building Official.

• Separate Sign and Awning Permit

All exterior signage and awning will require a separate permit.

**CITY OF SAVANNAH
DEVELOPMENT
SERVICES**

PLAN

**APPROVED
08/02/2021**

**ALL EXTERIOR
SIGNAGE WILL
REQUIRE A
SEPARATE PERMIT**